

Oxford Falls Grammar School



Preliminary Site Investigation,
1078 Oxford Falls Road, Oxford Falls,
NSW.

ENVIRONMENTAL



WATER



WASTEWATER



GEOTECHNICAL



CIVIL



PROJECT
MANAGEMENT



P1907548JR01V02
March 2020

Copyright Statement

Martens & Associates Pty Ltd (Publisher) is the owner of the copyright subsisting in this publication. Other than as permitted by the Copyright Act and as outlined in the Terms of Engagement, no part of this report may be reprinted or reproduced or used in any form, copied or transmitted, by any electronic, mechanical, or by other means, now known or hereafter invented (including microcopying, photocopying, recording, recording tape or through electronic information storage and retrieval systems or otherwise), without the prior written permission of Martens & Associates Pty Ltd. Legal action will be taken against any breach of its copyright. This report is available only as book form unless specifically distributed by Martens & Associates in electronic form. No part of it is authorised to be copied, sold, distributed or offered in any other form.

The document may only be used for the purposes for which it was commissioned. Unauthorised use of this document in any form whatsoever is prohibited. Martens & Associates Pty Ltd assumes no responsibility where the document is used for purposes other than those for which it was commissioned.

Limitations Statement

The sole purpose of this report and the associated services performed by Martens & Associates Pty Ltd is to provide a Preliminary Site Investigation at the subject site in accordance with the scope of services set out in the contract / quotation between Martens & Associates Pty Ltd and Oxford Falls Grammar School (hereafter known as the Client). That scope of works and services were defined by the requests of the Client, by the time and budgetary constraints imposed by the Client, and by the availability of access to the site.

Martens & Associates Pty Ltd derived the data in this report primarily from a number of sources which may include for example site inspections, correspondence regarding the proposal, examination of records in the public domain, interviews with individuals with information about the site or the project, and field explorations conducted on the dates indicated. The passage of time, manifestation of latent conditions or impacts of future events may require further examination / exploration of the site and subsequent data analyses, together with a re-evaluation of the findings, observations and conclusions expressed in this report.


In preparing this report, Martens & Associates Pty Ltd may have relied upon and presumed accurate certain information (or absence thereof) relative to the site. Except as otherwise stated in the report, Martens & Associates Pty Ltd has not attempted to verify the accuracy or completeness of any such information (including for example survey data supplied by others).

The findings, observations and conclusions expressed by Martens & Associates Pty Ltd in this report are not, and should not be considered an opinion concerning the completeness and accuracy of information supplied by others. No warranty or guarantee, whether express or implied, is made with respect to the data reported or to the findings, observations and conclusions expressed in this report. Further, such data, findings and conclusions are based solely upon site conditions, information and drawings supplied by the Client etc. in existence at the time of the investigation.

This report has been prepared on behalf of and for the exclusive use of the Client, and is subject to and issued in connection with the provisions of the agreement between Martens & Associates Pty Ltd and the Client. Martens & Associates Pty Ltd accepts no liability or responsibility whatsoever for or in respect of any use of or reliance upon this report by any third party.

© March 2020
Copyright Martens & Associates Pty Ltd
All Rights Reserved

Head Office
Suite 201, 20 George Street
Hornsby, NSW 2077, Australia
ACN 070 240 890 ABN 85 070 240 890
Phone: +61-2-9476-9999
Fax: +61-2-9476-8767
Email: mail@martens.com.au
Web: www.martens.com.au

Document and Distribution Status							
Author(s)		Reviewer(s)		Project Manager		Signature	
William Xu		Brett McLennan Jeff Fulton		Jeff Fulton			
Revision No.	Description	Status	Release Date	Distribution			
				File Copy	Oxford Falls Grammar School	EPM Projects	
1	Draft for Client comment	Draft	14.02.2020	1E 1P	1P	1P	
2	Amended draft report	Draft	19.02.2020	1E 1P	1P	1P	
3	Final for submission	Final	20.03.2020	1E 1P	1P	1P	

Distribution Types: F = fax, H = hard copy, P = PDF document, E = other electronic format. Digits indicate number of document copies.

All enquiries regarding this project are to be directed to the Project Manager.

Contents

1 INTRODUCTION.....	7
1.1 Overview	7
1.2 Previous Assessments	7
1.3 Proposed Development	7
1.4 Objectives	7
1.5 Project Scope	8
1.6 Guideline Reference Documents	8
2 SITE DESCRIPTION	9
2.1 Site Details	9
2.2 Hydrogeology	10
3 SITE CONTAMINATION ASSESSMENT.....	11
3.1 Council Historical Site Records (JK, 2019)	11
3.2 NSW EPA Records	11
3.3 External Potentially Contaminating Activities	12
3.4 Aerial Photograph Review	12
3.5 Site Walkover Inspection	13
3.6 Preliminary Areas of Environmental Concern/Contaminants of Potential Concern	13
3.7 Previous Assessment Results	13
4 DISCUSSION AND CONCLUSION	15
5 RECOMMENDATIONS.....	16
6 LIMITATIONS STATEMENT	17
7 REFERENCES	18

Attachments

ATTACHMENT A : AERIAL PHOTOGRAPHY

ATTACHMENT B : PROPOSED DEVELOPMENT PLANS

ATTACHMENT C: EIS WASTE CLASSIFICATION ASSESSMENT AND SOIL SUITABILITY ANALYSIS (2017)

Tables

Table 1: Site background information.	9
Table 2: Available hydrogeological information.	10
Table 3: Available Council records.	11
Table 4: Potentially contaminating activities.	11
Table 5: Aerial photograph observations from 1956 to 2019.	12
Table 6: Preliminary areas of environmental concern and contaminants of potential concern.	13

General Abbreviations

AASS	Actual acid sulfate soil
ABC	Ambient background concentrations
ACM	Asbestos containing material
AEC	Area of environmental concern
AF	Asbestos fines
AMP	Asbestos Management Plan
ANZECC	Australia and New Zealand Environment Conservation Council
ANZG	Australian and New Zealand Governments
ASC NEPM	National Environmental Protection (Assessment of Site Contamination) Measure (2013)
ASS	Acid sulfate soil
ASSMAC	Acid Sulfate Soils Management Advisory Committee
AST	Above ground storage tank
BGL	Below ground level
BH	Borehole
BTEXN	Benzene, toluene, ethylbenzene, xylene, naphthalene
CEMP	Construction Environmental Management Plan
COC	Chain of custody
COPC	Contaminants of potential concern
DA	Development application
DBT	Dibutyltin
DEC	Department of Environment and Conservation
DECC	Department of Environment and Climate Change
DNAPL	Dense non aqueous phase liquid
DP	Deposited Plan
DPI	NSW Department of Primary Industry
DPIW	NSW Department of Primary Industry – Water
DQI	Data quality indicators
DQO	Data quality objectives
DSI	Detailed Site Investigation
EAC	Ecological assessment criteria
EIL	Ecological investigation level
EMP	Environmental Management Plan
EPA	NSW Environmental Protection Authority
EQL	Estimated quantification limit (Interchangeable with PQL and LOR)
ESA	Environmental Site Assessment
ESL	Ecological screening level
FA	Fibrous asbestos
GIL	Groundwater investigation level
HIL	Health investigation level
HM	Heavy metals
HSL	Health screening level
IA	Investigation area
ISQG	Interim Sediment Quality Guideline
ITP	Inspection Testing Plan
LGA	Local government area
LNAPL	Light non aqueous phase liquid
LOR	Limit of reporting (Interchangeable with EQL and PQL)
MA	Martens & Associates Pty Ltd
mAHD	Metres, Australian Height Datum
mbgl	Metres below ground level

MBT	Monobutyltin
MNA	Monitored natural attenuation
MPE	Multi phase extraction
NAPL	Non aqueous phase liquid
NATA	National Association of Testing Authorities
ND	No data
NEPC	National Environment Protection Council
NEPM	National Environment Protection Measure
OCP	Organochloride pesticides
OEHS	NSW Office of Environment and Heritage
OPP	Organophosphorus pesticides
PACM	Potential asbestos containing material
PAH	Polycyclic aromatic hydrocarbons
PASS	Potential acid sulfate soil
PCB	Polychlorinated biphenyl
PCEMP	Post Construction Environmental Management Plan
PESA	Preliminary Environmental Site Assessment
PFAS	Per- and polyfluoroalkyl substances
PID	Photoionisation detector
ppb	Parts per billion
ppm	Parts per million
PQL	Practical quantification limit (Interchangeable with EQL and LOR)
PSI	Preliminary Site Investigation
QA/QC	Quality assurance / quality control
RAC	Remediation acceptance criteria
RAP	Remedial Action Plan
HHRA	Human Health Risk Assessment
RPD	Relative percentage difference
SAC	Site assessment criteria
SAQP	Sampling and Analysis Quality Plan
SEPP	State Environmental Planning Policy
SIL	Soil investigation level
SOP	Standard operating procedure
SWL	Standing water level
SWMS	Safe Work Method Statement
TB	Trip blank
TBT	Tributyl tin
TCLP	Toxicity characteristics leaching procedure
TEQ	Toxic equivalency factor
TP	Test pit
TPH	Total petroleum hydrocarbons
TRH	Total recoverable hydrocarbons
TS	Trip spike
UCL	Upper confidence limit
UPSS	Underground petroleum storage system
UST	Underground storage tank
VHC	Volatile halogenated compounds
VOC	Volatile organic compounds
WHS	Work health and safety
WHSP	Work Health and Safety Plan

1 Introduction

1.1 Overview

This report, prepared by Martens and Associates (MA), documents a Preliminary Site Investigation (PSI) of potentially contaminating activities, to support a Part 5 Activity using a Review of Environmental Factors for construction of the administration and library development (the Project) for Oxford Falls Grammar School at 1075 Oxford Falls Road, Oxford Falls, NSW ('the site').

The investigation area (IA) for this PSI is limited to the southeast portion of the school site, as shown in Attachment A.

1.2 Previous Assessments

JK Environmental previously undertook a Stage 1 Environmental Site Assessment (report reference E30807Brpt Rev2) for a proposed kiosk in the southwest portion of the school site [November 2019] (JK, 2019).

JK Geotechnics previously provided a geotechnical investigation (report reference 30807SYrpt) for the proposed sporting facility, car park and playing field in the southern portion of the site [October 2017] (JK, 2017).

Environmental Investigation Services (EIS) undertook a Waste Classification Assessment and Soil Suitability Analysis (report reference E30807KMlet-WC_rev1) for the playing field in the southwest portion of the site [November, 2017] (EIS, 2017). The testing undertaken as part of EIS (2017) covers the IA for this PSI. EIS's (2017) results and findings are summarised in Section 3.8, with a copy of their assessment provided in Attachment C.

1.3 Proposed Development

The proposed site development involves the construction of an on grade car park with first floor library, and an administration building directly north of the library (EPM, 2019).

The proposed development plans are provided in Attachment B.

1.4 Objectives

Investigation objectives include:

- Identification of historic and current potentially contaminating site activities.

- Evaluation of areas of environmental concern (AEC) and associated contaminants of potential concern (COPC) within the IA.
- Assess identified AEC and associated COPC.
- Provide comment on the suitability of the IA for the future use, and where required, provide recommendations for additional investigations.

1.5 Project Scope

The scope of works includes:

- Walkover inspection to review current land use, potential contaminating activities and neighbouring land use.
- Site history review using aerial photographs and available historic records.
- Review of previous investigations on the site related to contamination.
- Review of NSW EPA notices under the Contaminated Land Management Act (1997).
- Preparation of a report in general accordance with the relevant sections of NSW OEH (2011) and ASC NEPM (2013) and EPA (2017).

1.6 Guideline Reference Documents

- ASC NEPC (1999, amended 2013) National Environmental Protection (Assessment of Site Contamination) Measure. Referred to as ASC NEPM (2013).
- NSW EPA (2017) 3rd Ed. Contaminated Land Management: Guidelines for the NSW Site Auditor Scheme.
- NSW OEH (2011) Contaminated Sites: Guidelines for Consultants Reporting on Contaminated Sites.

2 Site Description

2.1 Site Details

Site information is summarised in Table 1, and site location and general surrounds shown in Attachment A.

Table 1: Site background information.

Item	Description / Detail
Site address	1078 Oxford Falls Road, Oxford Falls, NSW.
Legal Identifier	Lot 100 DP 1240806
Approximate site area	4.2 ha (Sixmaps, 2019)
Approximate IA area	0.5 ha (Sixmaps, 2019)
Local Government Area	Northern Beaches Council
Current zoning and land use	Zoned RE1 – Public Recreation (Planning Portal, 2019). Site is currently used for as a primary and secondary school.
Site description	Oxford Falls Grammar School at the north and southeast portion of the site, and a sports field at the southwest portion of the site.
Surrounding land uses	Church to the west of the site. Low density residential dwellings east and south.
Topography	The site is relatively flat with grades < 5%. Site elevation ranges between approximately 79 mAHD in the northeastern portion and 73 mAHD in the western portion of the site (Google Earth Pro. 2019).
Expected geology	<p>The Sydney 1:100,000 Geological Sheet 9030 describes site geology as Hawkesbury Sandstone, which typically consists of medium to coarse grained quartz sandstone with minor shale and laminite lenses.</p> <p>The NSW Environment and Heritage eSPADE website identifies the northeast portion of the site as having soils of the Hawkesbury landscape comprising of shallow discontinuous lithosols / siliceous sands associated with rock outcrops; earth sands, yellow earths and some yellow podzolic soils on inside of benches and along joints and fractures; localised yellow and red podzolic soils associated with shale lenses; siliceous sands and secondary yellow earths along drainage lines.</p> <p>The remainder of the site have soils of the Oxford Falls landscape having moderately deep to deep earthy sands, yellow earths, siliceous sands on slopes; deep leaches sands, podzols and grey earths on valley floors.</p>
Surface hydrology	<p>Drainage of the site is via overland flow northwest, to an unnamed tributary of Middle Creek (which bisects the school site).</p> <p>The unnamed tributary is located along the northeast boundary of the IA.</p>

2.2 Hydrogeology

Review of WaterNSW Real-time Water Database, indicated two groundwater bores within 500 m of the site, as summarised in Table 2.

Table 2: Available hydrogeological information.

Bore Identification	Record Date	Intended Use	Standing Water Level (mbgl)	First Water Bearing Zone (mbgl) and Substrate	Distance and Direction from IA
GW108250	2007	Recreation	21.0	Sandstone	350 m southwest
GW032798	1970	Domestic	4.8	Sandstone	450 m northwest

Groundwater inflow was encountered during a geotechnical investigation by JK (2017) between 3 – 5 mbgl, with standing water levels between 2.8 – 4.5 mbgl.

No springs were listed within 500 m of the site in the NSW Government Hydrography Spatial Data (SEED, 2019).

Should further information on permanent site groundwater conditions be required, an additional assessment would need to be carried out (i.e. installation of groundwater monitoring bores / ongoing groundwater monitoring).

3 Site Contamination Assessment

3.1 Council Historical Site Records (JK, 2019)

One historic development record was held by Council for the site. Details are summarised in Table 3 and records can be found in JK (2019).

Table 3: Available Council records.

Lot ID	Year	Record Number	Description
Lot 100 DP 1240806	1979	3675/P1 079- 1080	Erection of stages of a primary and infants school comprising twelve classrooms, library, hall and administration office, playing field, carpark and associated landscaping. The enclosed pool and caretaker's cottage were to be retained. Proposed playing field involved site filling for flat surface.

3.2 NSW EPA Records

No sites within 500 m of the IA were identified on the list of NSW contaminated sites notified to the EPA as required by the Contaminated Land Management Act (1997) and the Environmentally Hazardous Chemicals Act (1985).

One site within 500 m of the IA was listed on the EPA public register required under section 308 of the Protection of the Environment Operations Act 1997 (the POEO Act), which lists licences, notices penalty notices and convictions, is summarised in Table 4.

Table 4: Potentially contaminating activities.

Licence Number	Site Name	Approximate Distance from Site Boundary	Direction from Site	Gradient from Site
4584	Numeve Pty Ltd	290 m	Northeast	Up gradient

The licenced activities include the recovery of general waste, waste storage and application of herbicides to waterways.

Due to the distance and proximity from the site, the above location is not expected to have impacted near surface soils or groundwater within the IA.

Due to the above site being downstream of the IA, the above activity is also unlikely to have impacted surface water at the IA.

3.3 External Potentially Contaminating Activities

No potentially contaminating activities, such as service stations, mechanics and dry cleaners, were identified within 500 m of the site.

3.4 Aerial Photograph Review

Aerial photographs taken of the site during between 1956 and 2019, were reviewed to investigate historic site land uses (Table 4). Copies of aerial photographs from 1956 to 2009 are provided in JK (2019), and are reproduced as shown in Attachment A along with a recent site aerial from Nearmap 2019.

The aerials indicated that the IA was cleared prior to 1956, and a large shed constructed between 1961 and 1965. The large shed was demolished between 1982 and 1991, and the current site conditions were constructed between 1991 and 2005.

Table 5: Aerial photograph observations from 1956 to 2019.

Year (Source)	IA Activity	Surrounding Land Use
1956	The site was cleared.	Surrounding land was rural residential properties with market gardens and orchards, particularly to the west.
1961	Little to no change from previous.	Sheds constructed to the west, otherwise little to no change from previous.
1965	A large shed (possible warehouse) was constructed to the west of the IA which partly protruded into the IA.	Sheds constructed to the north, otherwise little to no change from previous.
1970	Little to no change from previous.	Little to no change from previous.
1982	Little to no change from previous, minor extension to eastern side of shed.	A number of sheds in the north in the site demolished, otherwise little to no change from previous.
1991	Large shed was demolished.	Sheds demolished to the west, otherwise little to no change from previous.
2005	The current oval was constructed.	Oxford Falls Grammar School has been constructed. The area west of the site was no longer used for agricultural purposes and a church has been constructed to the west of the site. Residential development constructed to the east.
2009	Little to no change from previous.	Little to no change from previous.
2019 (Nearmaps)	Little to no change from previous.	Little to no change from previous.

3.5 Site Walkover Inspection

Observations during the site walkover inspection 17 December 2019, were as follows:

- The IA was used as a sports field with an unnamed tributary of Middle Creek flowing northwest along the northern and eastern boundary of the IA.
- The school site is bisected by the tributary of Middle Creek along a southeast to northwest transect.
- The site was bounded by Oxford Falls Road to the east, Dreadnought Road to the south, Wakehurst Parkway to the west and bush to the north.
- The IA appeared to be composed of fill to level the sports field, as observed from the raised levee banks from the unnamed tributary.
- No other obvious signs of contamination (i.e. asbestos, soil staining, odours) were noted.

3.6 Preliminary Areas of Environmental Concern/Contaminants of Potential Concern

Our assessment of site AEC and COPC (Table 6) for the IA was made on the basis of available site history, aerial photograph interpretation, site walkover and geotechnical drilling (JK, 2017).

Table 6: Preliminary areas of environmental concern and contaminants of potential concern.

AEC	Potential for Contamination	COPC
AEC A Fill	Fill from unknown sources has the potential to add contamination including hydrocarbons, heavy metals, pesticides and asbestos.	HM, TRH, BTEXN, PAH, OCP / OPP and asbestos
AEC B Former shed including curtilage 5 m	Pesticides and heavy metals may have been used underneath past shed for pest control. Building construction may include PACM, zinc treated (galvanised) metals, and lead based paints. Garage may have previously stored fuels, oils and chemicals.	HM, TRH, BTEXN, PAH, OCP / OPP and asbestos

3.7

3.7 Previous Assessment Results

Subsurface soil investigation by EIS (2017) to support a waste classification assessment and soil suitability analysis within the sports

playing field involved the excavation of twenty one boreholes, of which ten were inside the IA for this investigation. Fill was observed up to 2.5 mbgl (BH4) and alluvium up to 5.5 mbgl (BH4).

Soil samples were sent to a NATA registered laboratory (Envirolab Services) by EIS (2017) for soil analysis, which involved:

- Fifteen samples for HM, BTEXN, PAH, TRH;
- Ten samples for asbestos;
- Five samples for OCP and OPP.

BTEXN, TRH, OCP and OPP results were all below laboratory practical quantitation limits (PQL), and all other results were below ASC NEPM (2013) site assessment criteria (SAC) for Residential A.

No asbestos was detected in samples analysed.

4 Discussion and Conclusion

The review of the site history indicated that the IA was cleared prior to 1956 and a large shed constructed between 1961 and 1965. The shed was demolished between 1982 and 1991, and the current Oxford Falls Grammar school oval has been in place since.

Potential contamination sources are summarised as:

- The entire IA which appears to be filled to level the sports field.
- Former shed which occupied a small eastern portion within the IA.

Subsurface soil investigation by JK (2017) indicated fill was observed up to 2.5 mbgl (BH4) and alluvium up to 5.5 mbgl (BH4).

EIS (2017) documented a waste classification and soil suitability analysis which covered the entire IA and preliminary AEC noted in this PSI. Samples were sent to a laboratory and assessed against COPC noted in this PSI.

Soil analysis indicated all samples to be below ASC NEPM (2013) Residential A guidelines. In light of this, the fill across the entire IA and former shed AEC is not considered to pose a risk of contamination and does not require further investigation.

Overall, the IA is considered to have a low risk of broadscale or localised contamination, and will be suitable for the proposed development. It should be noted, however, that past filling undertaken from unknown sources still has a risk of contamination. This risk should be managed by implementing an appropriately prepared unexpected finds protocol. This document should be made available to all contractors working on the site and included as part of the site induction process.

5 Recommendations

Based on the findings of the historical analysis and EIS (2017) soil analysis results, no further investigation for contamination is warranted.

An unexpected finds protocol is to be prepared prior to works commencing on the site. If any unexpected finds (such as fibro material, odours or soil staining) are encountered during site works, the unexpected find will require assessment by MA to determine requirements for additional investigation and / or remedial action.

If any soil material is removed from site, a formal waste classification assessment shall be required in accordance with the NSW EPA Waste Classification Guidelines (2014).

6 Limitations Statement

The PSI was undertaken in line with current industry standards.

It is important, however, to note that no land contamination study can be considered to be a complete and exhaustive characterisation of a site nor can it be guaranteed that any assessment shall identify and characterise all areas of potential contamination or all past potentially contaminating land-uses. Therefore, this report should not be read as a guarantee that no contamination shall be found on the site. Should material be exposed in future which appears to be contaminated or inconsistent with natural site soils, additional testing may be required to determine the implications for the site.

Martens & Associates Pty Ltd has undertaken this assessment for the purposes of the current development proposal. No reliance on this report should be made for any other investigation or proposal. Martens & Associates Pty Ltd accepts no responsibility and provides no guarantee regarding the characteristics of areas of the site not specifically studied in this investigation.

- ASC NEPM (1999, amended 2013) *National Environmental Protection (Assessment of Site Contamination) Measure*, 2013.
- Environmental Information Services (2017) *Waste Classification Assessment and Soil Suitability Analysis (Proposed playing field development at Oxford Grammar School)*. Ref. E30807KMlet-WC_rev1 (EIS, 2017).
- EPM Projects Pty Ltd (2019), Oxford Falls Grammar School – Main Works Project Brief, Document No. P02-TEM-004, Revision A (EPM, 2019).
- Google Earth Pro (2019).
- Herbert C., 1983, Sydney 1:100 000 Geological Sheet 9130, 1st edition. Geological Survey of New South Wales, Sydney.
- JK Geotechnics (2017) *Geotechnical Investigation (Proposed new sporting facility, car park and playing field at Oxford Grammar School)*. Ref. 30807SYrpt (JK, 2017).
- JK Environmental (2019) *Stage 1 Environmental Site Assessment (Proposed new kiosk development at Oxford Grammar School)*. Ref. E30807Brpt Rev. 2 (JK, 2019). Nearmap – Aerial photographs (2019).
- NSW Department of Environment & Heritage (eSPADE, NSW soil and land information), www.environment.nsw.gov.au.
- NSW Department of Planning, Industry and Environment (Planning Portal, 2019) www.planningportal.nsw.gov.au/spatialviewer.
- NSW EPA (2017) 3rd Ed. *Contaminated Land Management: Guidelines for the NSW Site Auditor Scheme*.
- NSW EPA (2014) *Waste Classification Guidelines*. NSW OEH (2011) *Contaminated Sites: Guidelines for Consultants Reporting on Contaminated Sites, 2nd Edition*. Sixmaps (2019)
- State Environmental Planning Policy No. 55 – *Remediation of Contaminated Land*.
- WaterNSW Real-Time Water Database, accessed 16 December 2019, <https://realtimedata.waternsw.com.au/water.stm>.

Attachment A: Aerial Photography

PRELIMINARY DRAFT
NOT FOR
DISTRIBUTION



Legend
 Site Boundary

0 30 60 90 120 150 m

1:2500 @ A4

Map Title / Figure:

2019 Aerial Image (Nearmaps, 2019)


Aerial Imagery 2009

Wakehurst Parkway, Oxford Falls, NSW 2100



Aerial Imagery 2005

Wakehurst Parkway, Oxford Falls, NSW 2100

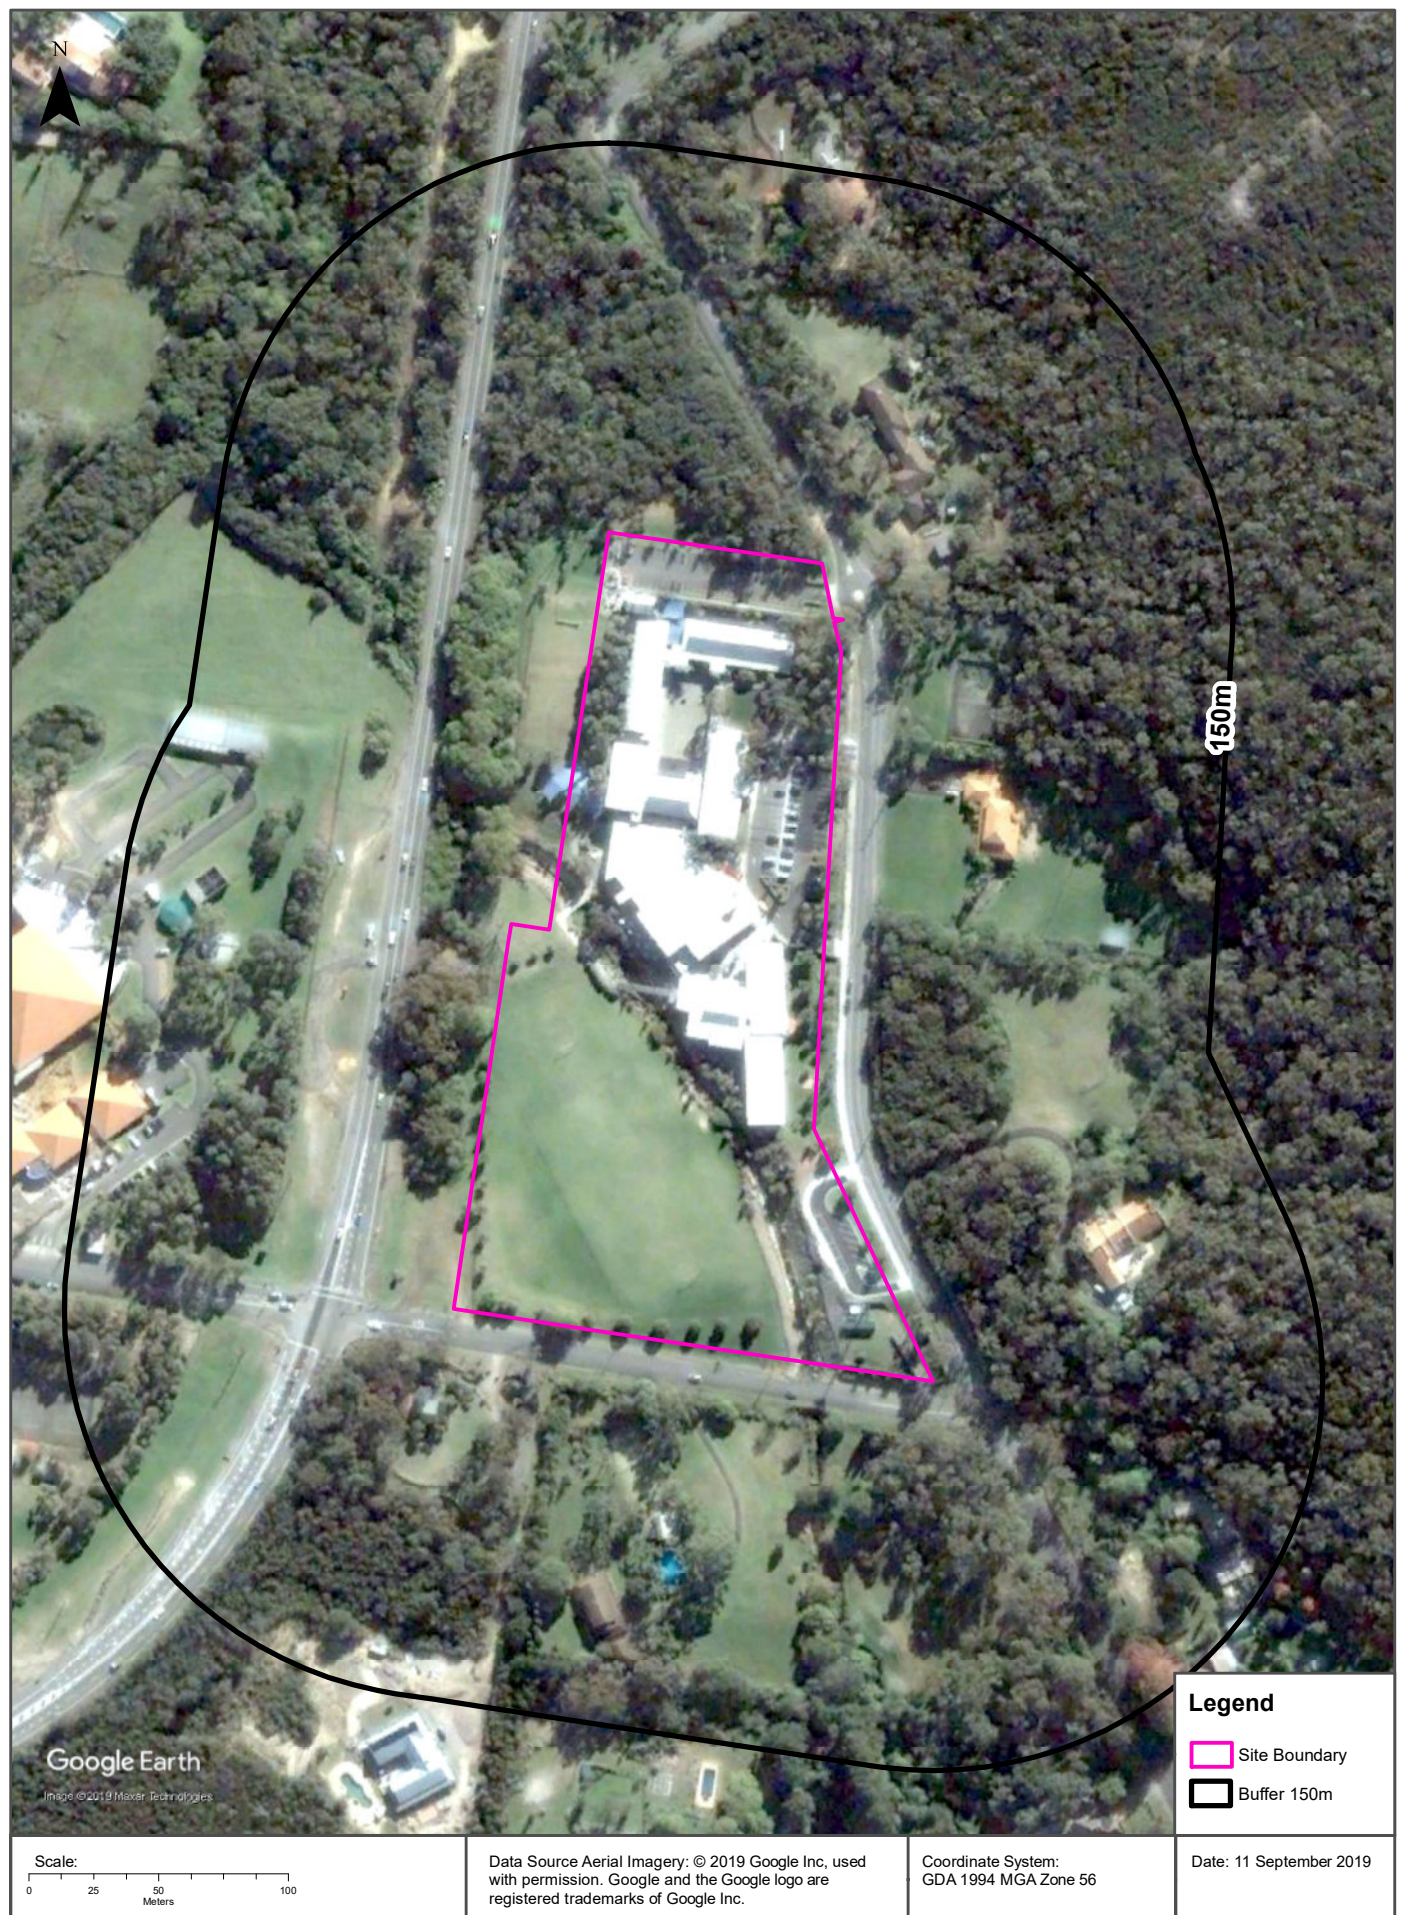

Aerial Imagery 1991


Wakehurst Parkway, Oxford Falls, NSW 2100



<p>Scale:</p> <p>0 25 50 100</p> <p>Metres</p>	<p>Data Sources: Aerial Imagery © Department of Finance, Services & Innovation</p>	<p>Coordinate System: GDA 1994 MGA Zone 56</p>	<p>Date: 12 September 2019</p>
--	--	--	--------------------------------

Aerial Imagery 1982

Wakehurst Parkway, Oxford Falls, NSW 2100

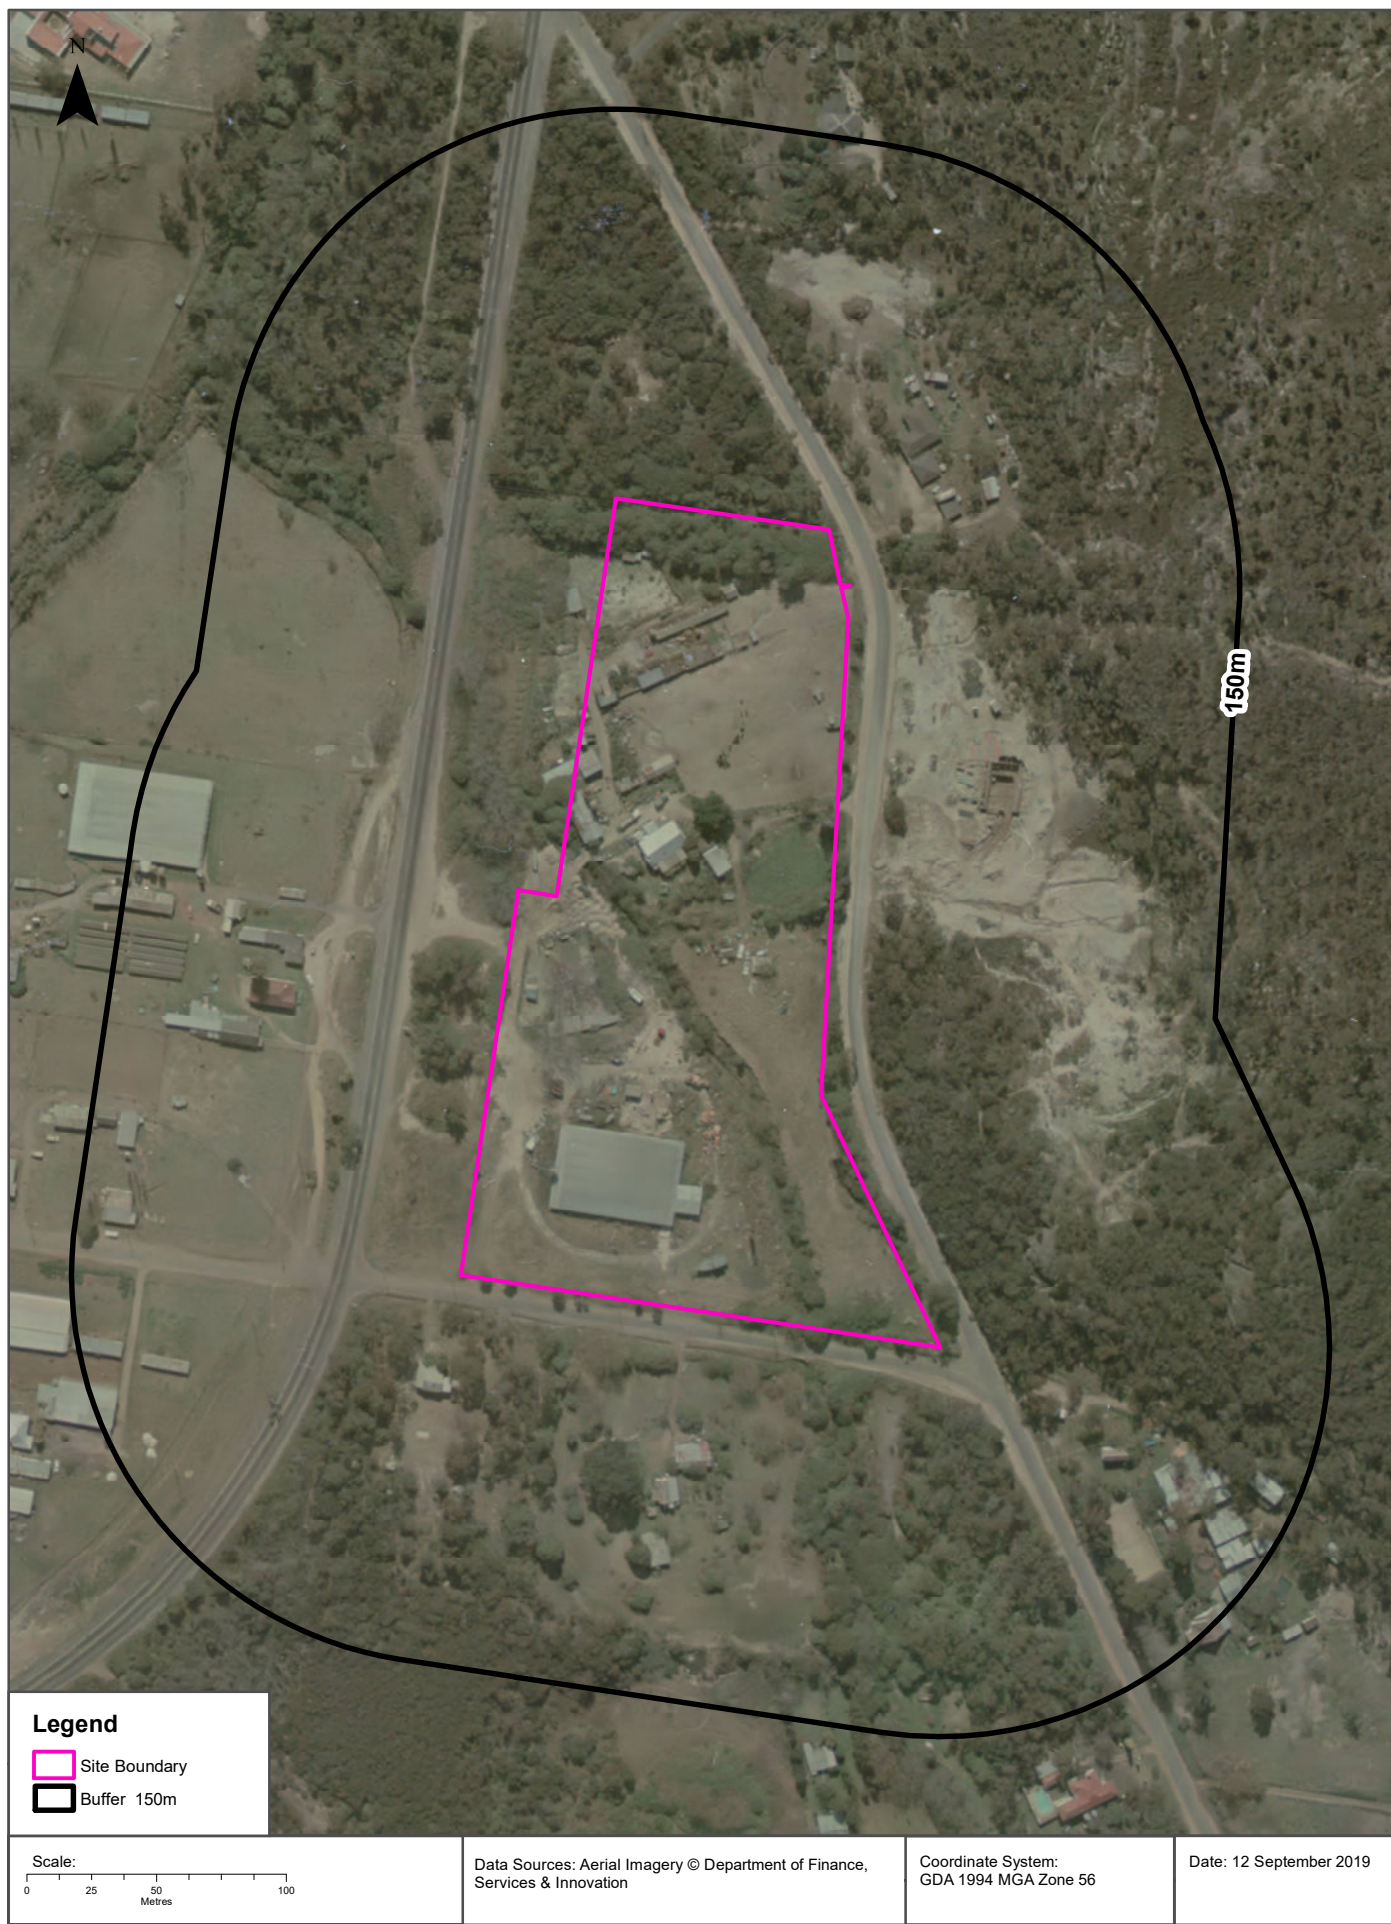

Aerial Imagery 1970

Wakehurst Parkway, Oxford Falls, NSW 2100



Data Sources: Aerial Imagery © Department of Finance, Services & Innovation

Coordinate System: GDA 1994 MGA Zone 56

Date: 12 September 2019


Aerial Imagery 1965

Wakehurst Parkway, Oxford Falls, NSW 2100




Aerial Imagery 1961

Wakehurst Parkway, Oxford Falls, NSW 2100

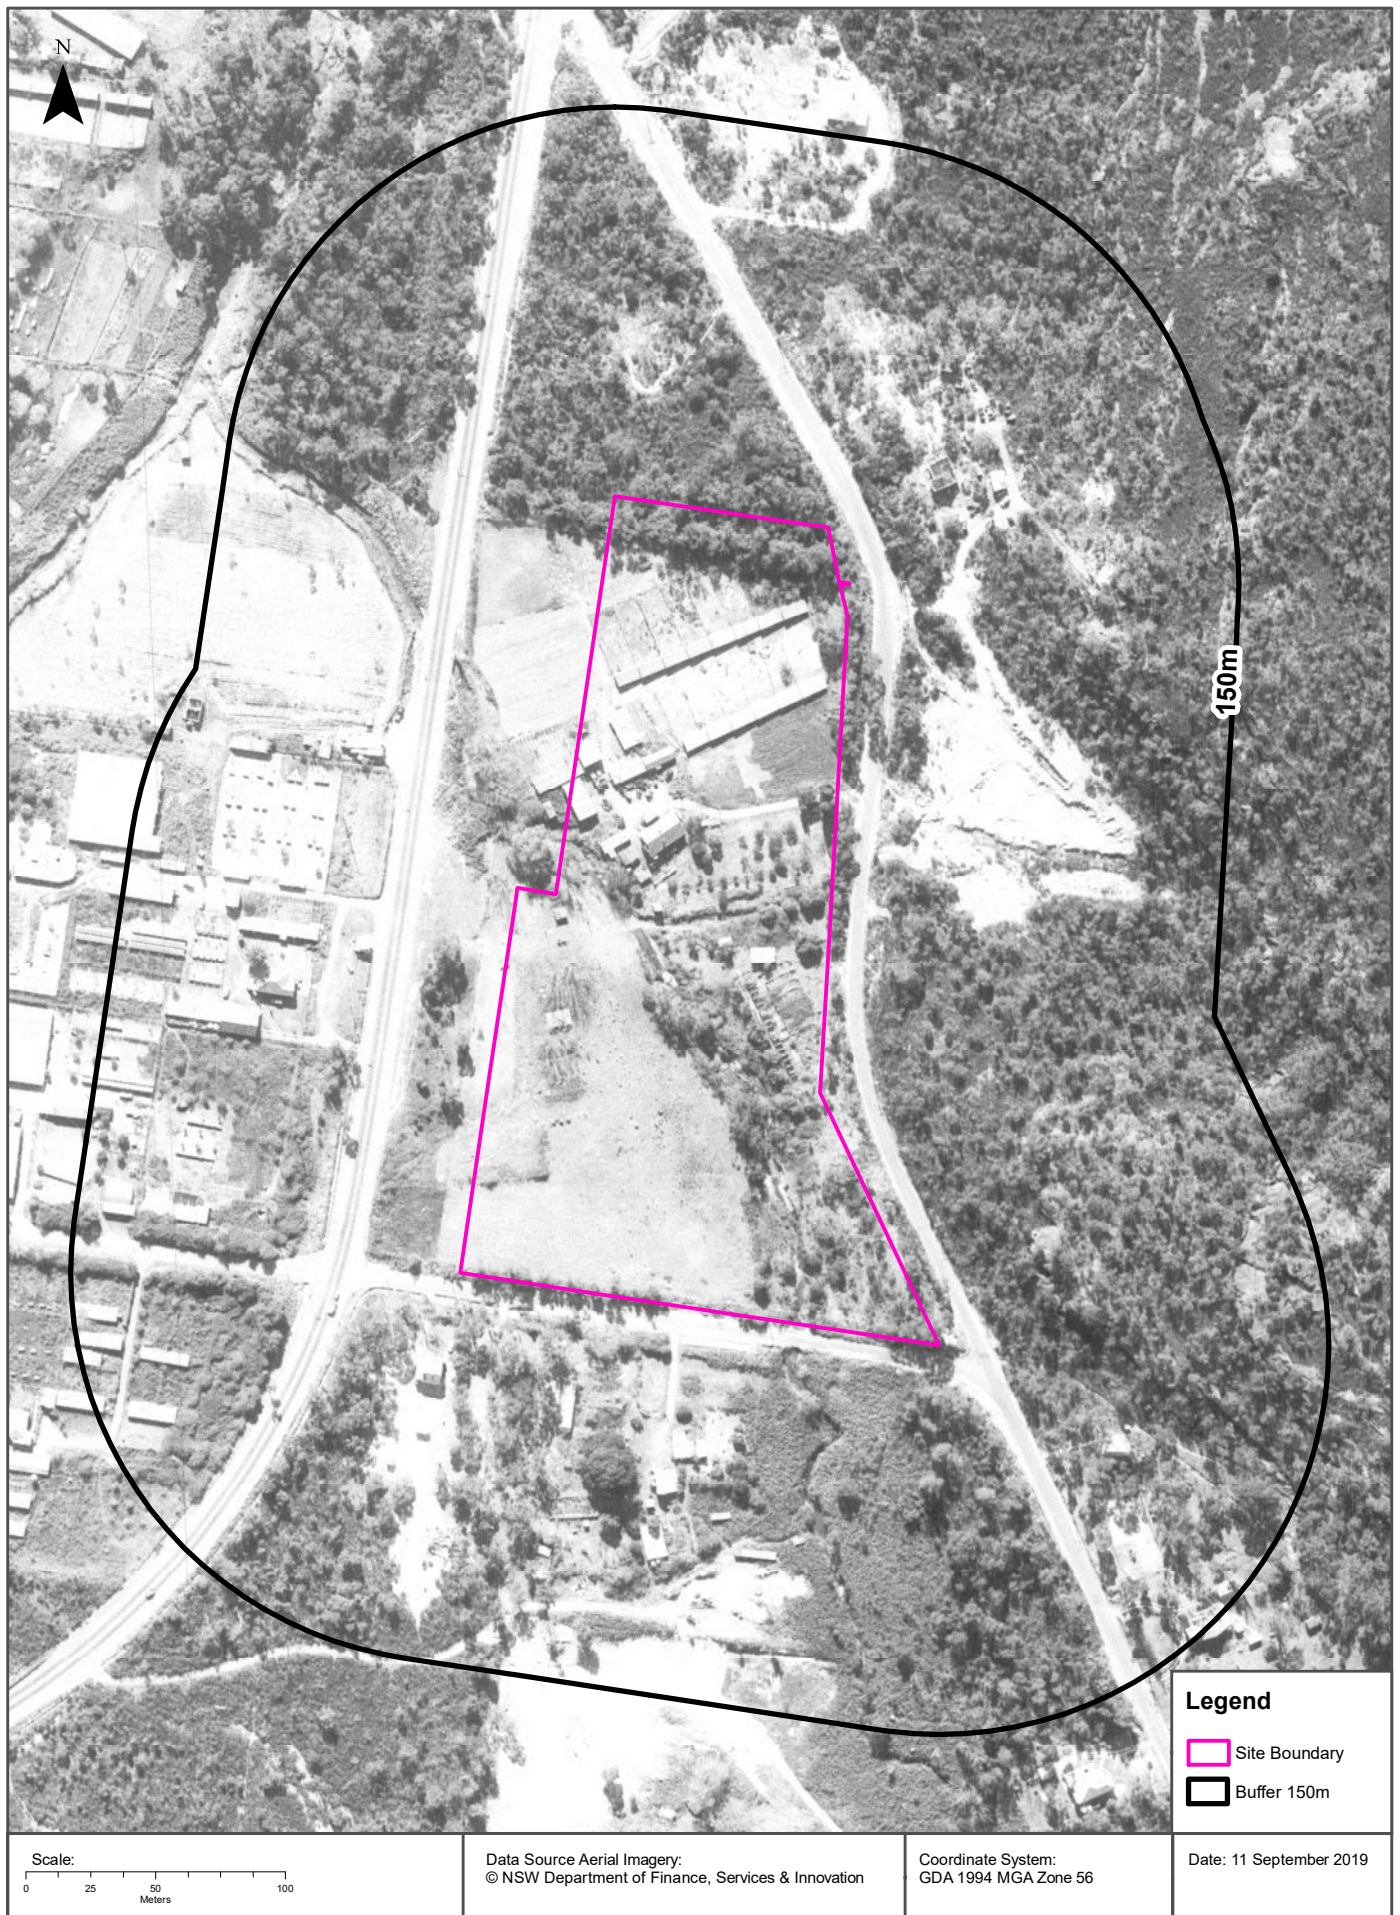

Aerial Imagery 1956

Wakehurst Parkway, Oxford Falls, NSW 2100

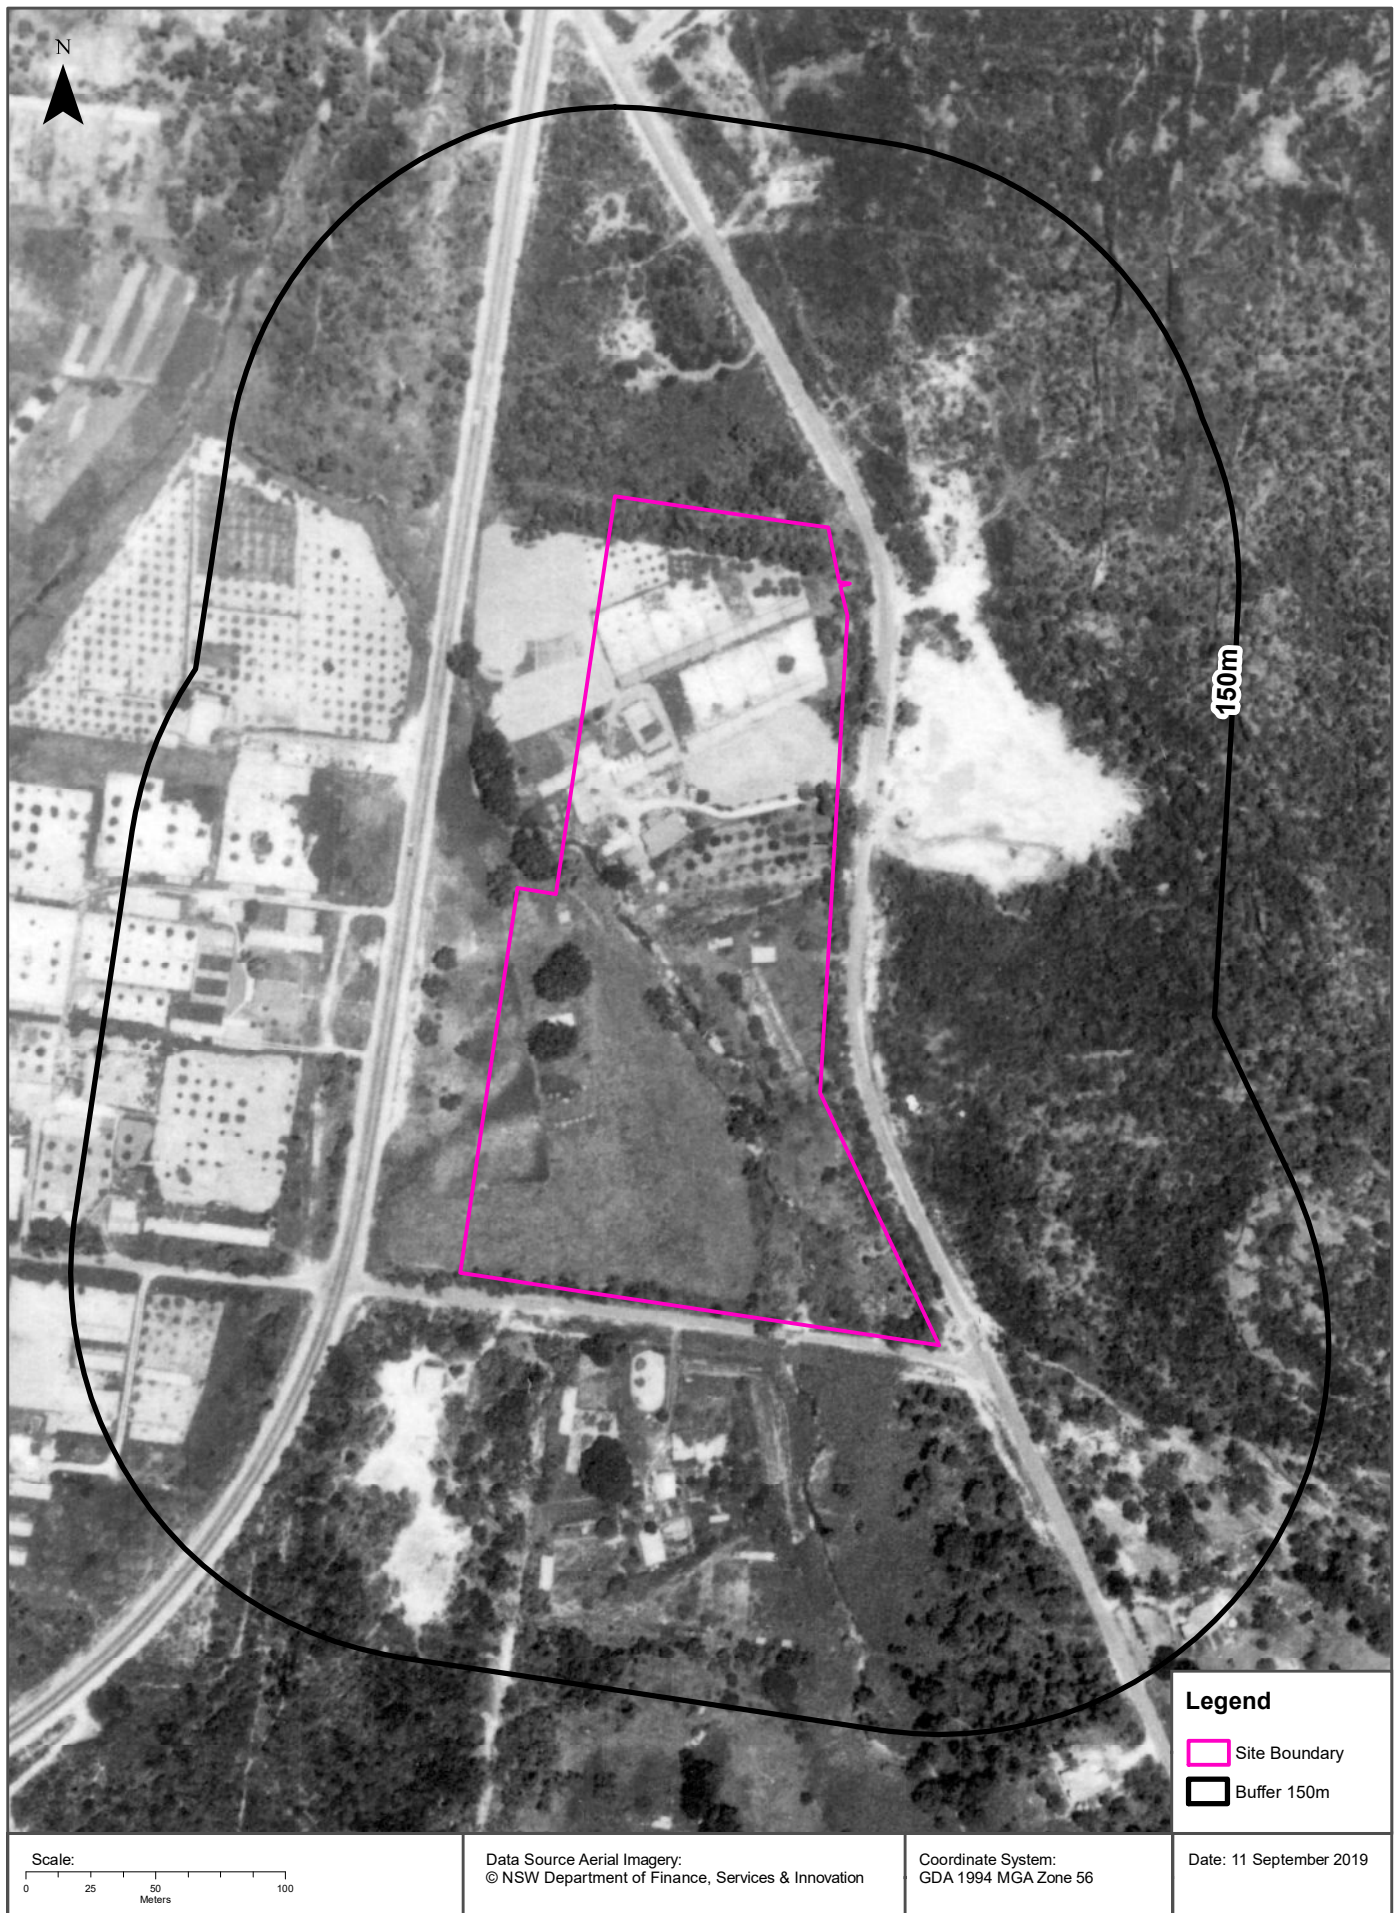

Attachment B: Proposed Development Plans

PRELIMINARY DRAFT
NOT FOR
DISTRIBUTION



DRAWING LIST

- REF101 SITE PLAN
REF201 GROUND LEVEL PLAN
REF202 LEVEL 1 PLAN
REF203 ROOF PLAN
REF311 ELEVATIONS - SHEET 1
REF312 ELEVATIONS - SHEET 2
REF321 SECTIONS
REF401 SHADOW DIAGRAMS
REF601 PERSPECTIVES

ABBREVIATIONS

A/C	AIR CONDITIONING	FP	FIRE INDICATOR PANEL	REF	REFRIGERATOR
AFSL	ABOVE STRUCTURAL FLOOR LEVEL	FLR	FLOOR	RA	RETURN AIR
AL	ALUMINIUM	FP	FIBROUS PLASTER	RAO	RADIUS
AO	ACCESS OPENING	FRL	FIRE RESISTANCE LEVEL	RC	REINFORCED CONCRETE
AP	ACCESS PANEL	FRL	FLOOR FINISH TO SEWER	RCH	RANGE HOOD
AT	ACUSTIC TILE	GALV	GALVANISED	RH	ROBE HOOK
B	BOLLARD	GD	GATED DRAIN	RHS	RECTANGULAR HOLLOW SECTION
BAL	BALUSTRADE	GL	GLAZING	RL	RENDER JOINT (V-JOINT)
BDY	BOUNDARY	GND	GROUND	RL	REDUCED LEVEL
BH	BORERHOLE	GPO	GENERAL PURPOSE (POWER) OUTLET	RSW	RIGHT OF WAY
BHD	BULKHEAD	GR	GRAB RAIL	RS	ROLLER SHUTTER
BK	BRICK	GRANO	GRANOLITHIC	RW	RETAINING WALL
BLG	BUILDING	GRC	GLASS REINFORCED CONCRETE/CEMENT	RWH	RAINWATER HEAD
BLK	BLOCKWORK	GT	GATE	RWO	RAINWATER OUTLET TO STORMWATER
BN	BALUNOSE	GTP	GREASE TRAP	RWP	RAINWATER PIPE
BCE	BRICK-ON-EDGE	HYD	HYDRANT	SA	SUPPLY AIR
BSN	BASIN	HC	HOSE COOK	SC	STEEL COLUMN
BTH	BATH	HMR	HIGH MOISTURE RESISTANT	SCR	SUNSCREEN
BWK	BRICKWORK	HR	HANDRAIL	SCT	SUSPENDED CEILING TILE
BWU	BUILDING WATER UNIT	HTR	HEATER	SD	SEWER DRAIN
CB	CONCRETE BLOCK	HW	HOT WATER	SFL	STRUCTURE FINISHED LEVEL
CCTV	CLOSED CIRCUIT TELEVISION	HND	HARDWOOD	SHB	SHOWER BATH
CD	CLOTHES DRYER	HNU	HOT WATER/LANT	SHR	SHOWER
CFC	COMPRESSED FIBROUS CEMENT	ID	INSIDE DIAMETER	SHS	SQUARE HOLLOW SECTION
CHS	CIRCULAR HOLLOW SECTION	IL	INVERT LEVEL	SK	SKIRTING
CI	CAST IRON	INCL	INCLUDE	SKL	SKYLIGHT
CIP	CAST IRON PIPE	INT	INTERNAL	SKK	SINK
CJ	CONTROL JOINT	IO	INSPECTION OPENING	SP	SEWER PIT
CL	CENTRE LINE	J	JOINT	SPRC	SPECIFICATION
CNR	CLEANER	JT	JOINT	SPL	SPLASHBACK
COL	COLUMN	KB	KERB	SRL	SHOWER ROSE
CONC	CONCRETE	KG	KERB AND GUTTER	SS	STAINLESS STEEL
CP	CHROME-PLATED	KIT	KITCHEN	ST	STONE
CPT	CURB/BOARD	L	LOUIRE	SVP	SEWER VENT PIPE
CPT	CARPET	LDY	LAUNDRY	SW	STORM WATER
CS	CEMENT RENDER	LS	LOUIRE SCREEN	SWP	STORMWATER PIT
CSK	COUNTERSINK	M	MIRROR	T	TILE
CT	COOK TOP	MC	METAL CLADDING	TEL	TELEPHONE
CTR	CENTRE	MDF	MEDIUM DENSITY FIBREBOARD	TGSI	TACTILE INDICATORS
CW	COLD WATER	MP	MANHOLE	TMB	TIMBER
D	DOOR	MSC	MISCELLANEOUS	TOH	TOP OF HOH
DB	DISTRIBUTION BOARD	MJ	MOVEMENT JOINT	TOK	TOP OF KERB
DF	DRINKING FOUNTAIN	NLM	NELMINE	TOW	TOP OF WALL
DG	DRAIN GROOVE	MO	MOISTURE RESISTANT	TP	TAP
DA	DIAMETER	MR	MOISTURE RESISTANT	TPH	TOILET PAPER HOLDER
DM	DIMENSION	MRS	METAL ROOF SHEETING	TR	TOWEL RAIL
DP	DORMER	MS	MILD STEEL	TRZD	TERRAZZO
DPC	DAMP-PROOF COURSE	MSB	MAIN SATCHBOARD	TUB	LAUNDRY TUB
DPN	DAMP-PROOF MEMBRANE	MY	MECHANICAL VENT	TV	TELEVISION
DWG	DRAWING	MW	METALWORK	TYP	TYPICAL
DS	DUCTED SKIRTING	NGL	NATURAL GROUND LEVEL	UGS	UNDERGROUND
DW	DRAIN	NC	NOT IN CONTRACT	US	UNDERSIDE
EA	EACH	ND	NUMBER	UB	UNIVERSAL BEAM
EDE	ELECTRICAL DISTRIBUTION BOARD	NGM	NOMINAL	UC	UNIVERSAL COLUMN
EJ	EXPANSION JOINT	NTS	NOT TO SCALE	URN	URNAL
EQ	EQUAL	OD	OUTSIDE DIAMETER	V	VINYL
ESB	ELECTRICAL SWITCHBOARD	OF	OVERFLOW/RAINWATER	VB	VANITY BASIN
EX	EXISTING (PRIOR TO)	OFC	OFF-FORM CONCRETE	VOS	VERIFY ON SITE
EXT	EXTERNAL	OHV	OVERHEAD DOOR	VP	VENT PIPE
F	FRESH GLAZING	OP	OPENING	W	WINDOW
FB	FACE BRICK	OY	OVEN	WB	WEATHERBOARD
FBL	FACE BLOCK	P	PAINT (FINISH)	WC	WATER CLOSET
FCL	FIBROUS CEMENT	PAV	PAVING	WR	WALK-IN ROBE
FCU	FAN COIL UNIT	PB	PLASTERBOARD	WM	WASHING MACHINE
FEN	FENCE	PC	PRECAST CONCRETE	WO	WALL OVEN
FFL	FINISHED FLOOR LEVEL	PES	POSSIBLE BALLAST	WP	WASTE PIPE
FL	FINISHED FLOOR LEVEL	PFC	PARALLEL FLANGE CHANNEL	WPM	WATERPROOF MEMBRANE
FSL	FINISHED GRADE LEVEL	PLY	PLYWOOD	WR	WANDROSE
FHR	FIRE HOSE REEL	PTD	PAPER TOWEL DISPENSER	WS	WALL STIFFENER


FOR REVIEW OF ENVIRONMENTAL FACTORS

OXFORD FALLS GRAMMAR SCHOOL LIBRARY / ADMIN BUILDING

1078 OXFORD FALLS ROAD
OXFORD FALLS, NSW 2100

Revisions	No.	Date	Description
1	19/12/19	DRAWING	ISSUE TO REF
2	11/03/20		

Checked: NZ
Approved: JW





Architect: **AJ+C**
ALLEN JACK+COTTER
79 Myrtle Street Chippendale NSW 2008 AUSTRALIA
ph +61 2 9311 8222 fr +61 2 9311 8200
ABN 53 063 732 250

Project: **OXFORD FALLS GRAMMAR SCHOOL LIBRARY / ADMIN BUILDING**
1078 OXFORD FALLS ROAD
OXFORD FALLS, NSW 2100
Proj. No. 18025

Drawing Title: **COVER SHEET**
Project Status: **NOT FOR CONSTRUCTION**


Scale: Drawing No. **REF001** Issue **2**

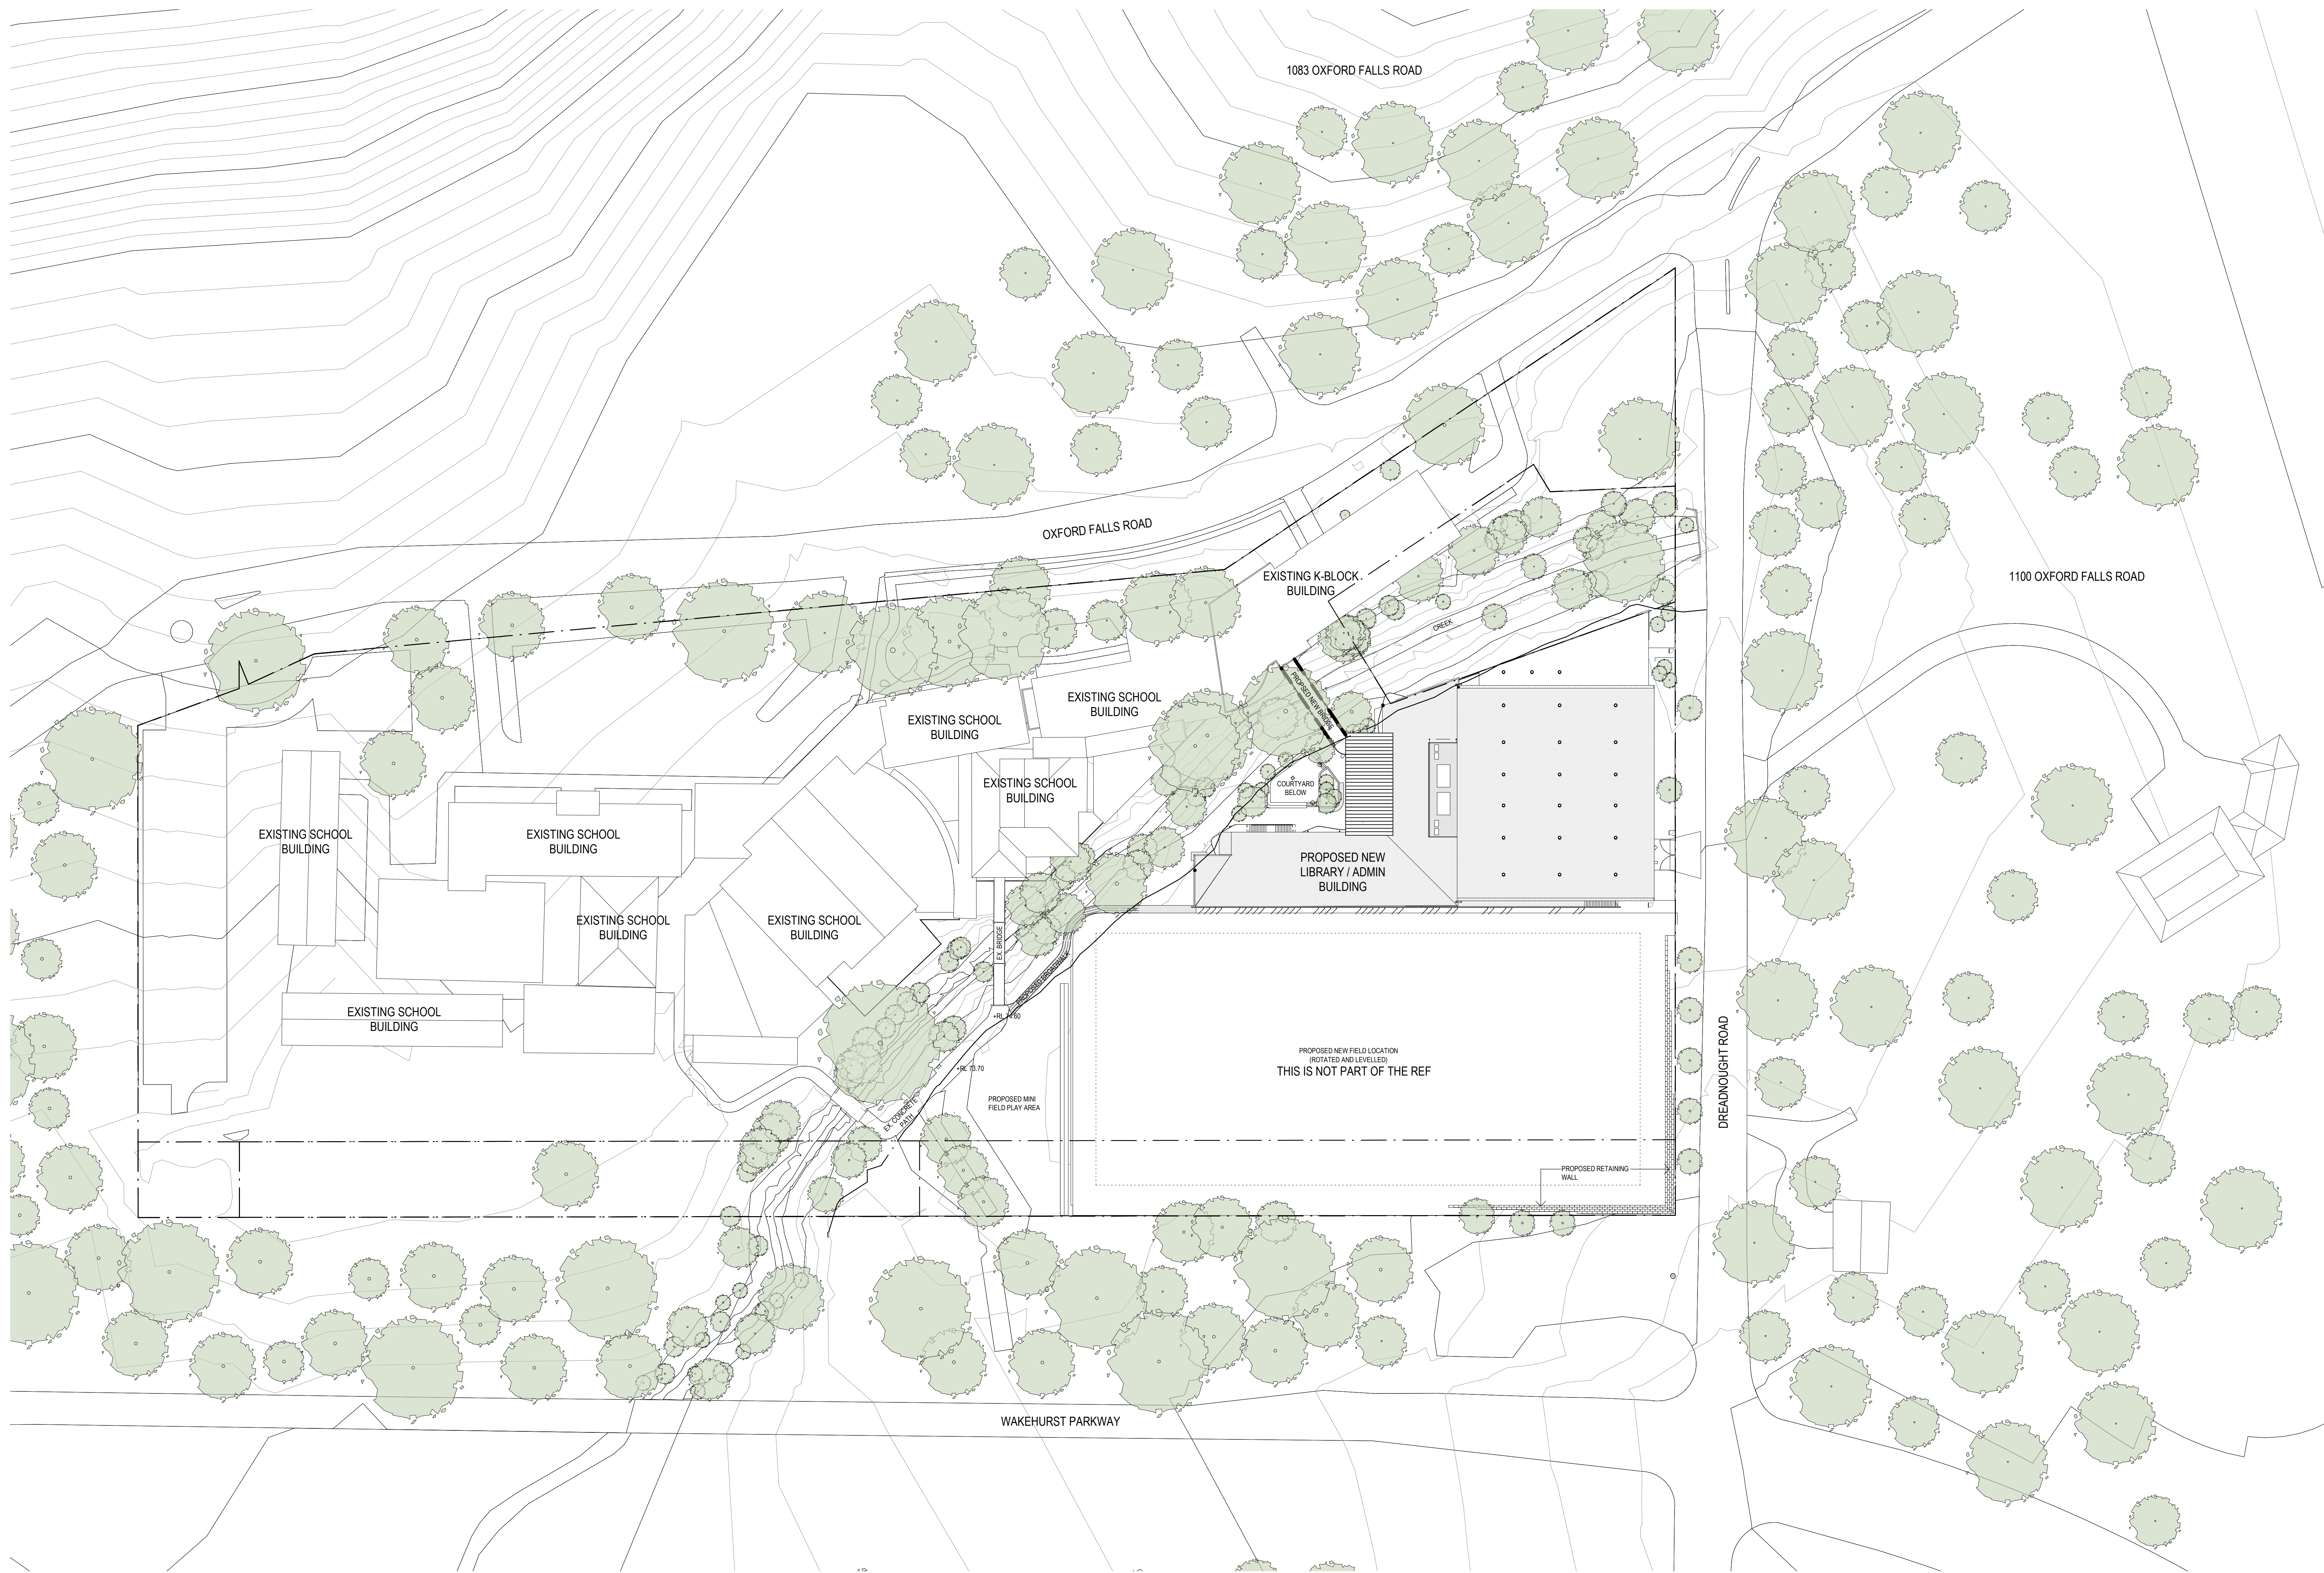

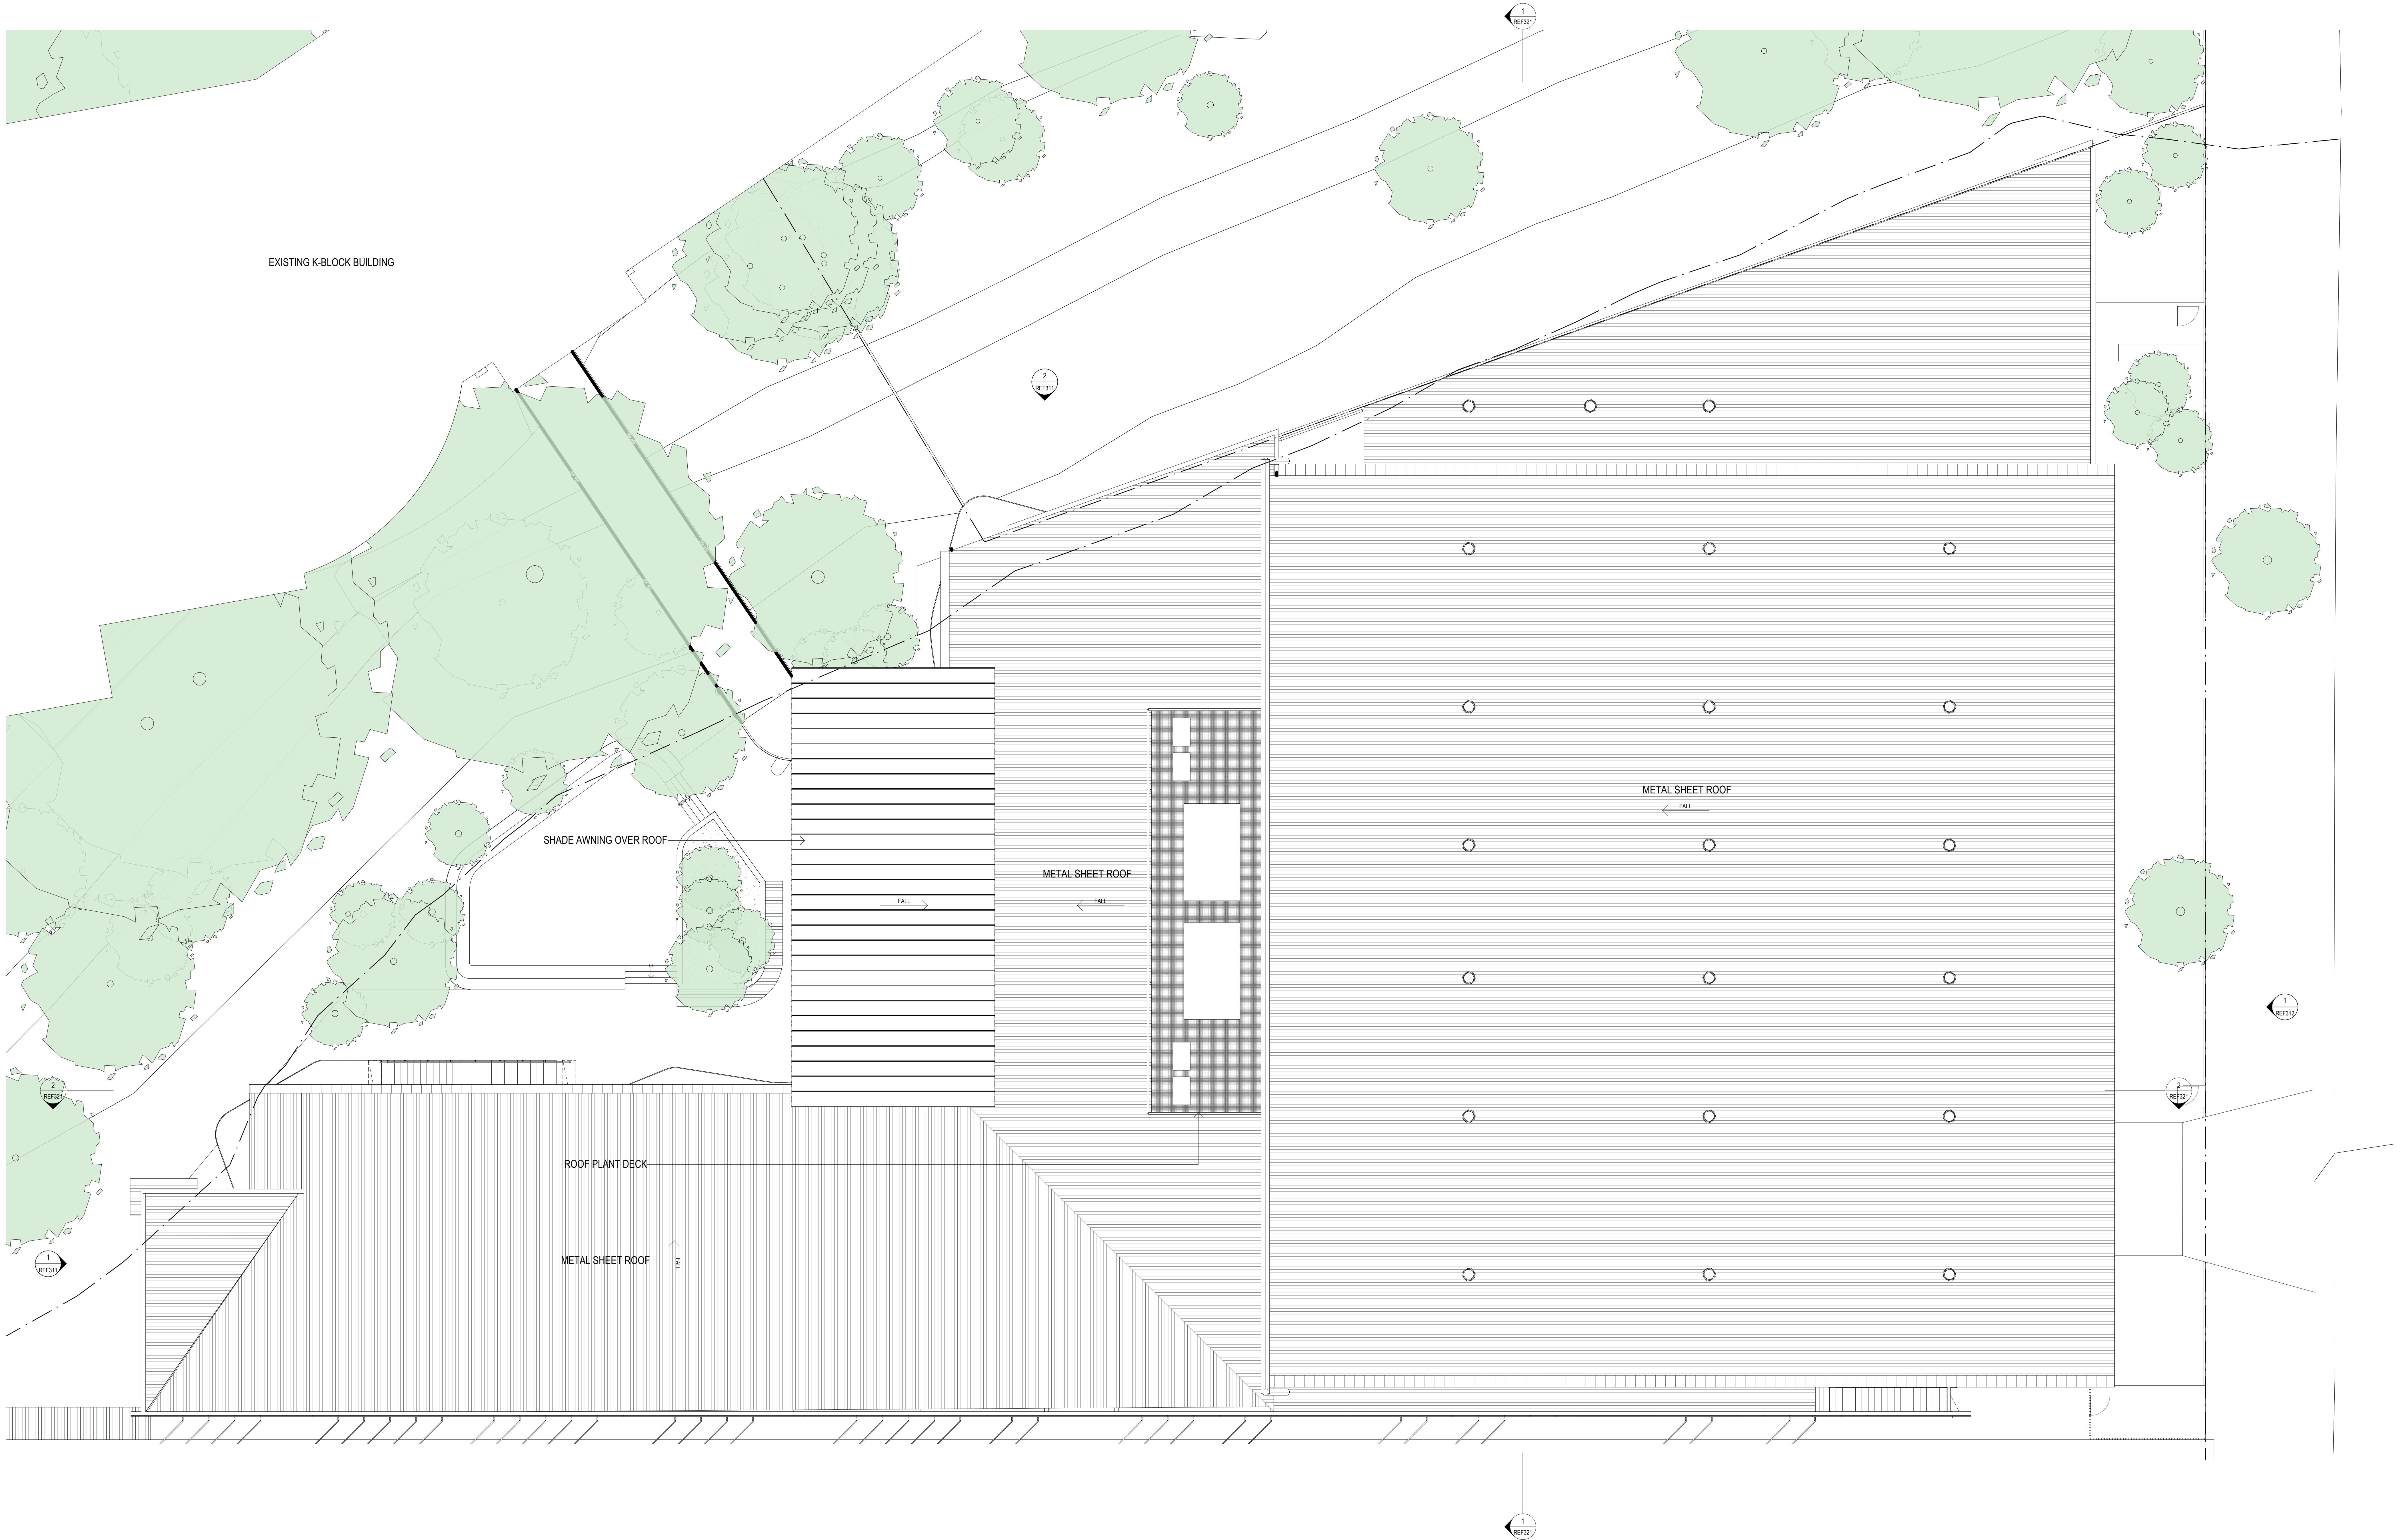

Revisions		
No.	Date	Description
1	19/12/19	DRAFT REF
2	11/03/20	ISSUE TO REF

Checked: NZ
Approved: JW



Architect
AJ+C
ALLEN JACK+COTTER
79 Myrtle Street Chippendale NSW 2008 AUSTRALIA
ph +61 2 9311 8222 fr +61 2 9311 8200
ABN 53 063 732 250

Project:
OFGS LIBRARY / ADMIN BUILDING
1078 OXFORD FALLS ROAD
OXFORD FALLS, NSW 2100

Proj. No. 18025

Drawing Title
ROOF PLAN


Project Status
NOT FOR CONSTRUCTION

Scale
1 : 100 @A0 REF203

Drawing No.
2



2 EAST ELEVATION 1:100

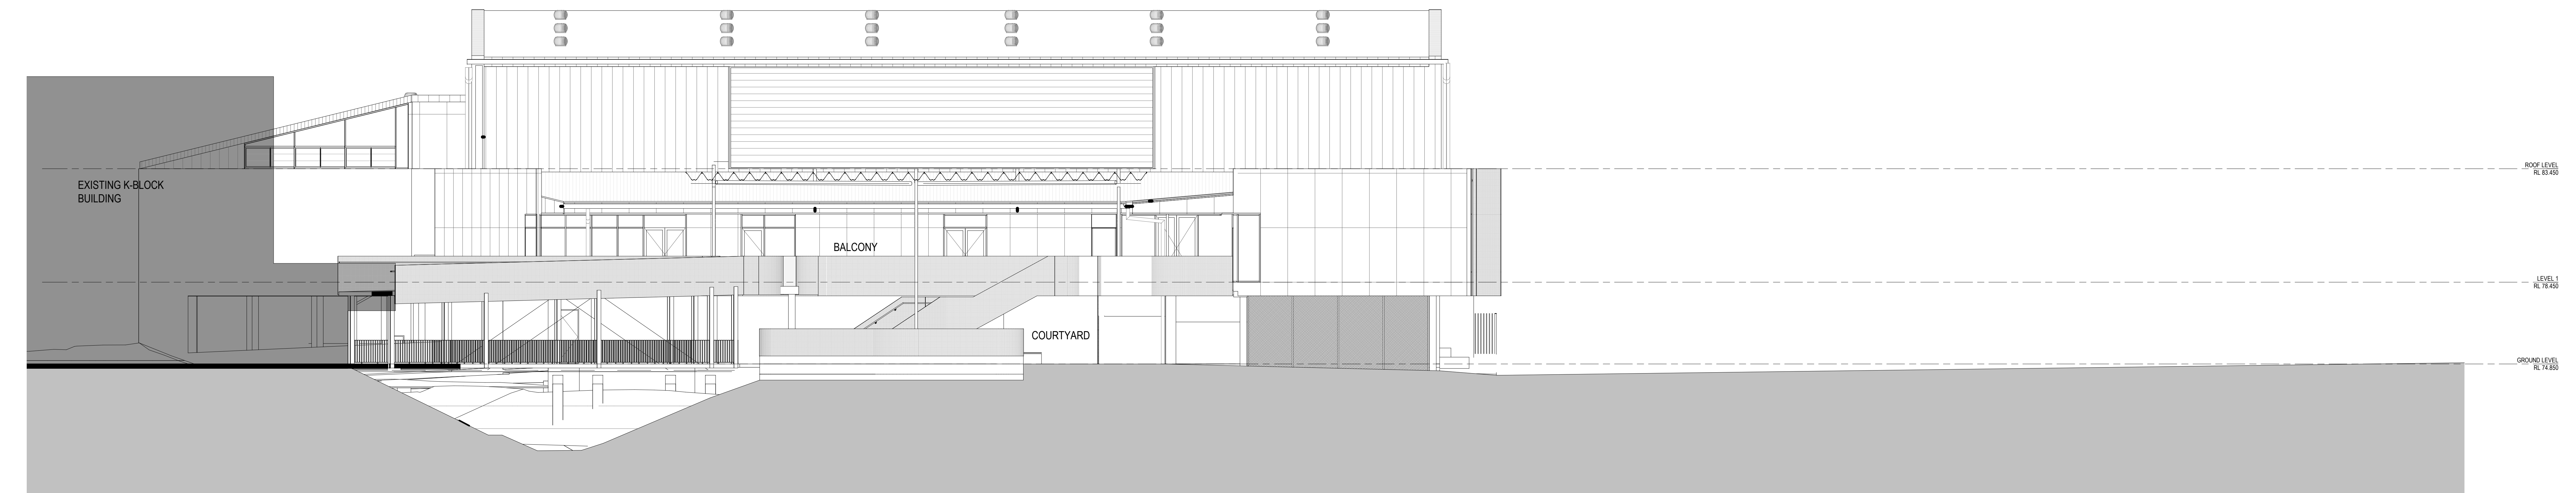

1 NORTH ELEVATION 1:100

Revisions	No.	Date	Description	Checked	Approved
1	11/12/19	ISSUE FOR CONSULTANT COORDINATION			
2	19/12/19	ISSUE FOR REF			
3	11/03/20	ISSUE TO REF		NZ	JW

Key

Client



Architect



79 Myrtle Street Chippendale NSW 2008 AUSTRALIA
ph +61 2 9311 8222 fr +61 2 9311 8200
ABN 53 063 782 250

Project

OFGS LIBRARY / ADMIN BUILDING
1078 OXFORD FALLS ROAD
OXFORD FALLS, NSW 2100

Proj. No. 18025

Drawing Title

ELEVATIONS - SHEET 1

Project Status

NOT FOR CONSTRUCTION


Scale

1:100 @A0 REF311


Drawing No.

Issue

3

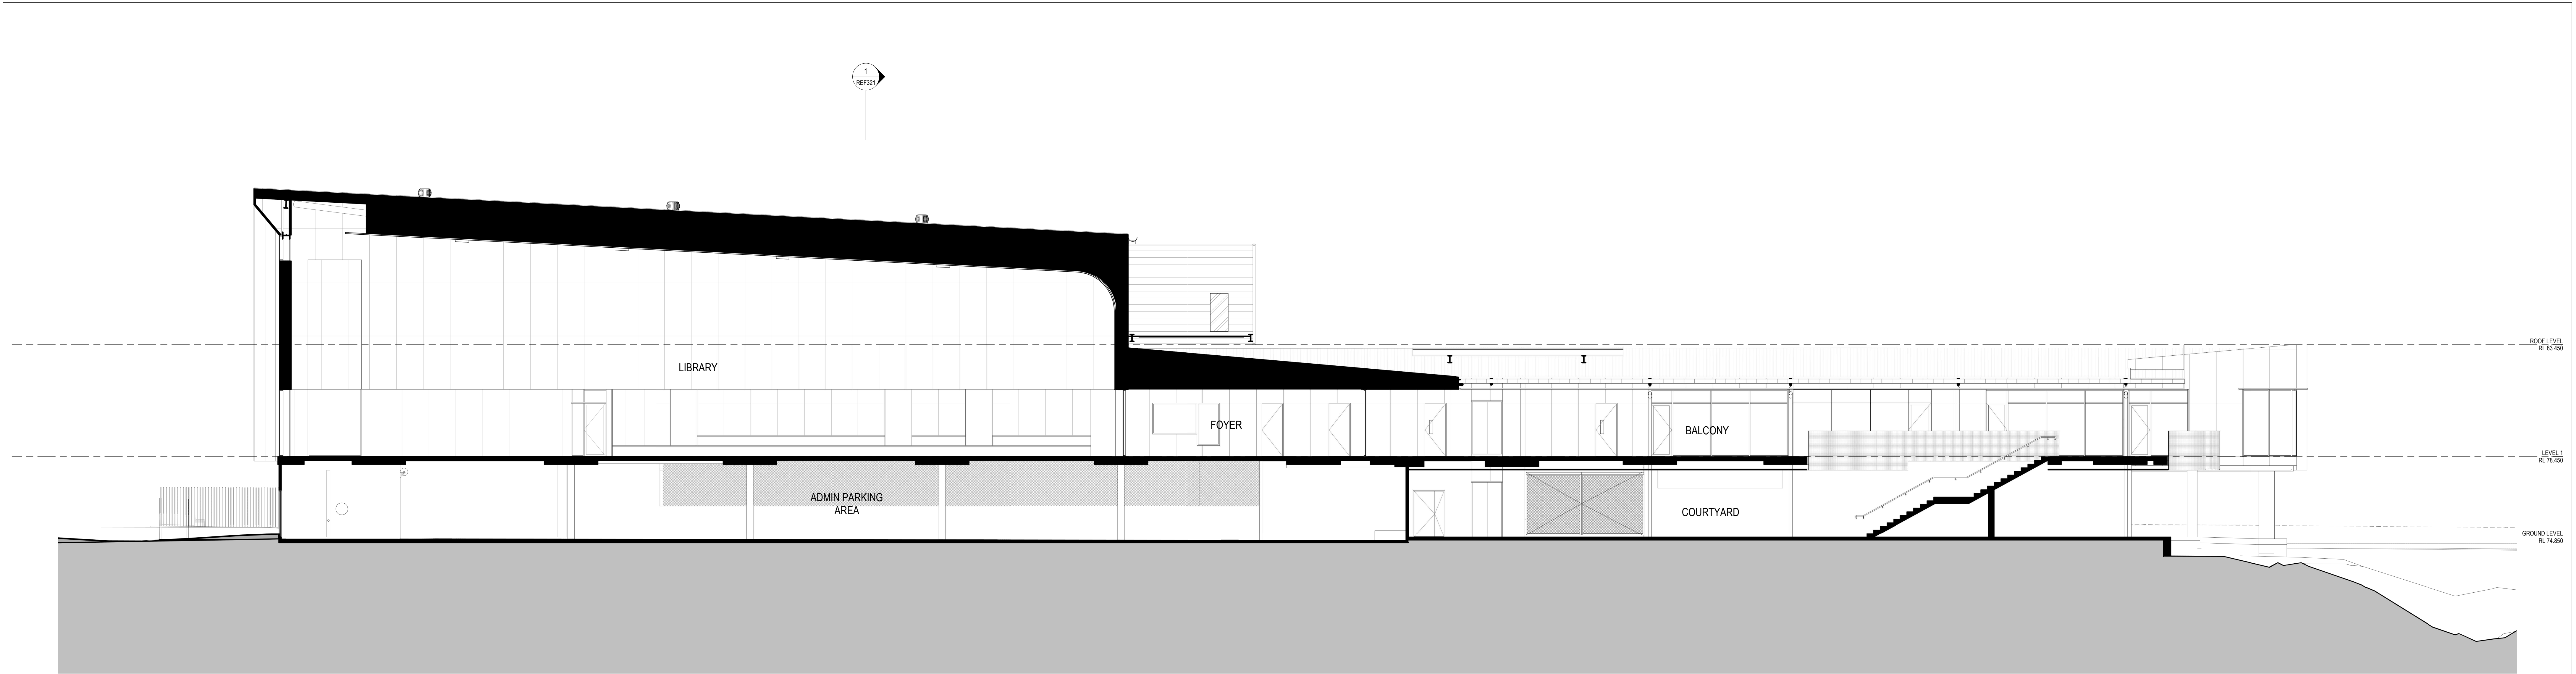

2 SECTION A 1:100

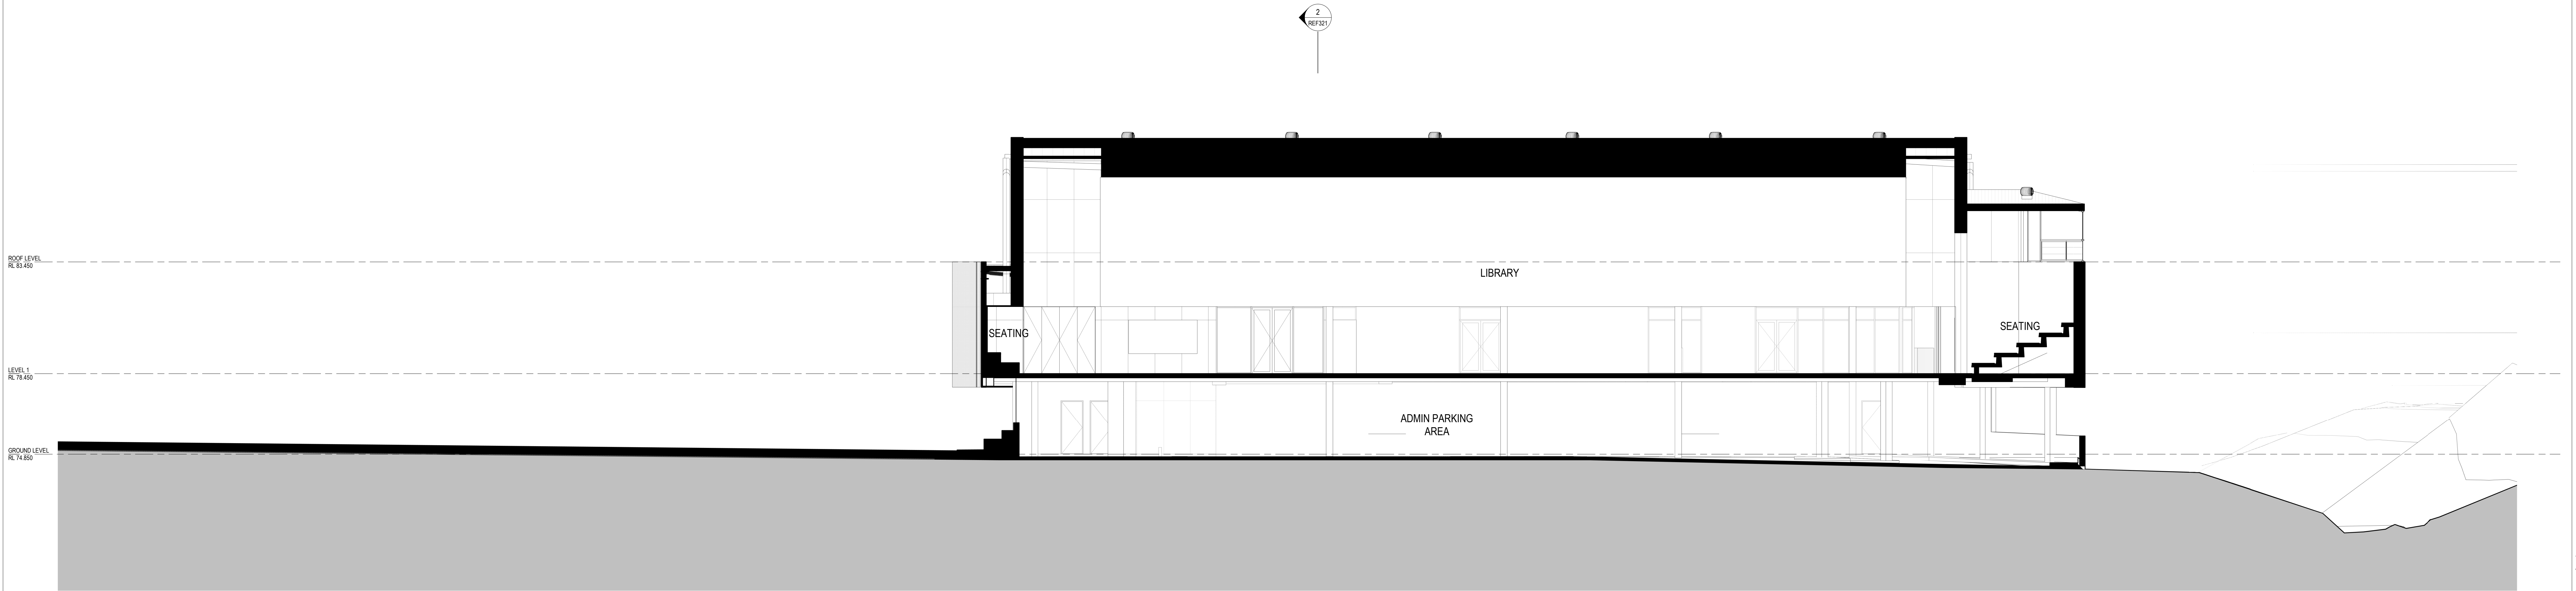

1 SECTION B 1:100

Revisions		Description	Checked	Approved
No.	Date			
1	11/12/19	ISSUE FOR CONSULTANT COORDINATION		
2	19/12/19	ISSUE REF		
3	11/03/20	ISSUE TO REF	NZ	JW

Key



Architect
AJ+C
ALLEN JACK+COTTER
79 Myrtle Street Chippendale NSW 2008 AUSTRALIA
ph +61 2 9311 8222 fr +61 2 9311 8200
ABN 53 063 782 250

Project
OFGS LIBRARY / ADMIN BUILDING
1078 OXFORD FALLS ROAD
OXFORD FALLS, NSW 2100




Proj. No. 18025

Drawing Title
SECTIONS

Project Status
NOT FOR CONSTRUCTION

Scale
1:100 @A0 REF321

Drawing No.
3



A diagram of a circle with a vertical line segment extending from the center to the top edge. Below the circle is the letter 'N'.



Architect

AJ+C
ALLEN JACK+COTTIER


79 Myrtle Street Chippendale NSW 2008 AUSTRALIA
ph +61 2 9311 8222 fx +61 2 9311 8200
ABN 53 003 782 250



Project	OFGS LIBRARY / ADMIN BUILDING
	1078 OXFORD FALLS ROAD OXFORD FALLS, NSW 2100

Drawing Title
SHADOW DIAGRAMS

Project Status
NOT FOR CONSTRUCTION

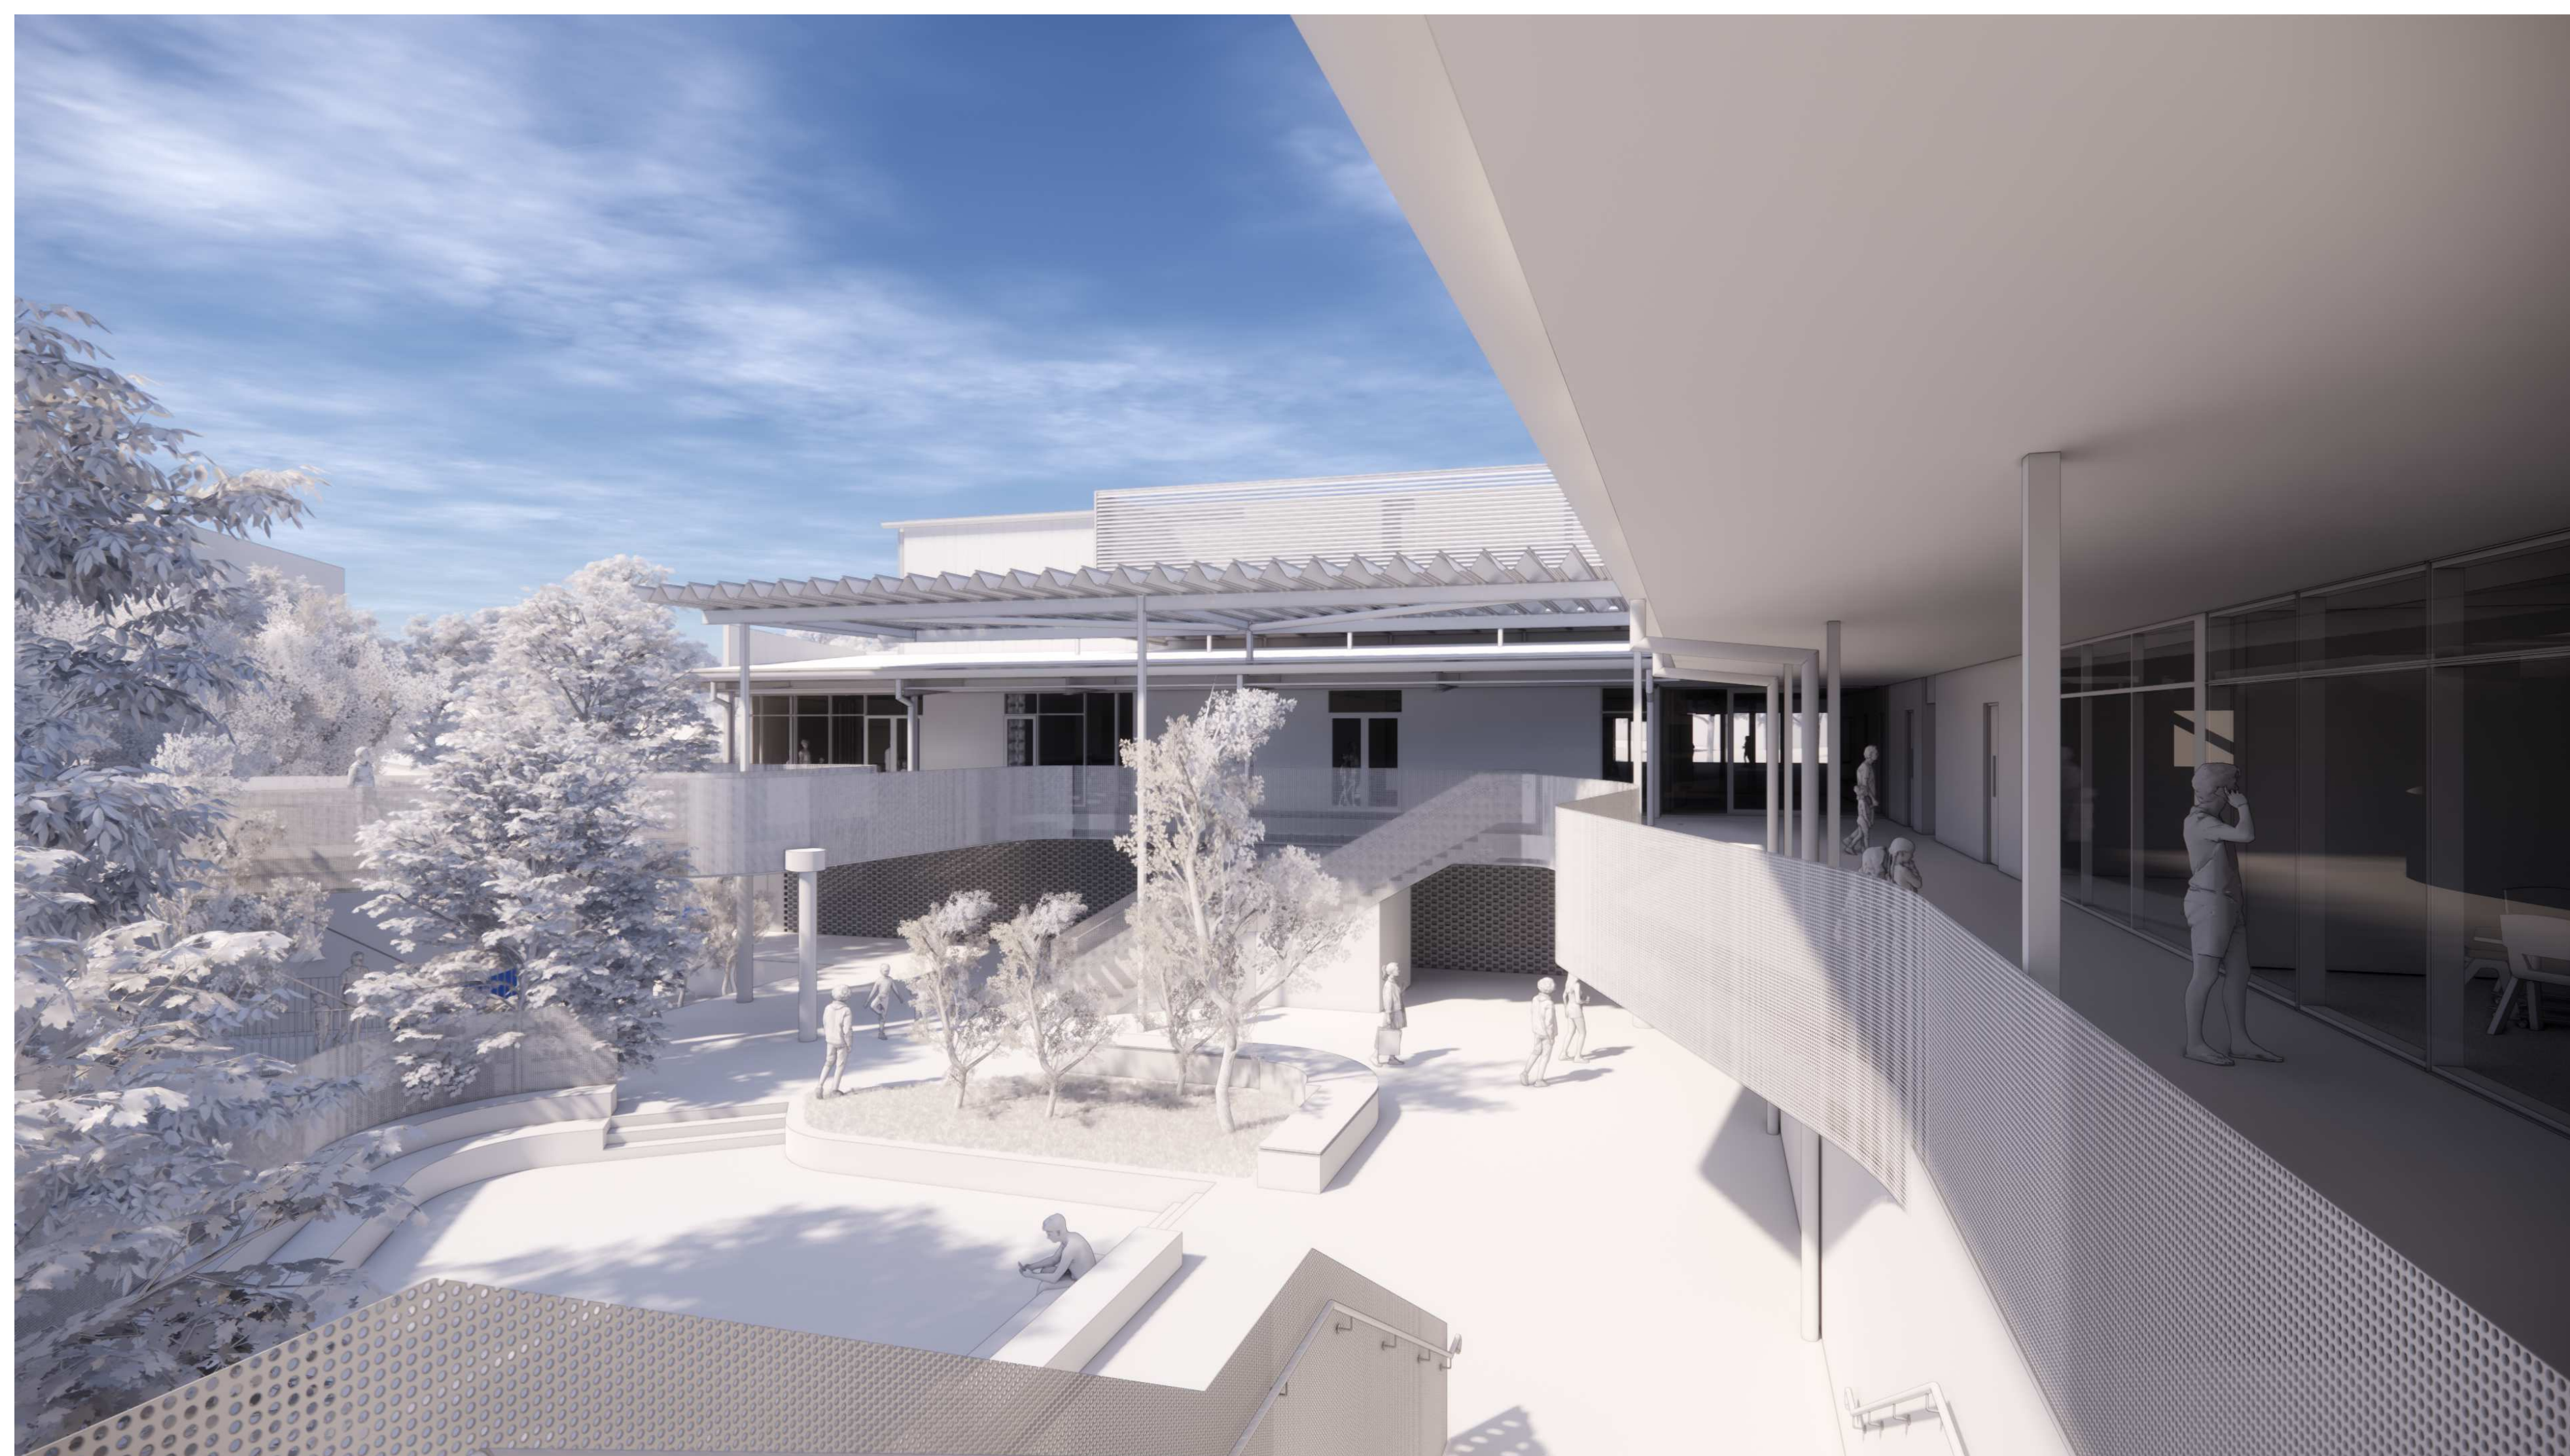Scale	Drawing No.	Issue
1 : 1000 @A0	REF401	2



<div> <div> Revisions No. Date 1 19/12/19 2 11/03/20 </div> <div> Description DRAFT REF ISSUE TO REF </div> <div> Checked Approved NZ JW </div> </div>	<div> <div>Key</div> </div>	<div> <div> <div>  <div> OXFORD FALLS GRAMMAR SCHOOL </div> </div> </div> <div> 79 Myrtle Street Chippendale NSW 2008 AUSTRALIA ph +61 2 9311 8222 fx +61 2 9311 8200 ABN 53 003 782 250 </div> </div>	<div> <div> <div> <div>Architect</div> <div>  <div> ALLEN JACK COTTER </div> </div> </div> <div> 79 Myrtle Street Chippendale NSW 2008 AUSTRALIA ph +61 2 9311 8222 fx +61 2 9311 8200 ABN 53 003 782 250 </div> </div> <div> <div> Project OFGS LIBRARY / ADMIN BUILDING 1078 OXFORD FALLS ROAD OXFORD FALLS, NSW 2100 </div> <div> Proj. No. 18025 </div> </div> </div>	<div> <div> Drawing Title PERSPECTIVES </div> <div> Project Status NOT FOR CONSTRUCTION </div> </div>	<div> <div> Scale </div> </div>	<div> <div> Drawing No. REF601 </div> </div>	<div> <div> Issue 2 </div> </div>
---	-----------------------------	---	--	---	---------------------------------	--	---------------------------------------

**Attachment C: EIS Waste Classification Assessment and
Soil Suitability Analysis (2017)**

PRELIMINARY DRAFT
NOT FOR
DISTRIBUTION



ENVIRONMENTAL INVESTIGATION SERVICES

15/11/2017

Report Ref: E30807KMlet-WC_rev1

Oxford Falls Grammar School
1078 Oxford Falls Road
OXFORD FALLS NSW 2100

Attention: Mr Greg Morris

WASTE CLASSIFICATION ASSESSMENT AND SOIL SUITABILITY ANALYSIS
PROPOSED PLAYING FIELD DEVELOPMENT
OXFORD FALLS GRAMMAR SCHOOL

1 INTRODUCTION

Oxford Falls Grammar School ('the client') commissioned Environmental Investigation Services (EIS)¹ to assign a waste classification and conduct a soil suitability analysis of in-situ soil located at the playing fields at Oxford Falls Grammar School, 1078 Oxford Falls Road, Oxford Falls ('the site'). The site location is shown on Figure 1 and sampling for the assessment was confined to the in-situ soil in the investigation area as shown on Figure 2 attached in the appendices.

The purpose of this assessment was to:

- i. provide a waste classification for the off-site disposal of the material in accordance with the NSW EPA Waste Classification Guidelines - Part 1: Classifying Waste (2014²); and
- ii. assess the suitability of the soil for growing grass on the oval.

The assessment was undertaken generally in accordance with an EIS proposal (Ref: EP45494KM) of 8 August 2017 and written acceptance from Oxford Falls Grammar School of 14 August 2017.

A geotechnical investigation was undertaken in conjunction with the waste classification assessment by JK Geotechnics³ and the results are presented in a separate report (Ref. 30807SYrpt, dated 23 October 2017).

¹ Environmental consulting division of Jeffery & Katauskas Pty Ltd (J&K)

² NSW EPA, (2014). *Waste Classification Guidelines, Part 1: Classifying Waste*. (referred to as Waste Classification Guidelines 2014)

³ Geotechnical consulting division of J&K



Postal Address: PO Box 976, North Ryde BC NSW 1670

Tel: 02 9888 5000 • Fax: 9888 5004

EIS is a division of Jeffery and Katauskas Pty Ltd • ABN 17 003 550 801

1.1 Proposed Development Details

The proposed development includes:

- Construction of a sporting facility building located in the south-eastern corner of the oval adjacent to the creek. The building will have a basement car park, which may require excavation to maximum depths of approximately 3m. A new vehicular access way to the building is proposed adjacent to Dreadnought Road;
- Expansion and reorientation of the existing sports field. The new sports field will occupy the existing field and will extend further west to accommodate the sports facility building in the south-east. The new oval will be at approximately the same surface level as the existing oval. Within the footprint of the existing oval this will require some cutting into the embankment along the southern and western boundaries of the site. It is expected that maximum cut depths may be in the order of approximately 3m; and
- Footbridges are proposed over the existing creek providing pedestrian access from the main school buildings to the proposed new sports facilities and oval.

2 SITE INFORMATION

2.1 Site Identification and Description

Table 2-1: Site Identification

Site Address:	1078 Oxford Falls Road, Oxford Falls, NSW, 2100
Lot & Deposited Plan:	Part of Lot 1 DP1046451
Current Land Use:	Sports oval
Area Applicable to Waste Classification:	Approximately 10,000m ²
Geographical Location (approx.):	Latitude: -33.739114°; Longitude: 151.24546°

A site inspection was conducted during the fieldwork on 25 and 26 September 2017. The school was located within undulating topography. A creek ran through the school grounds in a north-westerly to south-easterly direction.

The site was bound by Dreadnought Road to the south and the creek to the north-east. The site comprised a sports oval which was located in the south-western corner of the school grounds. The oval was relatively flat and appeared to have been formed by a cut along the western edge and filling along the eastern side, closer to the creek. Batters were located along the western and north-western sides of the oval.

A gravel surfaced car park was located at the top of the batter on the western side of the oval. School buildings were located on the eastern side of the creek. A seating area and several small to medium sized trees were located to the north of the oval.

Wakehurst Parkway was located beyond the gravel car park on the western side of the oval. Oxford Falls Road was located on the eastern side of the school buildings to the east of the site.

2.2 Background/Historical Information

EIS has undertaken a preliminary historical assessment based on a review of the following information:

- The 1943 aerial photograph for the site provided by SIX Maps⁴;
- The contaminated land records provided by the NSW EPA⁵; and
- Historical information from the school's website.

The 1943 aerial photograph indicated that the site was used for agricultural purposes at that time. The site area appeared to be divided into several fields or paddocks used for a variety of purposes. A copy of the photograph is reproduced below in Plate 1.

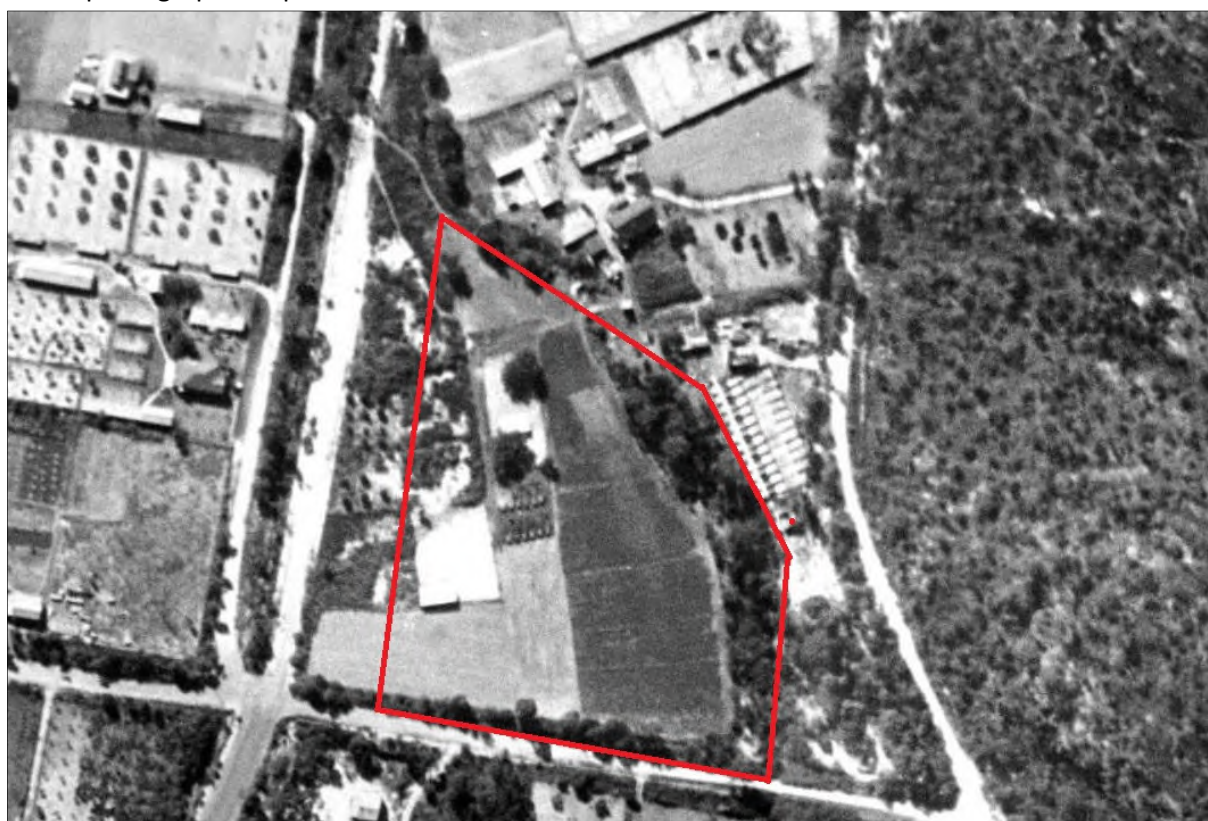


Plate 1: 1943 aerial photograph, showing the approximate location of the current school oval and assessment area outlined in red (Six Viewer - <https://maps.six.nsw.gov.au>, accessed on 19 October 2017)

There were no records for the site on the NSW EPA contaminated land registers.

Information from the school's website⁶ indicated that the school was constructed in the early 1980s and officially opened in 1984.

⁴ <https://maps.six.nsw.gov.au/>

⁵ <http://www.epa.nsw.gov.au/>

⁶ <http://www.ofgs.nsw.edu.au/about>

Considering the above information, the waste classification assessment will consider a broad suite of potential contaminants as outlined in Section 4.4.

2.3 Regional Geology

The geological map of Sydney (1983⁷) indicates the site to be underlain by Hawkesbury Sandstone, which typically consists of medium to coarse grained quartz sandstone with minor shale and laminite lenses.

3 ASSESSMENT CRITERIA

3.1 NSW EPA Waste Classification Guidelines

Off-site disposal of fill, contaminated material, stockpiled soil, natural soil and rock excavated as part of the proposed development works is regulated by the Protection of the Environment Operations Act (1997⁸) and associated regulations and guidelines including Part 1 of the Waste Classification Guidelines.

Soils are classed into the following categories based on the chemical contaminant criteria outlined in the guidelines:

Table 3-1: Waste Categories

Category	Description
General Solid Waste (non-putrescible) (GSW)	<ul style="list-style-type: none"> If Specific Contaminant Concentration (SCC) \leq Contaminant Threshold (CT1) then Toxicity Characteristics Leaching Procedure (TCLP) not needed to classify the soil as GSW If TCLP \leq TCLP1 and SCC \leq SCC1 then treat as GSW
Restricted Solid Waste (non-putrescible) (RSW)	<ul style="list-style-type: none"> If SCC \leq CT2 then TCLP not needed to classify the soil as RSW If TCLP \leq TCLP2 and SCC \leq SCC2 then treat as RSW
Hazardous Waste (HW)	<ul style="list-style-type: none"> If SCC $>$ CT2 then TCLP not needed to classify the soil as HW If TCLP $>$ TCLP2 and/or SCC $>$ SCC2 then treat as HW

⁷ 1:100,000 Geological Map of Sydney (Series 9130), Department of Mineral Resources (1983) [now Department of Primary Industries]

⁸ NSW Government, (1997). *Protection of Environment Operations Act*. (POEO Act 1997)

Category	Description
Virgin Excavated Natural Material (VENM)	<p>Natural material (such as clay, gravel, sand, soil or rock fines) that meet the following criteria:</p> <ul style="list-style-type: none"> • That has been excavated or quarried from areas that are not contaminated with manufactured chemicals, or with process residues, as a result of industrial, commercial mining or agricultural activities; • That does not contain sulfidic ores or other waste; and • Includes excavated natural material that meets such criteria for virgin excavated natural material as may be approved from time to time by a notice published in the NSW Government Gazette.

4 **INVESTIGATION PROCEDURE**

4.1 **Subsurface Investigation and Soil Sampling**

Field work for this investigation was undertaken on 25 and 26 September 2017. Soil samples for the waste classification assessment were obtained from eleven of the twenty-one boreholes drilled for the JK geotechnical investigation. The borehole locations are shown on Figure 2 attached in the appendices.

The sample locations were drilled using a truck-mounted hydraulically operated drill rig equipped with spiral flight augers. Soil samples were obtained from a Standard Penetration Test (SPT) sampler or directly from the auger when conditions did not allow use of the SPT sampler.

Soil samples were collected from the fill and natural profiles encountered during the investigation. All samples were recorded on the borehole logs attached in the appendices.

Samples were placed in glass jars with plastic caps and Teflon seals with minimal headspace. Samples for asbestos analysis were placed in zip-lock plastic bags. Sampling personnel used disposable nitrile gloves during sampling activities. The samples were labelled with the job number, sampling location, sampling depth and date.

4.2 **Screening for Volatile Organic Compounds (VOCs)**

A photoionisation detector (PID) was used to screen the samples for the presence of VOCs. PID screening for VOCs was undertaken on soil samples using the soil sample headspace method. VOC data was obtained from partly filled zip-lock plastic bags following equilibration of the headspace gases.

The sensitivity of the PID is dependent on the organic compound and varies for different mixtures of hydrocarbons. Some compounds give relatively high readings and some can be undetectable even though present in identical concentrations. The PID is best used semi-quantitatively to compare samples contaminated by the same hydrocarbon source. The PID is calibrated before use by

measurement of an isobutylene standard gas. All the PID measurements are quoted as parts per million (ppm) isobutylene equivalents.

4.3 Sample Preservation

Soil samples were preserved by immediate storage in an insulated sample container with ice in accordance with AS4482.1-2005 and AS4482.2-1999⁹, as summarised in the following table:

Table 4-1: Soil Sample Preservation and Storage

Analyte	Preservation	Storage
Heavy metals	Unpreserved glass jar with Teflon lined lid	Store at <4°, analysis within 28 days (mercury and Cr[VI]) and 180 days (other metals)
Hydrocarbons, pesticides and other organics	As above	Store at <4°, analysis within 14 days
Asbestos	Sealed plastic bag	None

On completion of the fieldwork, the samples were delivered in the insulated sample container to a NATA-registered laboratory for analysis under standard Chain of Custody (COC) procedures.

4.4 Laboratory Analysis for Waste Classification Assessment

Selected samples were analysed for a range of potential contaminants based on the site information presented in Section 2. EIS note that a detailed site history assessment was not undertaken, however this was compensated for by analysing the samples for a broad range of potential contaminants.

Fifteen selected in-situ soil samples were analysed for the following:

- heavy metals including: arsenic, cadmium, chromium (total), copper, lead, mercury, nickel and zinc;
- polycyclic aromatic hydrocarbons (PAHs);
- total recoverable hydrocarbons (TRH); and
- monocyclic aromatic hydrocarbons including benzene, toluene, ethylbenzene and xylene (BTEX).

Ten of the samples were also analysed for asbestos.

Five of the samples were also analysed for:

- organochlorine pesticides (OCPs);
- organophosphate pesticides (OPPs); and

⁹ *Guide to the Sampling and Investigation of Potentially Contaminated Soil Part2: Volatile Substances*, Standards Australia, 1999 (AS 1999)

- polychlorinated biphenyls (PCBs);

Samples were analysed by Envirolab Services (NATA Accreditation Number – 2901) using the analytical methods detailed in the National Environmental Protection (Assessment of Site Contamination) Measure 1999 (as amended 2013¹⁰). Reference should be made to the laboratory report (Ref: 176661) attached in the appendices for further information.

4.5 Laboratory Analysis for Soil Suitability Analysis

Three soil samples, collected at a variety of depths from BH1, BH4 and BH7 were analysed for a range of parameters to assess the soil's suitability for growing turf on a school oval. The analysis included:

- pH;
- electrical conductivity;
- organic matter;
- cation exchange capacity;
- nitrate;
- phosphate;
- potassium;
- sulphate;
- calcium;
- magnesium;
- iron;
- manganese;
- zinc;
- copper and
- boron.

5 RESULTS OF THE INVESTIGATION

5.1 Subsurface Conditions

A summary of the subsurface soil conditions encountered during the investigation is presented in the table below. Reference should be made to the borehole logs attached in the appendices for further details.

Table 5-1: Summary of Subsurface Conditions

Profile	Description (depth in m below ground level)
Fill	Fill material was encountered in all boreholes and extended to depths ranging from 0.1m to 3.5m. The fill typically comprised silty sand, sand and sandy clay, with sandstone gravel, cobbles and boulders. Traces of bricks, timber, plastic and string were encountered in some boreholes.

¹⁰ National Environment Protection Council (NEPC), (2013). *National Environmental Protection (Assessment of Site Contamination) Measure 1999 (as amended 2013)*. (referred to as NEPM 2013)

Profile	Description (depth in m below ground level)
	<p>Odours or staining were not observed in the fill during the investigation. Potential asbestos containing material was not observed.</p> <p>The attached Figure 2 shows the depth of fill material in each borehole, and a contour plan showing the approximate depth of fill across the site. The contours should be regarded as approximate only.</p>
Natural Soil	<p>Natural alluvial soils were encountered below the fill material, and comprised sands, clayey sands and sandy clays.</p> <p>Odours or staining were not observed in the natural soils during the investigation.</p>
Bedrock	<p>Weathered sandstone bedrock was encountered in several boreholes at depths ranging from 3.3m to 4.8m.</p> <p>Odours or staining were not observed in the bedrock during the investigation.</p>
Groundwater	<p>Groundwater seepage was encountered during drilling at depths ranging from 3.0m to 5.0m. On completion of drilling groundwater was measured at depths ranging from 2.8m to 4.5m. At the time of drilling the groundwater levels had not had time to stabilise and therefore may be artificially higher. No longer-term groundwater monitoring was carried out.</p>

5.2 VOC Screening

PID soil sample headspace readings are presented in the COC documents attached in the appendices. All results were 0ppm equivalent isobutylene which indicates a lack of PID-detectable VOCs.

5.3 Laboratory Results – Waste Classification Assessment

The laboratory results were assessed against the criteria presented in Part 1 of the Waste Classification Guidelines. The results are summarised in Table A which is attached in the appendices. A summary of the results is presented below.

Table 5-2: Summary of Soil Laboratory Results Compared to Waste Classification Criteria

Analyte	No. of Samples Analysed	No. of Results > CT1 Criteria	No. of Results > SCC1 Criteria	Comments
Heavy Metals	15	0	0	All results were below the CT1 and SCC1 criteria.
TRH	15	0	0	All results were below the laboratory practical quantitation limits (PQLs).

Analyte	No. of Samples Analysed	No. of Results > CT1 Criteria	No. of Results > SCC1 Criteria	Comments
BTEX	15	0	0	All results were below the laboratory PQLs.
Total PAHs	15	0	0	All results were below the CT1 and SCC1 criteria.
Benzo(a)pyrene	15	0	0	All results were below the CT1 and SCC1 criteria.
OCPs & OPPs	5	0	0	All results were below the laboratory PQLs.
PCBs	5	0	0	All results were below the laboratory PQLs.
Asbestos	10	-	-	Asbestos was not detected in the samples analysed.

5.4 Statistical Analysis

95% Upper Confidence Limits (UCLs) of the mean were calculated for all analytes that were detected at concentrations above the laboratory PQLs, which included arsenic, chromium, copper, lead, nickel, zinc, total PAHs and benzo(a)pyrene. All 95% UCLs were below the corresponding CT1 criterion. The UCL calculations are included in Appendix F.

5.5 Laboratory Analysis – Soil Suitability Assessment

The analytical results of the soil suitability assessment are contained in the attached appendices. A summary of the results is presented below:

- The sample from BH1, collected from a depth of 0.0m to 0.2m, had a low effective cation exchange capacity (eCEC) indicating poor nutrient retention. It was recommended that nitrate, potassium and sulphate be boosted. Once compacted through pedestrian traffic, it was expected that the soil would become waterlogged and turf growth would fail;
- The sample from BH4, collected from a depth of 0.5m to 0.95m, had a low eCEC indicating poor nutrient retention. It was recommended that all nutrients be boosted with the exception of phosphorus. Once compacted through pedestrian traffic, it was expected that the soil would become waterlogged and turf growth would fail;
- The sample from BH7, collected from a depth of 0.0m to 0.2m, had a low eCEC indicating poor nutrient retention. It was recommended that all nutrients be boosted with the exception of phosphorus. The soil in this sample was considered to be the most suitable for growing turf.

6 CONCLUSIONS

6.1 Waste Classification of Fill

Based on the results of the assessment, and at the time of reporting, the fill material is classified as **General Solid Waste (non-putrescible)**. Surplus fill should be disposed of to a landfill that is licensed by the NSW EPA to receive this waste stream. The landfill should be contacted to obtain the required approvals prior to commencement of excavation.

6.2 Classification of Natural Soil and Bedrock

Based on the scope of work undertaken for this assessment, and at the time of reporting, EIS are of the opinion that the natural soil and bedrock at the site meets the definition of **VENM** for off-site disposal or re-use purposes. VENM is considered suitable for re-use on-site, or alternatively, the information included in this report may be used to assess whether the material is suitable for beneficial reuse at another site as fill material. In accordance with Part 1 of the Waste Classification Guidelines, the VENM is pre-classified as general solid waste and can also be disposed of accordingly to a facility that is licensed to accept it.

6.3 Recommendations of the Waste Classification Assessment

Any unexpected finds encountered during the site works should be inspected by a suitably qualified environmental consultant¹¹. In the event that the find has the potential to alter the waste classification documented in this report, additional testing and reporting should be undertaken.

6.4 Conclusions of the Soil Suitability Assessment

Detailed recommendations for each of the three sample locations are contained in the report attached in Appendix E. A summary of the recommendations is provided below.

It is recommended that fertiliser be added to the soil to boost nutrients. The nutrient requirements are likely to vary depending on the location of the soil.

It is recommended that the soil in the vicinity of sample locations BH1 and BH4 be capped with approximately 100mm of imported 80/20 media (a blend of 80% sand and 20% soil). Alternatively the soil from the vicinity of sample BH7 could be used as a capping material.

6.5 General Information

If disposed off-site, the fill material must be disposed of to a facility licensed by the NSW EPA to accept the waste. It is the responsibility of the receiving facility to ensure that the material meets their EPA license conditions. EIS accepts no liability whatsoever for illegal or inappropriate disposal of material.

¹¹ The consultant should be from a company that is a member of the Australian Contaminated Land Consultants Association (ACLCA).

Fill and contaminated soil disposal costs are significant and may affect project viability. These costs should be assessed at an early stage of the project development to avoid significant future unexpected additional costs.

Material classed as VENM must not be mixed with any fill material (including building rubble) as this will invalidate the VENM classification. Where doubt exists about the difference between fill and VENM material an environmental/geotechnical engineer should be contacted for advice.

Section 143 of the POEO Act 1997 states that if waste is transported to a place that cannot lawfully be used as a waste facility for that waste, then the transporter and owner of the waste are each guilty of an offence. The transporter and owner of the waste have a duty to ensure that the waste is disposed of in an appropriate manner. EIS accepts no liability whatsoever for the unlawful disposal of any waste from any site.

7 LIMITATIONS

The report limitations are outlined below:

- EIS accepts no responsibility for any unidentified contamination issues at the site. Any unexpected problems/subsurface features that may be encountered during development works should be inspected by an environmental consultant as soon as possible;
- This report has been prepared based on site conditions which existed at the time of the investigation; scope of work and limitation outlined in the EIS proposal; and terms of contract between EIS and the client (as applicable);
- The conclusions presented in this report are based on investigation of conditions at specific locations, chosen to be as representative as possible under the given circumstances, visual observations of the site and immediate surrounds and documents reviewed as described in the report;
- Subsurface soil and rock conditions encountered between investigation locations may be found to be different from those expected. Groundwater conditions may also vary, especially after climatic changes;
- The investigation and preparation of this report have been undertaken in accordance with accepted practice for environmental consultants, with reference to applicable environmental regulatory authority and industry standards, guidelines and the assessment criteria outlined in the report;
- Where information has been provided by third parties, EIS has not undertaken any verification process, except where specifically stated in the report;
- EIS has not undertaken any assessment of off-site areas that may be potential contamination sources or may have been impacted by site contamination, except where specifically stated in the report;
- EIS accept no responsibility for potentially asbestos containing materials that may exist at the site. These materials may be associated with demolition of pre-1990 constructed buildings or fill material at the site;


- EIS have not and will not make any determination regarding finances associated with the site;
- Additional investigation work may be required in the event of changes to the proposed development or land use. EIS should be contacted immediately in such circumstances;
- Material considered to be suitable from a geotechnical point of view may be unsatisfactory from a soil contamination viewpoint, and vice versa;
- This report has been prepared for the particular project described and no responsibility is accepted for the use of any part of this report in any other context or for any other purpose;
- Copyright in this report is the property of EIS. EIS has used a degree of care, skill and diligence normally exercised by consulting professionals in similar circumstances and locality. No other warranty expressed or implied is made or intended. Subject to payment of all fees due for the investigation, the client alone shall have a licence to use this report;
- If the client, or any person, provides a copy of this report to any third party, such third party must not rely on this report except with the express written consent of EIS; and
- Any third party who seeks to rely on this report without the express written consent of EIS does so entirely at their own risk and to the fullest extent permitted by law, EIS accepts no liability whatsoever, in respect of any loss or damage suffered by any such third party.

If you have any questions concerning the contents of this letter please do not hesitate to contact us.

Kind Regards



Rob Muller
Senior Environmental Scientist

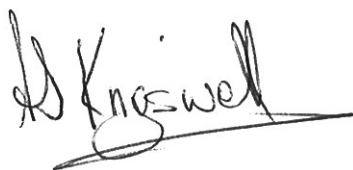

Adrian Kingswell
Principal

Appendices:

Appendix A: Report Figures

Appendix B: Laboratory Summary Table


Appendix C: Borehole Logs

Appendix D: Laboratory Report & COC Documents

Appendix E: Soil Suitability Analysis Report and Recommendations

Appendix F: UCL Calculations

Appendix A: Report Figures

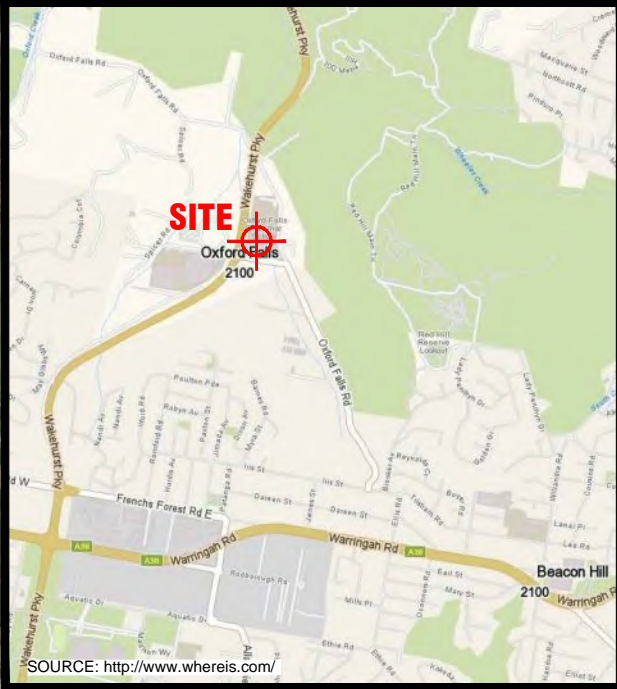

AERIAL IMAGE SOURCE: GOOGLE EARTH PRO 7.1.5.1557
AERIAL IMAGE ©: 2015 GOOGLE INC.

Title:

SITE LOCATION PLAN

Location:

OXFORD FALLS GRAMMAR SCHOOL
1078 OXFORD FALLS ROAD, OXFORD FALLS, NSW

Report No:

E30807KM


Figure No:

1

EIS

ENVIRONMENTAL INVESTIGATION SERVICES

This plan should be read in conjunction with the EIS report.

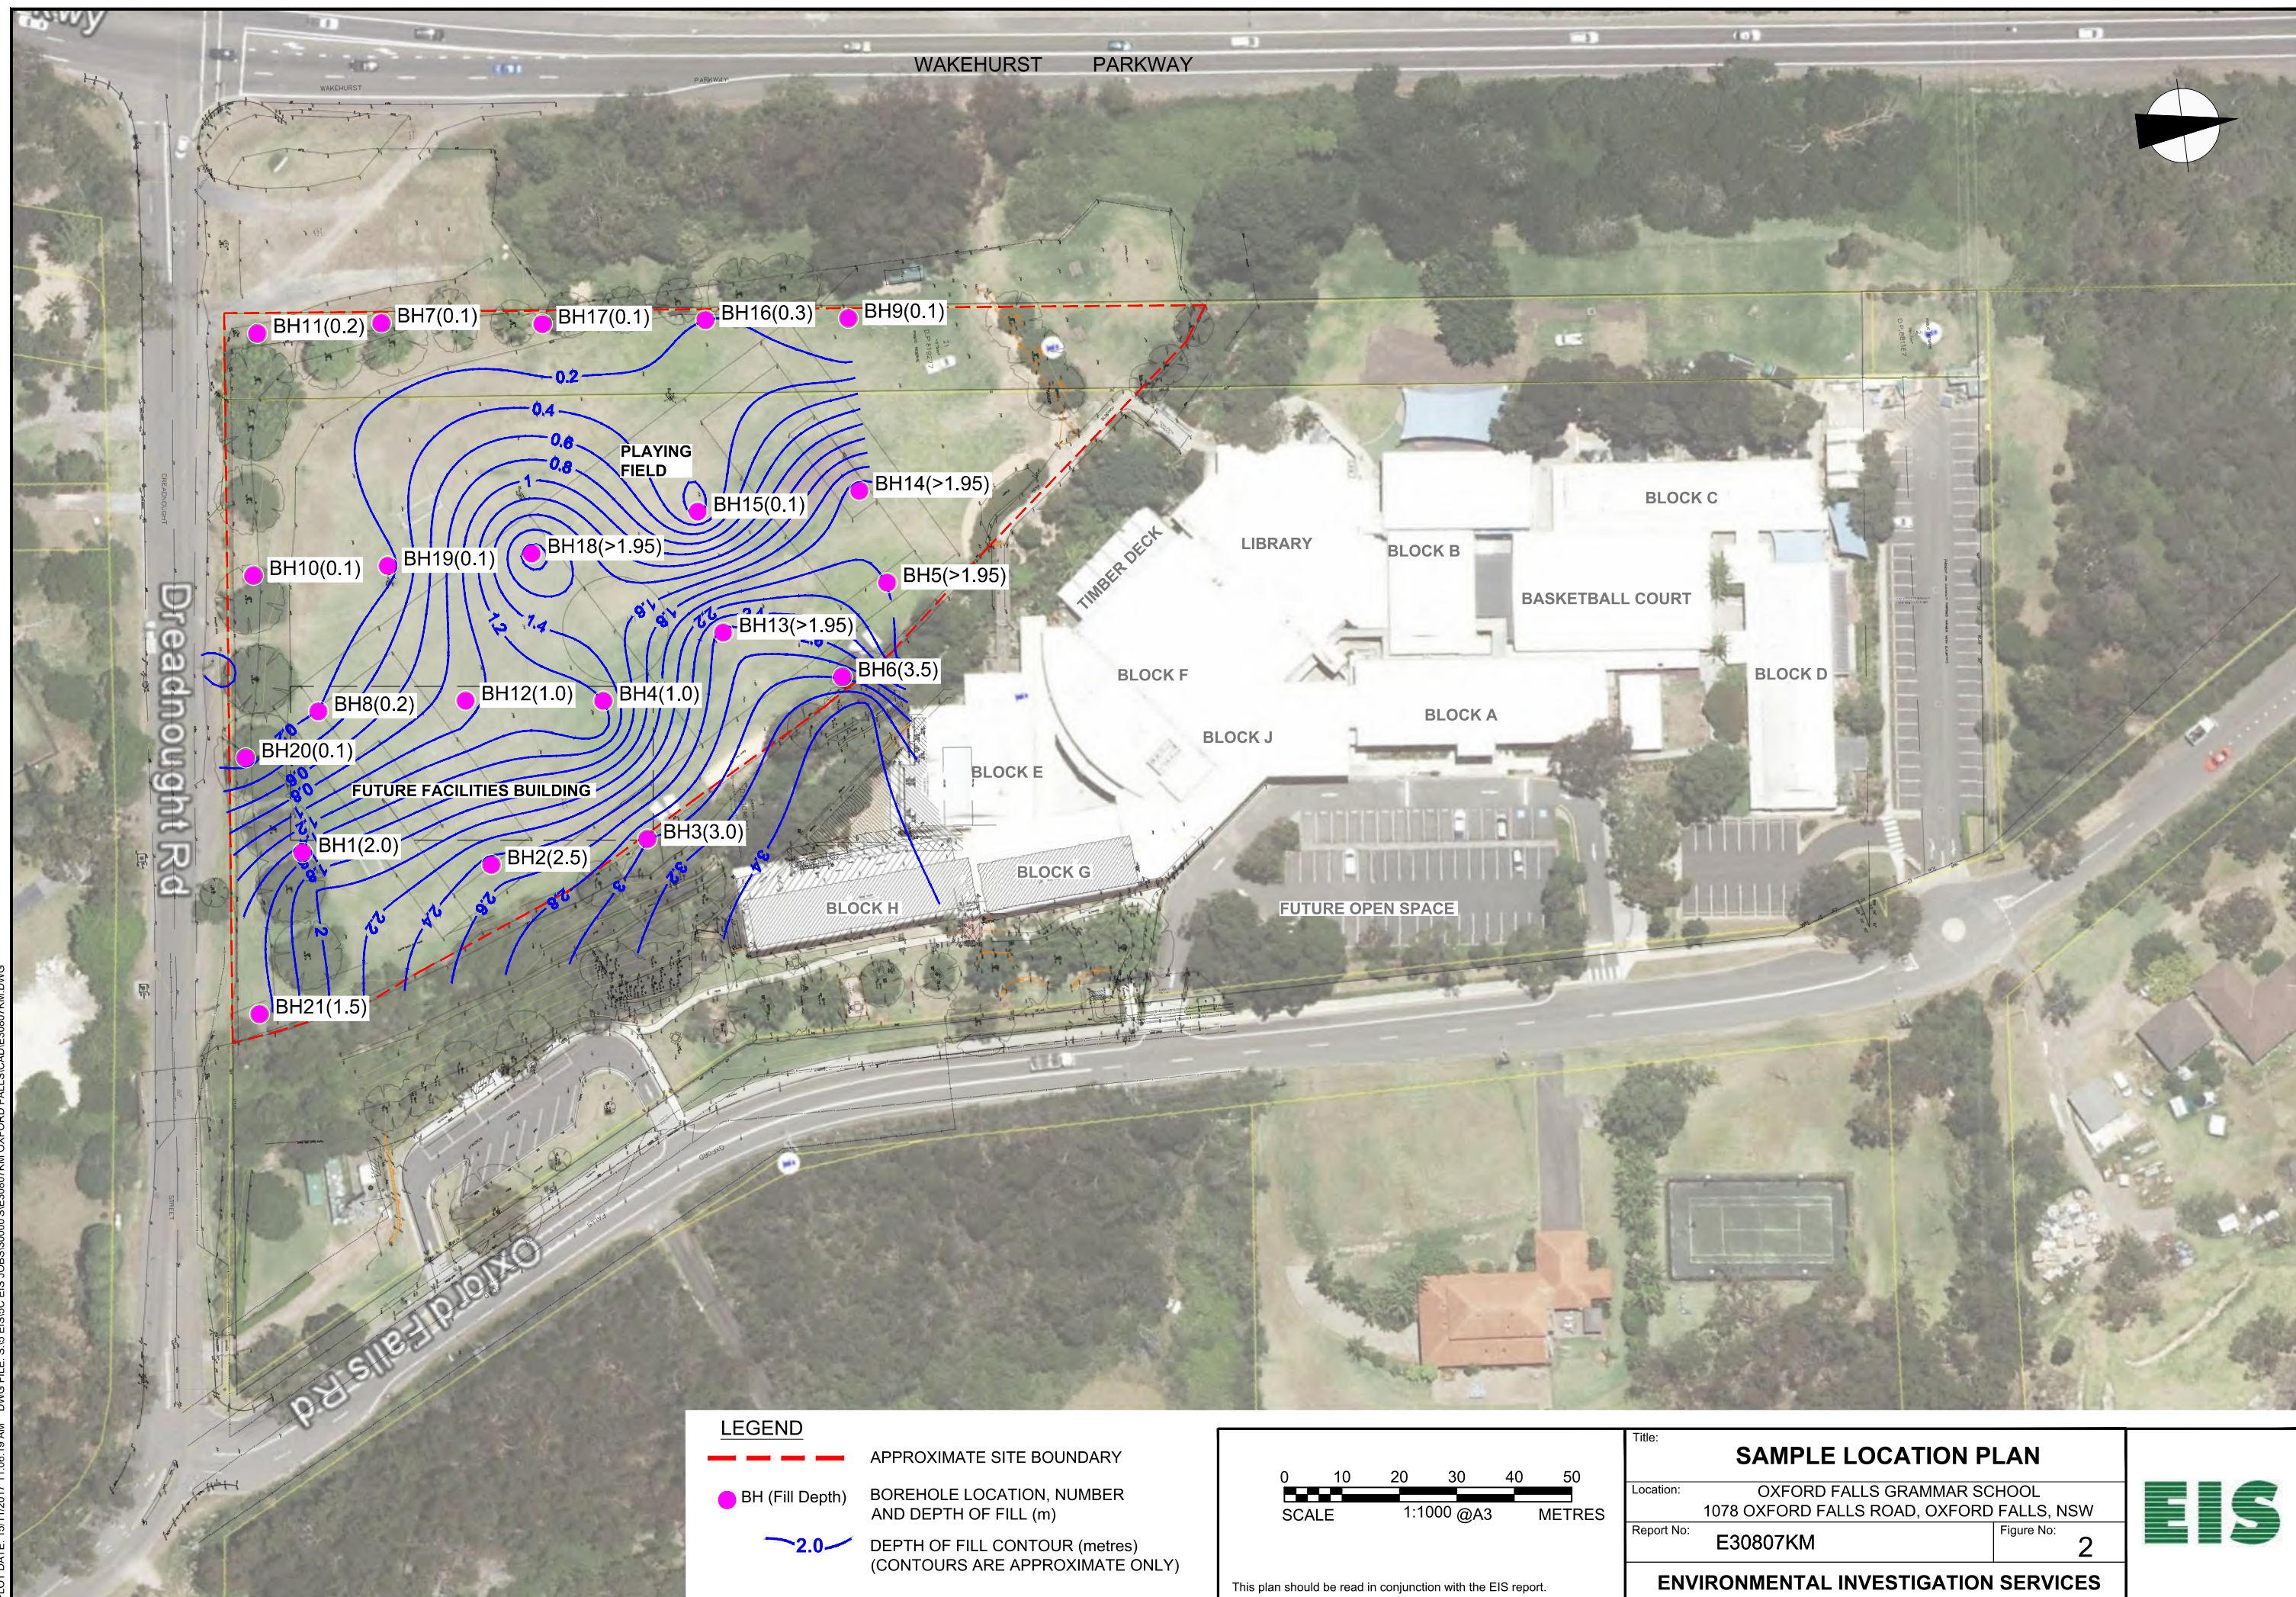

Appendix B: Laboratory Summary Table

TABLE A SOIL LABORATORY RESULTS COMPARED TO WASTE CLASSIFICATION GUIDELINES All data in mg/kg unless stated otherwise																											
			HEAVY METALS							PAHs		OC/OP PESTICIDES				Total PCBs	TRH					BTEX COMPOUNDS				ASBESTOS FIBRES	
			Arsenic	Cadmium	Chromium	Copper	Lead	Mercury	Nickel	Zinc	Total PAHs	B(a)P	Total Endosulfans	Chloropyrifos	Total Moderately Harmful ²		Total Scheduled ³	C ₆ -C ₉	C ₁₀ -C ₁₄	C ₁₅ -C ₂₈	C ₂₉ -C ₃₆	Total C ₁₀ -C ₃₆	Benzene	Toluene	Ethyl benzene		Total Xylenes
PQL - Envirolab Services			4	0.4	1	1	1	0.1	1	1	-	0.05	0.1	0.1	0.1	0.1	0.1	25	50	100	100	250	0.2	0.5	1	3	100
General Solid Waste CT1 ¹			100	20	100	NSL	100	4	40	NSL	200	0.8	60	4	250	<50	<50	650		NSL		10,000	10	288	600	1,000	-
General Solid Waste SCC1 ¹			500	100	1900	NSL	1500	50	1050	NSL	200	10	108	7.5	250	<50	<50	650		NSL		10,000	18	518	1,080	1,800	-
Restricted Solid Waste CT2 ¹			400	80	400	NSL	400	16	160	NSL	800	3.2	240	16	1000	<50	<50	2600		NSL		40,000	40	1,152	2,400	4,000	-
Restricted Solid Waste SCC2 ¹			2000	400	7600	NSL	6000	200	4200	NSL	800	23	432	30	1000	<50	<50	2600		NSL		40,000	72	2,073	4,320	7,200	-
Sample Reference	Sample Depth	Sample Description																									
BH1	0.0-0.2	Fill: silty sand	6	LPQL	9	10	34	LPQL	3	79	0.3	0.06	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	Not detected
BH1	2.0-2.5	Clayey sand	LPQL	LPQL	8	1	9	LPQL	2	13	LPQL	LPQL	NA	NA	NA	NA	NA	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	NA
BH2	0.0-0.2	Fill: silty sand	5	LPQL	7	18	23	LPQL	2	51	0.1	LPQL	NA	NA	NA	NA	NA	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	Not detected
BH2	0.5-0.95	Fill: sand	5	LPQL	16	15	73	LPQL	2	63	1.4	0.1	NA	NA	NA	NA	NA	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	NA
BH3	0.0-0.2	Fill: silty sand	LPQL	LPQL	7	6	12	LPQL	2	31	LPQL	LPQL	NA	NA	NA	NA	NA	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	Not detected
BH6	0.0-0.2	Fill: silty sand	LPQL	LPQL	13	5	13	LPQL	1	39	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	Not detected
BH6	3.0-3.45	Fill: sand	LPQL	LPQL	7	13	21	LPQL	2	100	LPQL	LPQL	NA	NA	NA	NA	NA	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	NA
BH9	0.0-0.2	Fill: silty sand	8	LPQL	13	29	56	LPQL	4	200	0.1	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	Not detected
BH11	0.0-0.2	Fill: silty sand	LPQL	LPQL	9	12	25	LPQL	7	45	0.4	0.06	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	Not detected
BH12	0.0-0.2	Fill: silty sand	5	LPQL	7	10	15	LPQL	2	42	LPQL	LPQL	NA	NA	NA	NA	NA	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	Not detected
BH13	0.5-0.95	Fill: sand	LPQL	LPQL	16	2	9	LPQL	2	21	LPQL	LPQL	NA	NA	NA	NA	NA	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	Not detected
BH16	0.0-0.2	Fill: silty sand	6	LPQL	12	31	36	LPQL	4	160	LPQL	LPQL	NA	NA	NA	NA	NA	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	NA
BH18	0.0-0.2	Fill: silty sand	LPQL	LPQL	6	13	13	LPQL	3	48	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	Not detected
BH18	1.5-1.95	Fill: clayey sand	LPQL	LPQL	19	3	8	LPQL	2	220	LPQL	LPQL	NA	NA	NA	NA	NA	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	NA
BH19	0.0-0.2	Fill: silty sand	LPQL	LPQL	7	10	18	LPQL	3	49	LPQL	LPQL	NA	NA	NA	NA	NA	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	Not detected
Total Number of samples			15	15	15	15	15	15	15	15	15	15	5	5	5	5	5	15	15	15	15	15	15	15	15	15	10
Maximum Value			8	LPQL	19	31	73	LPQL	7	220	1.4	0.1	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	LPQL	NC
Statistical Analysis on Fill Samples																											
Number of Fill Samples ⁴			14	14	14	14	14	14	14	14	14	14	NC	NC	NC	NC	NC	NC	NC	NC	NC	NC	NC	NC	NC	NC	NC
Mean Value ⁴			4.8	NC	10.6	12.6	25.4	NC	2.8	82	0.2	0.06	NC	NC	NC	NC	NC	NC	NC	NC	NC	NC	NC	NC	NC	NC	NC
Standard Deviation ⁴			1.1	NC	4.2	8.6	18.9	NC	1.5	64.5	0.4	0.01	NC	NC	NC	NC	NC	NC	NC	NC	NC	NC	NC	NC	NC	NC	NC
% UCL ⁴			95%	NC	95%	NC	95%	NC	95%	95%	95%	95%	NC	NC	NC	NC	NC	NC	NC	NC	NC	NC	NC	NC	NC	NC	NC
UCL Value ⁴			5.3	NC	12.6	NC	34.4	NC	3.5	129.7	0.4	0.06	NC	NC	NC	NC	NC	NC	NC	NC	NC	NC	NC	NC	NC	NC	NC
Explanation: ¹ - NSW EPA Waste Classification Guidelines, Part 1: Classifying Waste (2014) ² - Assessment of Total Moderately Harmful pesticides includes: Dichlorovos, Dimethoate, Fenitrothion, Ethion, Malathion and Parathion ³ - Assessment of Total Scheduled pesticides include: HBC, alpha-BHC, gamma-BHC, beta-BHC, Heptachlor, Aldrin, Heptachlor Epoxide, gamma-Chlordane, alpha-chlordane, pp-DDE, Dieldrin, Endrin, pp-DDD, pp-DDT, Endrin Aldehyde ⁴ - Statistical calculation undertaken using ProUCL version 5.0 (USEPA). Statistical calculation has only been undertaken on fill samples																											
Concentration above the CT1			<div>VALUE</div>																								
Concentration above SCC1			<div>VALUE</div>																								
Concentration above the SCC2			<div>VALUE</div>																								
Abbreviations: PAHs: Polycyclic Aromatic Hydrocarbons B(a)P: Benzo(a)pyrene PQL: Practical Quantitation Limit LPQL: Less than PQL PID: Photoionisation Detector PCBs: Polychlorinated Biphenyls UCL: Upper Level Confidence Limit on Mean Value NA: Not Analysed NC: Not Calculated NSL: No Set Limit SAC: Site Assessment Criteria TRH: Total Recoverable Hydrocarbons CT: Contaminant Threshold SCC: Specific Contaminant Concentration HILs: Health Investigation Levels NEPM: National Environmental Protection Measure BTEX: Monocyclic Aromatic Hydrocarbons																											

Appendix C: Borehole Logs



BOREHOLE LOG

Borehole No.
1
1/1
E 337534
N 6265349

Client: OXFORD FALLS GRAMMAR SCHOOL
Project: PROPOSED SPORTING FACILITY, CARPARK AND PLAYING FIELDS
Location: 1078 OXFORD FALLS ROAD, OXFORD FALLS, NSW

Job No. 30807SY Method: SPIRAL AUGER R.L. Surface: 74.2m
Date: 25-9-17 JK350 Datum: AHD
Logged/Checked by: T.C./W.T.

Groundwater Record	SAMPLES			Field Tests	Depth (m)	Graphic Log	Unified Classification	DESCRIPTION	Moisture Condition/ Weathering	Strength/ Rel. Density	Hand Penetrometer Readings (kPa.)	Remarks
	ES	U50	DB									
AFTER 1 HR				N > 10 2,10/50mm REFUSAL	0			FILL: Silty sand, fine to medium grained, brown, with medium to coarse grained sandstone gravel and cobbles, trace of roots, bricks, metal and plastic fragments.	M			GRASS COVER
					1			FILL: Sand, fine to medium grained, orange brown and dark grey, with fine to coarse grained sandstone gravel.				MODERATE TO HIGH 'TC' BIT RESISTANCE
					2		SC	CLAYEY SAND: fine to medium grained, grey and orange brown.	M	(L)		SOIL RESISTANCE
				N = 9 3,5,4	3			CLAYEY SAND: fine to coarse grained, grey and dark grey.		L		APPEARS MODERATELY COMPACTED
					4							ALLUVIAL
				N > 30 9,20, 10/50mm REFUSAL	5		-	SANDSTONE: fine to coarse grained, grey.	XW DW	EL M		LOW RESISTANCE
					6							MODERATE TO HIGH RESISTANCE
					7			END OF BOREHOLE AT 6.0m				



BOREHOLE LOG

Borehole No.
2
1/1
E 337534
N 6265380

Client: OXFORD FALLS GRAMMAR SCHOOL
Project: PROPOSED SPORTING FACILITY, CARPARK AND PLAYING FIELDS
Location: 1078 OXFORD FALLS ROAD, OXFORD FALLS, NSW

Job No. 30807SY Method: SPIRAL AUGER R.L. Surface: 74.2m
Date: 25-9-17 JK350 Datum: AHD
Logged/Checked by: T.C./W.T.

Groundwater Record	SAMPLES			Field Tests	Depth (m)	Graphic Log	Unified Classification	DESCRIPTION	Moisture Condition/ Weathering	Strength/ Rel. Density	Hand Penetrometer Readings (kPa.)	Remarks
	ES	U50	DB									
AFTER 1 HR					0			FILL: Silty sand, fine to medium grained, dark brown.	M			GRASS COVER
				N = 25 8,10,15				FILL: Sand, fine to coarse grained, dark brown, grey and orange brown, with clay and fine to medium grained sandstone gravel.				APPEARS WELL COMPACTED
					1							
				N = 5 3,2,3								APPEARS POORLY COMPACTED
					2							
							CL	SANDY CLAY: medium plasticity, brown.	MC~PL	(F)		ALLUVIAL
				N = 14 5,7,7	3		SP	SAND: fine to coarse grained, grey and orange brown, with clay.	M	MD		
					4							
				N > 25 8,15, 10/50mm REFUSAL			-	SANDSTONE: fine to coarse grained, grey and dark grey.	XW	EL		
					5			SANDSTONE: fine to medium grained, grey.	DW	M		MODERATE TO HIGH 'TC' BIT RESISTANCE
					6			END OF BOREHOLE AT 6.0m				HIGH RESISTANCE
					7							

BOREHOLE LOG

Borehole No.

3

1/1

E 33753
N 6265408

Client: OXFORD FALLS GRAMMAR SCHOOL
Project: PROPOSED SPORTING FACILITY, CARPARK AND PLAYING FIELDS
Location: 1078 OXFORD FALLS ROAD, OXFORD FALLS, NSW

Job No. 30807SY **Method:** SPIRAL AUGER JK350 **R.L. Surface:** 73.7m
Date: 25-9-17 **Datum:** AHD
Logged/Checked by: T.C./W.T.

Groundwater Record	SAMPLES			Field Tests	Depth (m)	Graphic Log	Unified Classification	DESCRIPTION	Moisture Condition/ Weathering	Strength/ Rel. Density	Hand Penetrometer Readings (kPa.)	Remarks
	ES	U50	DB									
					0			FILL: Silty sand, fine to coarse grained, brown, with root fibres.	M			GRASS COVER
				N = 4 2,2,2				FILL: Sandy clay, medium plasticity, red brown, fine to medium grained sand, trace of fine to coarse grained sandstone gravel, cobbles and boulders.	MC≈PL			APPEARS POORLY COMPACTED
					1							
				N = 23 3,8,15				FILL: Silty sand, fine to medium grained, orange brown, grey and brown, with fine to coarse grained sandstone gravel, cobbles and boulders, trace of brick.	M			APPEARS WELL COMPACTED
					2		SC	CLAYEY SAND: fine to coarse grained, grey.	M	MD		ALLUVIAL
				N > 16 1,5,11/ 20mm REFUSAL	3							ORGANIC ODOUR
					4		-	SANDSTONE: fine to medium grained, orange brown and grey.	DW	VL-L		LOW 'TC' BIT RESISTANCE
					5			SANDSTONE: fine to coarse grained, grey.		L-M		MODERATE RESISTANCE
					6					M		MODERATE TO HIGH RESISTANCE
					7			END OF BOREHOLE AT 6.0m				

AFTER
1 HR
▲

BOREHOLE LOG

Borehole No.

4

1/1

E 337513
N 6265402

Client: OXFORD FALLS GRAMMAR SCHOOL
Project: PROPOSED SPORTING FACILITY, CARPARK AND PLAYING FIELDS
Location: 1078 OXFORD FALLS ROAD, OXFORD FALLS, NSW

Job No. 30807SY **Method:** SPIRAL AUGER **R.L. Surface:** 74.0m
Date: 25-9-17 **JK350** **Datum:** AHD
Logged/Checked by: T.C./W.T.

Groundwater Record	SAMPLES				Field Tests	Depth (m)	Graphic Log	Unified Classification	DESCRIPTION	Moisture Condition/ Weathering	Strength/ Rel. Density	Hand Penetrometer Readings (kPa.)	Remarks
	ES	U50	DB	DS									
					N = 10 6,6,4	0			FILL: Silty sand, fine to medium grained, brown and orange brown, trace of medium to coarse grained sandstone gravel, cobbles and boulders.	M			GRASS COVER
						1		SC	FILL: Sandy clay, medium plasticity, light brown mottled red and yellow brown, with medium to coarse grained sandstone gravel.	M	L		APPEARS WELL COMPACTED
					N = 8 3,4,4	2			CLAYEY SAND: fine to medium grained, grey mottled dark grey and orange brown.				ALLUVIAL
						3					MD		
					N = 14 3,5,9	4		SP	SAND: fine to coarse grained, orange brown, with medium grained, sub rounded to sub angular quartz gravel.	W			
					N > 17 6,7,10/ 20mm REFUSAL	5							
						6		-	SANDSTONE: fine to coarse grained, grey and orange brown.	DW	L-M		LOW TO MODERATE 'TC' BIT RESISTANCE
						6			END OF BOREHOLE AT 6.0m				
						7							

▲
AFTER
1 HR



BOREHOLE LOG

Borehole No.
5
1/1
E 337510
N 6265456

Client:

OXFORD FALLS GRAMMAR SCHOOL

Project:

PROPOSED SPORTING FACILITY, CARPARK AND PLAYING FIELDS

Location:

1078 OXFORD FALLS ROAD, OXFORD FALLS, NSW

Job No.

30807SY

Method:

SPIRAL AUGER
JK350

R.L. Surface:

73.6m

Date:

25-9-17

Logged/Checked by:

T.C./W.T.

Datum:

AHD

Groundwater Record	SAMPLES				Field Tests	Depth (m)	Graphic Log	Unified Classification	DESCRIPTION	Moisture Condition/ Weathering	Strength/ Rel. Density	Hand Penetrometer Readings (kPa.)	Remarks
	ES	U50	DB	DS									
DRY ON COMPLETION						0			FILL: Silty sand, fine to medium grained, brown, with root fibres, trace of medium to coarse grained sandstone gravel.	D			GRASS COVER
					N > 10 10/20mm REFUSAL	1			FILL: Silty sand, fine to medium grained, orange brown, with fine to coarse grained sandstone gravel, cobbles and boulders.	M			APPEARS POORLY TO MODERATELY COMPACTED
					N = 6 2,3,3								
						2			END OF BOREHOLE AT 1.95m				
						3							
						4							
						5							
						6							
						7							

BOREHOLE LOG

Borehole No.

6

1/1

E 337518
N 6265448

Client: OXFORD FALLS GRAMMAR SCHOOL
Project: PROPOSED SPORTING FACILITY, CARPARK AND PLAYING FIELDS
Location: 1078 OXFORD FALLS ROAD, OXFORD FALLS, NSW

Job No. 30807SY **Method:** SPIRAL AUGER JK350 **R.L. Surface:** 73.6m
Date: 25-9-17 **Datum:** AHD
Logged/Checked by: T.C./W.T.

Groundwater Record	SAMPLES			Field Tests	Depth (m)	Graphic Log	Unified Classification	DESCRIPTION	Moisture Condition/ Weathering	Strength/ Rel. Density	Hand Penetrometer Readings (kPa.)	Remarks
	ES	U50	DB									
ON COMPLETION					0			FILL: Silty sand, fine to coarse grained, brown, trace of fine to medium grained sandstone gravel.	M			GRASS COVER
								FILL: Sandstone boulder	-			HIGH 'TC' BIT RESISTANCE
				N = 15 4,11,4	1			FILL: Silty sand, fine to coarse grained, brown, orange brown and grey, with fine to medium grained sandstone gravel, trace of timber and plastic fragments.	M			SOIL RESISTANCE APPEARS MODERATELY COMPACTED
					2							
				N = 6 3,3,3	3			FILL: Sand, fine to coarse grained, dark grey and orange brown, with string fibrefragments.				APPEARS POORLY COMPACTED
					4		SC	CLAYEY SAND: fine to coarse grained, grey.	M-W	(MD)		ALLUVIAL
				N = SPT 20/70mm REFUSAL	5		-	SANDSTONE: fine to coarse grained, grey.	DW	VL-L M-H		LOW 'TC' BIT RESISTANCE HIGH RESISTANCE
					6			END OF BOREHOLE AT 5.6m				'TC' BIT REFUSAL
					7							



BOREHOLE LOG

Borehole No.
7
1/1
E 337443
N 6265377

Client: OXFORD FALLS GRAMMAR SCHOOL
Project: PROPOSED SPORTING FACILITY, CARPARK AND PLAYING FIELDS
Location: 1078 OXFORD FALLS ROAD, OXFORD FALLS, NSW

Job No. 30807SY **Method:** SPIRAL AUGER JK350 **R.L. Surface:** 76.1m
Date: 25-9-17 **Datum:** AHD
Logged/Checked by: T.C./W.T.

Groundwater Record	SAMPLES			Field Tests	Depth (m)	Graphic Log	Unified Classification	DESCRIPTION	Moisture Condition/ Weathering	Strength/ Rel. Density	Hand Penetrometer Readings (kPa.)	Remarks
	ES	US	DB									
DRY ON COMPLETION					0	XXXX	SP	FILL: Silty sand, fine to medium grained, brown, with root fibres. SAND: fine to coarse grained, orange brown, with clay.	M M	MD		GRASS COVER
				N = 12 4,6,6								ALLUVIAL
					1							
				N = 14 3,6,8								
					2							
				N = 17 7,7,10			SC	CLAYEY SAND: fine to coarse grained, grey, orange brown and red brown.				
					3							
					4							
				N = 23 10,10,15			-	SANDSTONE: fine to coarse grained, grey, orange brown and red brown.	XW	EL		
					5			END OF BOREHOLE AT 4.95m				
					6							
					7							



BOREHOLE LOG

Borehole No.
8
1/1
E 337503
N 6265355

Client: OXFORD FALLS GRAMMAR SCHOOL
Project: PROPOSED SPORTING FACILITY, CARPARK AND PLAYING FIELDS
Location: 1078 OXFORD FALLS ROAD, OXFORD FALLS, NSW

Job No. 30807SY **Method:** SPIRAL AUGER JK350 **R.L. Surface:** 74.3m
Date: 26-9-17 **Datum:** AHD
Logged/Checked by: T.C./W.T.

Groundwater Record	SAMPLES				Field Tests	Depth (m)	Graphic Log	Unified Classification	DESCRIPTION	Moisture Condition/ Weathering	Strength/ Rel. Density	Hand Penetrometer Readings (kPa.)	Remarks
	ES	US	DB	DS									
AFTER 1 HR						0			FILL: Silty sand, fine to medium grained, brown, yellow brown mottled red and light brown, with medium to coarse grained sandstone gravel and cobbles.	M			GRASS COVER
					N = 14 5,7,7	1		SC	CLAYEY SAND: fine to coarse grained, grey.	M	MD		ALLUVIAL
					N = 14 5,6,8	2							
					N = 21 10,11,10	3		SC	CLAYEY SAND: fine to coarse grained, grey and orange brown.				
						4		-	SANDSTONE: fine to coarse grained, grey.	DW	L-M		LOW 'TC' BIT RESISTANCE
						5					M		MODERATE TO HIGH RESISTANCE
						6			END OF BOREHOLE AT 6.0m				
						7							



BOREHOLE LOG

Borehole No.
9
1/1
E 337457
N 6265456

Client: OXFORD FALLS GRAMMAR SCHOOL
Project: PROPOSED SPORTING FACILITY, CARPARK AND PLAYING FIELDS
Location: 1078 OXFORD FALLS ROAD, OXFORD FALLS, NSW

Job No. 30807SY Method: SPIRAL AUGER R.L. Surface: 73.6m
Date: 26-9-17 JK350 Datum: AHD
Logged/Checked by: T.C./W.T.

Groundwater Record	SAMPLES				Field Tests	Depth (m)	Graphic Log	Unified Classification	DESCRIPTION	Moisture Condition/ Weathering	Strength/ Rel. Density	Hand Penetrometer Readings (kPa.)	Remarks
	ES	US	DB	DS									
DRY ON COMPLET- ION						0			FILL: Silty sand, fine to medium grained, brown, with fine to coarse grained sandstone gravel.	M			GRASS COVER
					N = 7 4,4,3			SC	CLAYEY SAND: fine to medium grained, orange brown.	M	L		ALLUVIAL
					N = 7 3,4,3	1			CLAYEY SAND: fine to coarse grained, grey and orange brown, trace of ironstone gravel.				
						2			END OF BOREHOLE AT 1.95m				
						3							
						4							
						5							
						6							
						7							

BOREHOLE LOG

Borehole No.

10

1/1

E 337478
N 6265347

Client: OXFORD FALLS GRAMMAR SCHOOL
Project: PROPOSED SPORTING FACILITY, CARPARK AND PLAYING FIELDS
Location: 1078 OXFORD FALLS ROAD, OXFORD FALLS, NSW

Job No. 30807SY **Method:** SPIRAL AUGER JK350 **R.L. Surface:** 75.8m
Date: 26-9-17 **Datum:** AHD
Logged/Checked by: T.C./W.T.

Groundwater Record	SAMPLES			Field Tests	Depth (m)	Graphic Log	Unified Classification	DESCRIPTION	Moisture Condition/ Weathering	Strength/ Rel. Density	Hand Penetrometer Readings (kPa.)	Remarks
	ES	US	DB									
DRY ON COMPLETION					0	XXXX	SP	FILL: Silty sand, fine to coarse grained, brown, with roots. SAND: fine to coarse grained, orange brown, with clay.	D M	L		GRASS COVER
				N = 9 3,4,5	1		SC	CLAYEY SAND: fine to coarse grained, orange brown and grey.		MD		ALLUVIAL
				N = 10 3,4,6	2		SP	SAND: fine to coarse grained, grey, orange brown and red brown.				
				N = 17 7,8,9	3							
					4		-	SANDSTONE: fine to coarse grained, orange brown.	XW-DW	EL-VL		VERY LOW TO LOW 'TC' BIT RESISTANCE
					5			END OF BOREHOLE AT 4.5m				
					6							
					7							

BOREHOLE LOG

Borehole No.













11

1/1

E 337442
N 6265352

Client: OXFORD FALLS GRAMMAR SCHOOL
Project: PROPOSED SPORTING FACILITY, CARPARK AND PLAYING FIELDS
Location: 1078 OXFORD FALLS ROAD, OXFORD FALLS, NSW

Job No. 30807SY **Method:** SPIRAL AUGER JK350 **R.L. Surface:** 77.0m
Date: 26-9-17 **Datum:** AHD
Logged/Checked by: T.C./W.T.

Groundwater Record	SAMPLES			Field Tests	Depth (m)	Graphic Log	Unified Classification	DESCRIPTION	Moisture Condition/ Weathering	Strength/ Rel. Density	Hand Penetrometer Readings (kPa.)	Remarks
	ES	U50	DB									
					0			FILL: Silty sand, fine to medium grained, brown, with roots.	D			GRASS COVER
							SC	CLAYEY SAND: fine to coarse grained, orange brown.	M	MD		ALLUVIAL
				N = 10 4,4,6	1							
								CLAYEY SAND: fine to coarse grained, orange brown and red brown.				
				N = 14 5,6,8	2							
							SP	SAND: fine to coarse grained, red brown and grey.				
				N = 20 5,6,14	3							
												
					4			SAND: fine to coarse grained, red brown, with clay.	W	(MD)		
							-	SANDSTONE: fine to coarse grained, orange brown, grey and red brown.	XW	EL		VERY LOW TO LOW 'TC' BIT RESISTANCE
					5				DW	L		LOW RESISTANCE
					6			END OF BOREHOLE AT 5.5m				
					7							

BOREHOLE LOG

Borehole No.

12

1/1

E 337510
N 6265378

Client: OXFORD FALLS GRAMMAR SCHOOL
Project: PROPOSED SPORTING FACILITY, CARPARK AND PLAYING FIELDS
Location: 1078 OXFORD FALLS ROAD, OXFORD FALLS, NSW

Job No. 30807SY **Method:** SPIRAL AUGER JK350 **R.L. Surface:** 74.3m
Date: 26-9-17 **Datum:** AHD
Logged/Checked by: T.C./W.T.

Groundwater Record	SAMPLES			Field Tests	Depth (m)	Graphic Log	Unified Classification	DESCRIPTION	Moisture Condition/ Weathering	Strength/ Rel. Density	Hand Penetrometer Readings (kPa.)	Remarks
	ES	US	DB									
					0			FILL: Silty sand, fine to medium grained, brown, with roots.	M			GRASS COVER
				N = 30 6,20,10				FILL: Sand, fine to coarse grained, orange brown and grey, with clay, trace of fine grained sandstone gravel.				APPEARS WELL COMPACTED
					1		SP	SAND: fine to coarse grained, grey and dark grey, trace of clay.	M	L		ALLUVIAL
				N = 9 3,4,5								
					2							
					3		CL	SANDY CLAY: medium plasticity, grey, fine to coarse grained sand.	MC~PL	VSt		
				N = 7 2,3,4							300 350	
					4		-	SANDSTONE: fine to coarse grained, orange brown and grey.	XW	EL		VERY LOW 'TC' BIT RESISTANCE
				N = 25 6,7,18								
					5							
					6			END OF BOREHOLE AT 6.0m				
					7							

AFTER
1 HR





BOREHOLE LOG

Borehole No.
13
1/1
E 337501
N 6265426

Client:

OXFORD FALLS GRAMMAR SCHOOL

Project:

PROPOSED SPORTING FACILITY, CARPARK AND PLAYING FIELDS

Location:

1078 OXFORD FALLS ROAD, OXFORD FALLS, NSW

Job No. 30807SY

Method: SPIRAL AUGER JK350

R.L. Surface: 74.0m

Date: 26-9-17

Logged/Checked by: T.C./W.T.

Datum: AHD

Groundwater Record	SAMPLES				Field Tests	Depth (m)	Graphic Log	Unified Classification	DESCRIPTION	Moisture Condition/ Weathering	Strength/ Rel. Density	Hand Penetrometer Readings (kPa.)	Remarks
	ES	U50	DB	DS									
DRY ON COMPLETION						0			FILL: Silty sand, fine to coarse grained, brown, with roots.	M			GRASS COVER APPEARS MODERATELY COMPACTED
					N > 13 8,13/10mm REFUSAL	1			FILL: Sand, fine to coarse grained, orange brown and dark grey, with clay.				
					N = 13 7,6,7				FILL: Sand, fine to coarse grained, red brown and dark grey, with medium grained sandstone gravel.				
						2			END OF BOREHOLE AT 1.95m				
						3							
						4							
						5							
						6							
						7							



BOREHOLE LOG

Borehole No.
14
1/1
E 337480
N 6265454

Client:

OXFORD FALLS GRAMMAR SCHOOL

Project:

PROPOSED SPORTING FACILITY, CARPARK AND PLAYING FIELDS

Location:

1078 OXFORD FALLS ROAD, OXFORD FALLS, NSW

Job No. 30807SY

Date: 26-9-17

Method: SPIRAL AUGER
JK350

Logged/Checked by: T.C./W.T.

R.L. Surface: 73.8m

Datum: AHD

Groundwater Record	SAMPLES				Field Tests	Depth (m)	Graphic Log	Unified Classification	DESCRIPTION	Moisture Condition/ Weathering	Strength/ Rel. Density	Hand Penetrometer Readings (kPa.)	Remarks
	ES	US	DB	DS									
DRY ON COMPLETION						0			FILL: Silty sand, fine to coarse grained, brown, with root fibres.	D			GRASS COVER
					N = 10 2,2,8				FILL: Sand, fine to coarse grained, grey and brown, with medium to coarse grained sandstone gravel.	M			APPEARS MODERATELY COMPACTED
						1			as above, but with polystyrene fragments.				
					N = 14 6,7,7								
						2			END OF BOREHOLE AT 1.95m				
						3							
						4							
						5							
						6							
						7							



BOREHOLE LOG

Borehole No.
15
1/1
E 337451
N 6265425

Client: OXFORD FALLS GRAMMAR SCHOOL
Project: PROPOSED SPORTING FACILITY, CARPARK AND PLAYING FIELDS
Location: 1078 OXFORD FALLS ROAD, OXFORD FALLS, NSW

Job No. 30807SY **Method:** SPIRAL AUGER JK350 **R.L. Surface:** 74.0m
Date: 26-9-17 **Datum:** AHD
Logged/Checked by: T.C./W.T.

Groundwater Record	SAMPLES				Field Tests	Depth (m)	Graphic Log	Unified Classification	DESCRIPTION	Moisture Condition/ Weathering	Strength/ Rel. Density	Hand Penetrometer Readings (kPa.)	Remarks
	ES	US	DB	DS									
DRY ON COMPLETION						0	XXXX	SP	FILL: Silty sand, fine to coarse grained, brown, with roots. SAND: fine to coarse grained, orange brown, trace of clay.	M M	L		GRASS COVER ALLUVIAL
					N = 8 3,4,4								
						1		SC	CLAYEY SAND: fine to coarse grained, orange brown and grey.				
					N = 10 3,4,6						MD		
						2			END OF BOREHOLE AT 1.95m				
						3							
						4							
						5							
						6							
						7							



BOREHOLE LOG

Borehole No.
16
1/1
E 337451
N 6265433

Client: OXFORD FALLS GRAMMAR SCHOOL
Project: PROPOSED SPORTING FACILITY, CARPARK AND PLAYING FIELDS
Location: 1078 OXFORD FALLS ROAD, OXFORD FALLS, NSW

Job No. 30807SY Method: SPIRAL AUGER R.L. Surface: 73.7m
Date: 26-9-17 JK350 Datum: AHD
Logged/Checked by: T.C./W.T.

Groundwater Record	SAMPLES				Field Tests	Depth (m)	Graphic Log	Unified Classification	DESCRIPTION	Moisture Condition/ Weathering	Strength/ Rel. Density	Hand Penetrometer Readings (kPa.)	Remarks
	ES	U50	DB	DS									
DRY ON COMPLETION						0			FILL: Silty sand, fine to coarse grained, brown, with roots.	M			GRASS COVER
					N = 8 3,4,4	1		SC	CLAYEY SAND: fine to coarse grained, orange brown.	M	L		ALLUVIAL
					N = 14 5,6,8				CLAYEY SAND: fine to coarse grained, orange brown and grey.		MD		
						2			END OF BOREHOLE AT 1.95m				
						3							
						4							
						5							
						6							
						7							



BOREHOLE LOG

Borehole No.
17
1/1
E 337449
N 6265404

Client:

OXFORD FALLS GRAMMAR SCHOOL

Project:

PROPOSED SPORTING FACILITY, CARPARK AND PLAYING FIELDS

Location:

1078 OXFORD FALLS ROAD, OXFORD FALLS, NSW

Job No. 30807SY

Method: SPIRAL AUGER JK350

R.L. Surface: 74.4m

Date: 26-9-17

Logged/Checked by: T.C./W.T.

Datum: AHD

Groundwater Record	SAMPLES				Field Tests	Depth (m)	Graphic Log	Unified Classification	DESCRIPTION	Moisture Condition/ Weathering	Strength/ Rel. Density	Hand Penetrometer Readings (kPa.)	Remarks
	ES	U50	DB	DS									
DRY ON COMPLETION						0			FILL: Silty sand, fine to coarse grained, brown, with root fibres.	M			GRASS COVER
								SP	SAND: fine to coarse grained, dark brown, with clay.	M	L		ALLUVIAL
					N = 7 3,3,4	1							
					N = 20 4,10,10			SC	CLAYEY SAND: fine to coarse grained, red brown and grey.		MD		
						2			END OF BOREHOLE AT 1.95m				
						3							
						4							
						5							
						6							
						7							



BOREHOLE LOG

Borehole No.
18
1/1
E 337482
N 6265396

Client: OXFORD FALLS GRAMMAR SCHOOL												
Project: PROPOSED SPORTING FACILITY, CARPARK AND PLAYING FIELDS												
Location: 1078 OXFORD FALLS ROAD, OXFORD FALLS, NSW												
Job No. 30807SY Method: SPIRAL AUGER JK350 R.L. Surface: 74.1m												
Date: 26-9-17 Logged/Checked by: T.C./W.T. Datum: AHD												
Groundwater Record	SAMPLES			Field Tests	Depth (m)	Graphic Log	Unified Classification	DESCRIPTION	Moisture Condition/ Weathering	Strength/ Rel. Density	Hand Penetrometer Readings (kPa.)	Remarks
	ES	US	DB									
DRY ON COMPLETION					0			FILL: Silty sand, fine to coarse grained, brown, with root fibres.	M			GRASS COVER
				N = 17 20,11,6	1		FILL: Clayey sand, fine to coarse grained, orange brown.				APPEARS WELL COMPACTED	
				N = 1 0,0,1			FILL: Clayey sand, fine to coarse grained, grey and brown, timber and plastic fragments.	W			APPEARS POORLY COMPACTED	
					2			END OF BOREHOLE AT 1.95m				
					3							
					4							
					5							
					6							
					7							



BOREHOLE LOG

Borehole No.
19
1/1
E 337480
N 6265371

Client:

OXFORD FALLS GRAMMAR SCHOOL

Project:

PROPOSED SPORTING FACILITY, CARPARK AND PLAYING FIELDS

Location:

1078 OXFORD FALLS ROAD, OXFORD FALLS, NSW

Job No. 30807SY

Method: SPIRAL AUGER JK350

R.L. Surface: 74.2m

Date: 26-9-17

Logged/Checked by: T.C./W.T.

Datum: AHD

Groundwater Record	SAMPLES				Field Tests	Depth (m)	Graphic Log	Unified Classification	DESCRIPTION	Moisture Condition/ Weathering	Strength/ Rel. Density	Hand Penetrometer Readings (kPa.)	Remarks
	ES	US	DB	DS									
DRY ON COMPLETION						0		SC	FILL: Silty sand, fine to coarse grained, brown, with root fibres.	M M	MD		GRASS COVER ALLUVIAL
					N = 10 8,6,4				CLAYEY SAND: fine to coarse grained, orange brown and grey.				
					N = 10 5,4,6				CLAYEY SAND: fine to coarse grained, orange brown and grey.				
						2			END OF BOREHOLE AT 1.95m				
						3							
						4							
						5							
						6							
						7							



BOREHOLE LOG

Borehole No.
20
1/1
E 337509
N 6565341

Client: OXFORD FALLS GRAMMAR SCHOOL
Project: PROPOSED SPORTING FACILITY, CARPARK AND PLAYING FIELDS
Location: 1078 OXFORD FALLS ROAD, OXFORD FALLS, NSW

Job No. 30807SY Method: SPIRAL AUGER R.L. Surface: 74.6m
Date: 26-9-17 JK350 Datum: AHD
Logged/Checked by: T.C./W.T.

Groundwater Record	SAMPLES			Field Tests	Depth (m)	Graphic Log	Unified Classification	DESCRIPTION	Moisture Condition/ Weathering	Strength/ Rel. Density	Hand Penetrometer Readings (kPa.)	Remarks
	ES	U50	DB									
DRY ON COMPLETION					0	XXXX	SM	FILL: Silty sand, fine to coarse grained, brown, with roots.	M	L		GRASS COVER
				N = 13 6,8,5	1			SILTY SAND: fine to coarse grained, brown and orange brown, with clay.	M			ALLUVIAL
					2			END OF BOREHOLE AT 1.95m				
					3							
					4							
					5							
					6							
					7							



BOREHOLE LOG

Borehole No.
21
1/1
E 337554
N 6265336

Client:

OXFORD FALLS GRAMMAR SCHOOL

Project:

PROPOSED SPORTING FACILITY, CARPARK AND PLAYING FIELDS

Location:

1078 OXFORD FALLS ROAD, OXFORD FALLS, NSW

Job No. 30807SY

Method: SPIRAL AUGER JK350

R.L. Surface: 73.5m

Date: 26-9-17

Logged/Checked by: T.C./W.T.

Datum: AHD

Groundwater Record	SAMPLES			Field Tests	Depth (m)	Graphic Log	Unified Classification	DESCRIPTION	Moisture Condition/ Weathering	Strength/ Rel. Density	Hand Penetrometer Readings (kPa.)	Remarks
	ES	U50	DB									
DRY ON COMPLETION					0			FILL: Silty sand, fine to coarse grained, brown and orange brown, with fine to medium grained sandstone gravel, trace of clay.	M			GRASS COVER
				N = 6 4,4,2	1		SC	CLAYEY SAND: fine to coarse grained, orange brown and grey.	M	L		ALLUVIAL
					2			END OF BOREHOLE AT 1.95m				
					3							
					4							
					5							
					6							
					7							

EXPLANATORY NOTES – ENVIRONMENTAL LOGS

INTRODUCTION

These notes have been provided to supplement the environmental report with regards to drilling and field logging. Not all notes are necessarily relevant to all reports. Where geotechnical borehole logs are utilised for environmental purpose, reference should also be made to the explanatory notes included in the geotechnical report. Environmental logs are not suitable for geotechnical purposes.

The ground is a product of continuing natural and manmade processes and therefore exhibits a variety of characteristics and properties which vary from place to place and can change with time. Environmental studies involve gathering and assimilating limited facts about these characteristics and properties in order to understand the ground on a particular site under certain conditions. These conditions are directly relevant only to the ground at the place where, and time when, the investigation was carried out.

DESCRIPTION AND CLASSIFICATION METHODS

The methods of description and classification of soils and rocks used in this report are based on Australian Standard 1726, the SAA Site Investigation Code. In general, descriptions cover the following properties – soil or rock type, colour, structure, strength or density, and inclusions. Identification and classification of soil and rock involves judgement and the Company infers accuracy only to the extent that is common in current geotechnical practice.

Soil types are described according to the predominating particle size and behaviour as set out in the attached Unified Soil Classification Table qualified by the grading of other particles present (e.g. sandy clay) as set out below (note that unless stated in the report, the soil classification is based on a qualitative field assessment, not laboratory testing):

Soil Classification	Particle Size
Clay	less than 0.002mm
Silt	0.002 to 0.075mm
Sand	0.075 to 2mm
Gravel	2 to 60mm

Non-cohesive soils are classified on the basis of relative density, generally from the results of Standard Penetration Test (SPT) as below:

Relative Density	SPT 'N' Value (blows/300mm)
Very loose	less than 4
Loose	4 – 10
Medium dense	10 – 30
Dense	30 – 50
Very Dense	greater than 50

Cohesive soils are classified on the basis of strength (consistency) either by use of hand penetrometer, laboratory testing or engineering examination. The strength terms are defined as shown in the following table:

Classification	Unconfined Compressive Strength kPa
Very Soft	less than 25
Soft	25 – 50
Firm	50 – 100
Stiff	100 – 200
Very Stiff	200 – 400
Hard	Greater than 400
Friable	Strength not attainable – soil crumbles

Rock types are classified by their geological names, together with descriptive terms regarding weathering, strength, defects, etc. Where relevant, further information regarding rock classification is given in the text of the report. In the Sydney Basin, 'Shale' is used to describe thinly bedded to laminated siltstone.

DRILLING OR EXCAVATION METHODS

The following is a brief summary of drilling and excavation methods currently adopted by the Company, and some comments on their use and application. All except test pits and hand auger drilling require the use of a mechanical drilling rig.

Test Pits: These are normally excavated with a backhoe or a tracked excavator, allowing close examination of the in-situ soils if it is safe to descend into the pit. The depth of penetration is limited to approximately 3m for a backhoe and up to 6m for an excavator. Limitations of test pits include problems associated with disturbance and difficulty of reinstatement; and the consequent effects on nearby structures. Care must be taken if construction is to be carried out near test pit locations to either properly re-compact the backfill during construction, or to design and construct the structure so as not to be adversely affected by poorly compacted backfill at the test pit location.

Hand Auger Drilling: A borehole of 50mm to 100mm diameter is advanced by manually operated equipment. Premature refusal of the hand augers can occur on a variety of materials such as fill, hard clay, gravel or ironstone, and does not necessarily indicate rock level.

Continuous Spiral Flight Augers: The borehole is advanced using 75mm to 115mm diameter continuous spiral flight augers, which are withdrawn at intervals to allow sampling and in-situ testing. This is a relatively economical means of drilling in clays and in sands above the water table. Samples are returned to the surface by the flights or may be collected after withdrawal of the auger flights, but they can be very disturbed and layers may become mixed. Information from the auger sampling (as distinct from specific sampling by SPTs or undisturbed samples) is of relatively lower reliability due to mixing or softening of samples by groundwater, or uncertainties as to the original depth of the samples. Augering below the groundwater table is of even lesser reliability than augering above the water table.

Rock Augering: Use can be made of a Tungsten Carbide (TC) bit for auger drilling into rock to indicate rock quality and continuity by variation in drilling resistance and from examination of recovered rock fragments. This method of investigation is quick and relatively inexpensive but provides only an indication of the likely rock strength and predicted values may be in error by a strength order. Where rock strengths may have a significant impact on construction feasibility or costs, then further investigation by means of cored boreholes may be warranted.

Wash Boring: The borehole is usually advanced by a rotary bit, with water being pumped down the drill rods and returned up the annulus, carrying the drill cuttings. Only major changes in stratification can be determined from the cuttings, together with some information from "feel" and rate of penetration.

Mud Stabilised Drilling: Either Wash Boring or Continuous Core Drilling can use drilling mud as a circulating fluid to stabilise the borehole. The term ‘mud’ encompasses a range of products ranging from bentonite to polymers such as Revert or Biogel. The mud tends to mask the cuttings and reliable identification is only possible from intermittent intact sampling (e.g. from SPT and U50 samples) or from rock coring, etc.

Continuous Core Drilling: A continuous core sample is obtained using a diamond tipped core barrel. Provided full core recovery is achieved (which is not always possible in very low strength rocks and granular soils), this technique provides a very reliable (but relatively expensive) method of investigation. In rocks, an NMLC triple tube core barrel, which gives a core of about 50mm diameter, is usually used with water flush. The length of core recovered is compared to the length drilled and any length not recovered is shown as CORE LOSS. The locations of losses are determined on site by the supervising engineer; where the location is uncertain, the loss is placed at the top end of the drill run.

Standard Penetration Tests: Standard Penetration Tests (SPT) are used mainly in non-cohesive soils, but can also be used in cohesive soils as a means of indicating density or strength and also of obtaining a relatively undisturbed sample. The test procedure is described in Australian Standard 1289, “Methods of Testing Soils for Engineering Purposes” – Test F3.1.

The test is carried out in a borehole by driving a 50mm diameter split sample tube with a tapered shoe, under the impact of a 63kg hammer with a free fall of 760mm. It is normal for the tube to be driven in three successive 150mm increments and the ‘N’ value is taken as the number of blows for the last 300mm. In dense sands, very hard clays or weak rock, the full 450mm penetration may not be practicable and the test is discontinued.

The test results are reported in the following form:

- In the case where full penetration is obtained with successive blow counts for each 150mm of, say, 4, 6 and 7 blows, as: $N = 13 (4, 6, 7)$
- In a case where the test is discontinued short of full penetration, say after 15 blows for the first 150mm and 30 blows for the next 40mm, as: $N > 30 (15, 30/40\text{mm})$

The results of the test can be related empirically to the engineering properties of the soil. Occasionally, the drop hammer is used to drive 50mm diameter thin walled sample tubes (U50) in clays. In such circumstances, the test results are shown on the borehole logs in brackets.

A modification to the SPT test is where the same driving system is used with a solid 60 tipped steel cone of the same diameter as the SPT hollow sampler. The solid cone can be continuously driven for some distance in soft clays or loose sands, or may be used where damage would otherwise occur to the SPT. The results of this Solid Cone Penetration Test (SCPT) are shown as “Nc” on the borehole logs, together with the number of blows per 150mm penetration.

LOGS

The borehole or test pit logs presented herein are an interpretation of the subsurface conditions, and their reliability will depend to some extent on the frequency of sampling and the method of drilling or excavation. Ideally, continuous undisturbed sampling or core drilling will enable the most reliable assessment, but is not always practicable or possible to justify on economic grounds. In any case, the boreholes or test pits represent only a very small sample of the total subsurface conditions.

The attached explanatory notes define the terms and symbols used in preparation of the logs.

Interpretation of the information shown on the logs, and its application to design and construction, should therefore take into account the spacing of boreholes or test pits, the method of drilling or excavation, the frequency of sampling and testing and the possibility of other than “straight line”

variations between the boreholes or test pits. Subsurface conditions between boreholes or test pits may vary significantly from conditions encountered at the borehole or test pit locations.

GROUNDWATER

Where groundwater levels are measured in boreholes, there are several potential problems:

- Although groundwater may be present, in low permeability soils it may enter the hole slowly or perhaps not at all during the time it is left open;
- A localised perched water table may lead to an erroneous indication of the true water table;
- Water table levels will vary from time to time with seasons or recent weather changes and may not be the same at the time of construction; and
- The use of water or mud as a drilling fluid will mask any groundwater inflow. Water has to be blown out of the hole and drilling mud must be washed out of the hole or 'reverted' chemically if water observations are to be made.

More reliable measurements can be made by installing standpipes which are read after stabilising at intervals ranging from several days to perhaps weeks for low permeability soils. Piezometers, sealed in a particular stratum, may be advisable in low permeability soils or where there may be interference from perched water tables or surface water.

FILL

The presence of fill materials can often be determined only by the inclusion of foreign objects (e.g. bricks, concrete, plastic, slag/ash, steel etc) or by distinctly unusual colour, texture or fabric. Identification of the extent of fill materials will also depend on investigation methods and frequency. Where natural soils similar to those at the site are used for fill, it may be difficult with limited testing and sampling to reliably determine the extent of the fill.

The presence of fill materials is usually regarded with caution as the possible variation in density, strength and material type is much greater than with natural soil deposits. If the volume and quality of fill is of importance to a project, then frequent test pit excavations are preferable to boreholes


































LABORATORY TESTING

Laboratory testing has not been undertaken to confirm the soil classifications and rocks strengths indicated on the environmental logs unless noted in the report.

SITE ANOMALIES

In the event that conditions encountered on site during construction appear to vary from those which were expected from the information contained in the report, EIS should be notified immediately.


GRAPHIC LOG SYMBOLS FOR SOIL AND ROCKS

SOIL	ROCK	DEFECTS AND INCLUSIONS
 FILL	 CONGLOMERATE	 CLAY SEAM
 TOPSOIL	 SANDSTONE	 SHEARED OR CRUSHED SEAM
 CLAY (CL, CH)	 SHALE	 BRECCIATED OR SHATTERED SEAM/ZONE
 SILT (ML, MH)	 SILTSTONE, MUDSTONE, CLAYSTONE	 IRONSTONE GRAVEL
 SAND (SP, SW)	 LIMESTONE	 ORGANIC MATERIAL
 GRAVEL (GP, GW)	 PHYLLITE, SCHIST	
 SANDY CLAY (CL, CH)	 TUFF	
 SILTY CLAY (CL, CH)	 GRANITE, GABBRO	
 CLAYEY SAND (SC)	 DOLERITE, DIORITE	
 SILTY SAND (SM)	 BASALT, ANDESITE	
 GRAVELLY CLAY (CL, CH)	 QUARTZITE	
 CLAYEY GRAVEL (GC)		
 SANDY SILT (ML)		
 PEAT AND ORGANIC SOILS		
		OTHER MATERIALS
		 CONCRETE
		 BITUMINOUS CONCRETE, COAL
		 COLLUVIUM




Field Identification Procedures (Excluding particles larger than 75 μ m and basing fractions on estimated weights)				Group Symbols	Typical Names	Information Required for Describing Soils	Laboratory Classification Criteria
Coarse-grained soils More than half of material is larger than 75 μ m sieve size ^a (The 75 μ m sieve size is about the smallest particle visible to naked eye)	Gravels More than half of coarse fraction is larger than 4 mm sieve size	Clean gravels (little or no fines)	Wide range in grain size and substantial amounts of all intermediate particle sizes	GW	Well graded gravels, gravel-sand mixtures, little or no fines	<p>Give typical name; indicate approximate percentages of sand and gravel; maximum size; angularity, surface condition, and hardness of the coarse grains; local or geologic name and other pertinent descriptive information; and symbols in parentheses</p> <p>For undisturbed soils add information on stratification, degree of compactness, cementation, moisture conditions and drainage characteristics</p> <p>Example: Silty sand, gravelly; about 20% hard, angular gravel particles 12 mm maximum size; rounded and subangular sand grains coarse to fine, about 15% non-plastic fines with low dry strength; well compacted and moist in place; alluvial sand; (SM)</p>	$C_u = \frac{D_{60}}{D_{10}}$ $C_c = \frac{(D_{30})^2}{D_{10} \times D_{60}}$ <p>Greater than 4 Between 1 and 3</p> <p>Not meeting all gradation requirements for GW</p> <p>Atterberg limits below "A" line, or PI less than 4</p> <p>Atterberg limits above "A" line, with PI greater than 7</p>
			Predominantly one size or a range of sizes with some intermediate sizes missing	GP	Poorly graded gravels, gravel-sand mixtures, little or no fines		
		Gravels with fines (appreciable amount of fines)	Nonplastic fines (for identification procedures see ML below)	GM	Silty gravels, poorly graded gravel-sand-silt mixtures		
	Sands More than half of coarse fraction is smaller than 4 mm sieve size	Clean sands (little or no fines)	Wide range in grain sizes and substantial amounts of all intermediate particle sizes	SW	Well graded sands, gravelly sands, little or no fines		
			Predominantly one size or a range of sizes with some intermediate sizes missing	SP	Poorly graded sands, gravelly sands, little or no fines		
		Sands with fines (appreciable amount of fines)	Nonplastic fines (for identification procedures, see ML below)	SM	Silty sands, poorly graded sand-silt mixtures		
Fine-grained soils More than half of material is smaller than 75 μ m sieve size (The 75 μ m sieve size is about the smallest particle visible to naked eye)	Identification Procedures on Fraction Smaller than 380 μ m Sieve Size			SC	Clayey sands, poorly graded sand-clay mixtures		
	Silt and clays liquid limit less than 50	Dry Strength (crushing characteristics)	Dilatancy (reaction to shaking)	Toughness (consistency near plastic limit)	ML	Inorganic silts and very fine sands, rock flour, silty or clayey fine sands with slight plasticity	<p>Give typical name; indicate degree and character of plasticity, amount and maximum size of coarse grains; colour in wet condition, odour if any, local or geologic name, and other pertinent descriptive information, and symbol in parentheses</p> <p>For undisturbed soils add information on structure, stratification, consistency in undisturbed and remoulded states, moisture and drainage conditions</p> <p>Example: Clayey silt, brown; slightly plastic; small percentage of fine sand; numerous vertical root holes; firm and dry in place; loess; (ML)</p>
			None to slight	Quick to slow	None		
			Medium to high	None to very slow	Medium		
		Silt and clays liquid limit greater than 50	Slight to medium	Slow	Slight	OL	
			Slight to medium	Slow to none	Slight to medium	MH	
			High to very high	None	High	CH	
	Highly Organic Soils	Readily identified by colour, odour, spongy feel and frequently by fibrous texture	Medium to high	None to very slow	Slight to medium	OH	

- Note: 1 Soils possessing characteristics of two groups are designated by combinations of group symbols (eg. GW-GC, well graded gravel-sand mixture with clay fines).
2 Soils with liquid limits of the order of 35 to 50 may be visually classified as being of medium plasticity.

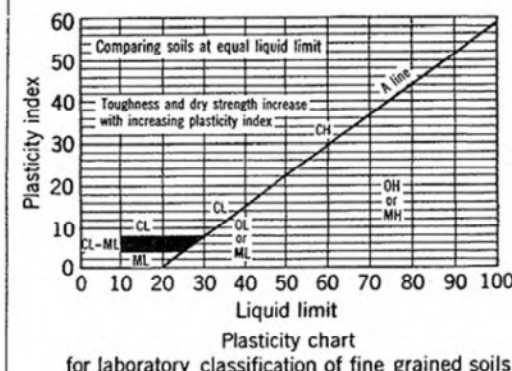Determine percentages of gravel and sand from grain size curve
Depending on percentage of fines (fraction smaller than 75 μ m sieve size) coarse grained soils are classified as follows:
Less than 5% GW, GP, SW, SP
More than 5% GM, GC, SM, SC
Borderline cases requiring use of dual symbols



LOG SYMBOLS

LOG COLUMN	SYMBOL		DEFINITION																	
Groundwater Record			Standing water level. Time delay following completion of drilling may be shown.																	
			Extent of borehole collapse shortly after drilling.																	
			Groundwater seepage into borehole or excavation noted during drilling or excavation.																	
Samples	ES		Soil sample taken over depth indicated, for environmental analysis.																	
	U50		Undisturbed 50mm diameter tube sample taken over depth indicated.																	
	DB		Bulk disturbed sample taken over depth indicated.																	
	DS		Small disturbed bag sample taken over depth indicated.																	
	ASB		Soil sample taken over depth indicated, for asbestos screening.																	
	ASS		Soil sample taken over depth indicated, for acid sulfate soil analysis.																	
	SAL		Soil sample taken over depth indicated, for salinity analysis.																	
Field Tests	N = 17 4, 7, 10		Standard Penetration Test (SPT) performed between depths indicated by lines. Individual show blows per 150mm penetration. 'R' as noted below.																	
	N _c =	5	Solid Cone Penetration Test (SCPT) performed between depths indicated by lines. Individual figures show blows per 150mm penetration for 60 degree solid cone driven by SPT hammer. 'R' refers to apparent hammer refusal within the corresponding 150mm depth increment.																	
		7																		
		3 R																		
VNS = 25 PID = 100		Vane shear reading in kPa of Undrained Shear Strength. Photoionisation detector reading in ppm (Soil sample heads pace test).																		
Moisture (Cohesive Soils) (Cohesionless)	MC > PL MC ≈ PL MC < PL D M W	Moisture content estimated to be greater than plastic limit. Moisture content estimated to be approximately equal to plastic limit. Moisture content estimated to be less than plastic limit. DRY – Runs freely through fingers. MOIST – Does not run freely but no free water visible on soil surface. WET – Free water visible on soil surface.																		
Strength (Consistency) Cohesive Soils	VS S F St VSt H ()	VERY SOFT – Unconfined compressive strength less than 25kPa SOFT – Unconfined compressive strength 25-50kPa FIRM – Unconfined compressive strength 50-100kPa STIFF – Unconfined compressive strength 100- 200kPa VERY STIFF – Unconfined compressive strength 200- 400kPa HARD – Unconfined compressive strength greater than 400kPa Bracketed symbol indicates estimated consistency based on tactile examination or other tests.																		
Density Index/ Relative Density (Cohesionless Soils)	VL L MD D VD ()	<table><tr><th colspan="2">Density Index (ID) Range (%)</th><th>SPT 'N' Value Range (Blows/300mm)</th></tr><tr><td>Very Loose</td><td>< 15</td><td>0-4</td></tr><tr><td>Loose</td><td>15-35</td><td>4-10</td></tr><tr><td>Medium Dense</td><td>35-65</td><td>10-30</td></tr><tr><td>Dense</td><td>65-85</td><td>30-50</td></tr><tr><td>Very Dense</td><td>> 85</td><td>> 50</td></tr></table> Bracketed symbol indicates estimated density based on ease of drilling or other tests.	Density Index (ID) Range (%)		SPT 'N' Value Range (Blows/300mm)	Very Loose	< 15	0-4	Loose	15-35	4-10	Medium Dense	35-65	10-30	Dense	65-85	30-50	Very Dense	> 85	> 50
Density Index (ID) Range (%)		SPT 'N' Value Range (Blows/300mm)																		
Very Loose	< 15	0-4																		
Loose	15-35	4-10																		
Medium Dense	35-65	10-30																		
Dense	65-85	30-50																		
Very Dense	> 85	> 50																		
Hand Penetrometer Readings	300 250	Numbers indicate individual test results in kPa on representative undisturbed material unless noted otherwise																		
Remarks	'V' bit 'TC' bit T ₆₀	Hardened steel 'V' shaped bit. Tungsten carbide wing bit. Penetration of auger string in mm under static load of rig applied by drill head hydraulics without rotation of augers.																		

LOG SYMBOLS CONTINUED

ROCK STRENGTH

Rock strength is defined by the Point Load Strength Index (Is 50) and refers to the strength of the rock substance in the bedding. The test procedure is described by the International Journal of Rock Mechanics, Mining and Geomechanics Abstract Volume 22, No 2, 1985.

TERM	SYMBOL	Is (50) MPa	FIELD GUIDE
Extremely Low:	EL	0.03	Easily remoulded by hand to a material with soil properties.
Very Low:	VL	0.1	May be crumbled in the hand. Sandstone is "sugary" and friable.
Low:	L	0.3	A piece of core 150 mm long x 50mm dia. may be broken by hand and easily scored with a knife. Sharp edges of core may be friable and break during handling.
Medium Strength:	M	1	A piece of core 150 mm long x 50mm dia. can be broken by hand with difficulty. Readily scored with knife.
High:	H	3	A piece of core 150 mm long x 50mm dia. core cannot be broken by hand, can be slightly scratched or scored with knife; rock rings under hammer.
Very High:	VH	10	A piece of core 150 mm long x 50mm dia. may be broken with hand-held pick after more than one blow. Cannot be scratched with pen knife; rock rings under hammer.
Extremely High:	EH		A piece of core 150 mm long x 50mm dia. is very difficult to break with hand-held hammer. Rings when struck with a hammer.

ROCK STRENGTH

ABBREVIATION	DESCRIPTION	NOTES
Be	Bedding Plane Parting	Defect orientations measured relative to the normal to (i.e. relative to horizontal for vertical holes)
CS	Clay Seam	
J	Joint	
P	Planar	
Un	Undulating	
S	Smooth	
R	Rough	
IS	Iron stained	
XWS	Extremely Weathered Seam	
Cr	Crushed Seam	
60t	Thickness of defect in millimetres	

Appendix D: Laboratory Report & COC Documents

SAMPLE RECEIPT ADVICE

Client Details

Client	Environmental Investigation Services
Attention	Rob Muller

Sample Login Details

Your reference	E30807KM, Oxford Falls
Envirolab Reference	176661
Date Sample Received	28/09/2017
Date Instructions Received	28/09/2017
Date Results Expected to be Reported	06/10/2017

Sample Condition

Samples received in appropriate condition for analysis	YES
No. of Samples Provided	15 Soil
Turnaround Time Requested	Standard
Temperature on Receipt (°C)	14.7
Cooling Method	Ice Pack
Sampling Date Provided	YES

Comments

Nil

Please direct any queries to:

Aileen Hie

Phone: 02 9910 6200
Fax: 02 9910 6201
Email: ahie@envirolab.com.au

Jacinta Hurst

Phone: 02 9910 6200
Fax: 02 9910 6201
Email: jhurst@envirolab.com.au

Analysis Underway, details on the following page:



Envirolab Services Pty Ltd

ABN 37 112 535 645

12 Ashley St Chatswood NSW 2067

ph 02 9910 6200 fax 02 9910 6201

customerservice@envirolab.com.au

www.envirolab.com.au

Sample ID	VTRH(C6-C10)/BTEXN in Soil	svTRH (C10-C40) in Soil	PAHs in Soil	Organochlorine Pesticides in soil	Organophosphorus Pesticides	PCBs in Soil	Acid Extractable metals in soil	Asbestos ID - soils
BH1-0.0-0.2	✓	✓	✓	✓	✓	✓	✓	✓
BH1-2.0-5.0	✓	✓	✓				✓	
BH2-0.0-0.2	✓	✓	✓				✓	✓
BH2-0.5-0.95	✓	✓	✓				✓	
BH3-0.0-0.2	✓	✓	✓				✓	✓
BH6-0.0-0.2	✓	✓	✓	✓	✓	✓	✓	✓
BH6-3.0-3.45	✓	✓	✓				✓	
BH9-0.0-0.2	✓	✓	✓	✓	✓	✓	✓	✓
BH11-0.0-0.2	✓	✓	✓	✓	✓	✓	✓	✓
BH12-0.0-0.2	✓	✓	✓				✓	✓
BH13-0.5-0.95	✓	✓	✓				✓	✓
BH16-0.0-0.2	✓	✓	✓				✓	
BH18-0.0-0.2	✓	✓	✓	✓	✓	✓	✓	✓
BH18-1.5-1.95	✓	✓	✓				✓	
BH19-0.0-0.2	✓	✓	✓				✓	✓

The '✓' indicates the testing you have requested. **THIS IS NOT A REPORT OF THE RESULTS.**

Additional Info

Sample storage - Waters are routinely disposed of approximately 1 month and soils approximately 2 months from receipt.

Requests for longer term sample storage must be received in writing.

CERTIFICATE OF ANALYSIS 176661

Client Details

Client	Environmental Investigation Services
Attention	Rob Muller
Address	PO Box 976, North Ryde BC, NSW, 1670

Sample Details

Your Reference	<u>E30807KM, Oxford Falls</u>
Number of Samples	15 Soil
Date samples received	28/09/2017
Date completed instructions received	28/09/2017

Analysis Details

Please refer to the following pages for results, methodology summary and quality control data.

Samples were analysed as received from the client. Results relate specifically to the samples as received.

Results are reported on a dry weight basis for solids and on an as received basis for other matrices.

Report Details

Date results requested by	06/10/2017
Date of Issue	06/10/2017
NATA Accreditation Number 2901. This document shall not be reproduced except in full.	
Accredited for compliance with ISO/IEC 17025 - Testing. Tests not covered by NATA are denoted with *	

Asbestos Approved By

Analysed by Asbestos Approved Identifier: Paul Ching
 Authorised by Asbestos Approved Signatory: Paul Ching

Results Approved By

Dragana Tomas, Senior Chemist
 Long Pham, Team Leader, Metals
 Paul Ching, Senior Analyst
 Steven Luong, Chemist

Authorised By



David Springer, General Manager

vTRH(C6-C10)/BTEXN in Soil

Our Reference		176661-1	176661-2	176661-3	176661-4	176661-5
Your Reference	UNITS	BH1	BH1	BH2	BH2	BH3
Depth		0.0-0.2	2.0-5.0	0.0-0.2	0.5-0.95	0.0-0.2
Date Sampled		25/09/2017	25/09/2017	25/09/2017	25/09/2017	25/09/2017
Type of sample		Soil	Soil	Soil	Soil	Soil
Date extracted	-	29/09/2017	29/09/2017	29/09/2017	29/09/2017	29/09/2017
Date analysed	-	03/10/2017	03/10/2017	03/10/2017	03/10/2017	03/10/2017
TRH C ₆ - C ₉	mg/kg	<25	<25	<25	<25	<25
TRH C ₆ - C ₁₀	mg/kg	<25	<25	<25	<25	<25
vTPH C ₆ - C ₁₀ less BTEX (F1)	mg/kg	<25	<25	<25	<25	<25
Benzene	mg/kg	<0.2	<0.2	<0.2	<0.2	<0.2
Toluene	mg/kg	<0.5	<0.5	<0.5	<0.5	<0.5
Ethylbenzene	mg/kg	<1	<1	<1	<1	<1
m+p-xylene	mg/kg	<2	<2	<2	<2	<2
o-Xylene	mg/kg	<1	<1	<1	<1	<1
Total +ve Xylenes	mg/kg	<1	<1	<1	<1	<1
naphthalene	mg/kg	<1	<1	<1	<1	<1
Surrogate aaa-Trifluorotoluene	%	129	127	127	116	130

vTRH(C6-C10)/BTEXN in Soil

Our Reference		176661-6	176661-7	176661-8	176661-9	176661-10
Your Reference	UNITS	BH6	BH6	BH9	BH11	BH12
Depth		0.0-0.2	3.0-3.45	0.0-0.2	0.0-0.2	0.0-0.2
Date Sampled		25/09/2017	25/09/2017	26/09/2017	26/09/2017	26/09/2017
Type of sample		Soil	Soil	Soil	Soil	Soil
Date extracted	-	29/09/2017	29/09/2017	29/09/2017	29/09/2017	29/09/2017
Date analysed	-	03/10/2017	03/10/2017	03/10/2017	03/10/2017	03/10/2017
TRH C ₆ - C ₉	mg/kg	<25	<25	<25	<25	<25
TRH C ₆ - C ₁₀	mg/kg	<25	<25	<25	<25	<25
vTPH C ₆ - C ₁₀ less BTEX (F1)	mg/kg	<25	<25	<25	<25	<25
Benzene	mg/kg	<0.2	<0.2	<0.2	<0.2	<0.2
Toluene	mg/kg	<0.5	<0.5	<0.5	<0.5	<0.5
Ethylbenzene	mg/kg	<1	<1	<1	<1	<1
m+p-xylene	mg/kg	<2	<2	<2	<2	<2
o-Xylene	mg/kg	<1	<1	<1	<1	<1
Total +ve Xylenes	mg/kg	<1	<1	<1	<1	<1
naphthalene	mg/kg	<1	<1	<1	<1	<1
Surrogate aaa-Trifluorotoluene	%	128	96	112	88	127

vTRH(C6-C10)/BTEXN in Soil

Our Reference		176661-11	176661-12	176661-13	176661-14	176661-15
Your Reference	UNITS	BH13	BH16	BH18	BH18	BH19
Depth		0.5-0.95	0.0-0.2	0.0-0.2	1.5-1.95	0.0-0.2
Date Sampled		26/09/2017	26/09/2017	26/09/2017	26/09/2017	26/09/2017
Type of sample		Soil	Soil	Soil	Soil	Soil
Date extracted	-	29/09/2017	29/09/2017	29/09/2017	29/09/2017	29/09/2017
Date analysed	-	03/10/2017	03/10/2017	03/10/2017	03/10/2017	03/10/2017
TRH C ₆ - C ₉	mg/kg	<25	<25	<25	<25	<25
TRH C ₆ - C ₁₀	mg/kg	<25	<25	<25	<25	<25
vTPH C ₆ - C ₁₀ less BTEX (F1)	mg/kg	<25	<25	<25	<25	<25
Benzene	mg/kg	<0.2	<0.2	<0.2	<0.2	<0.2
Toluene	mg/kg	<0.5	<0.5	<0.5	<0.5	<0.5
Ethylbenzene	mg/kg	<1	<1	<1	<1	<1
m+p-xylene	mg/kg	<2	<2	<2	<2	<2
o-Xylene	mg/kg	<1	<1	<1	<1	<1
Total +ve Xylenes	mg/kg	<1	<1	<1	<1	<1
naphthalene	mg/kg	<1	<1	<1	<1	<1
Surrogate aaa-Trifluorotoluene	%	123	130	105	117	102

svTRH (C10-C40) in Soil

Our Reference		176661-1	176661-2	176661-3	176661-4	176661-5
Your Reference	UNITS	BH1	BH1	BH2	BH2	BH3
Depth		0.0-0.2	2.0-5.0	0.0-0.2	0.5-0.95	0.0-0.2
Date Sampled		25/09/2017	25/09/2017	25/09/2017	25/09/2017	25/09/2017
Type of sample		Soil	Soil	Soil	Soil	Soil
Date extracted	-	29/09/2017	29/09/2017	29/09/2017	29/09/2017	29/09/2017
Date analysed	-	29/09/2017	29/09/2017	30/09/2017	30/09/2017	30/09/2017
TRH C ₁₀ - C ₁₄	mg/kg	<50	<50	<50	<50	<50
TRH C ₁₅ - C ₂₈	mg/kg	<100	<100	<100	<100	<100
TRH C ₂₉ - C ₃₆	mg/kg	<100	<100	<100	<100	<100
TRH >C ₁₀ -C ₁₆	mg/kg	<50	<50	<50	<50	<50
TRH >C ₁₀ - C ₁₆ less Naphthalene (F2)	mg/kg	<50	<50	<50	<50	<50
TRH >C ₁₆ -C ₃₄	mg/kg	<100	<100	<100	<100	<100
TRH >C ₃₄ -C ₄₀	mg/kg	<100	<100	<100	<100	<100
Total +ve TRH (>C10-C40)	mg/kg	<50	<50	<50	<50	<50
Surrogate o-Terphenyl	%	82	80	82	79	81

svTRH (C10-C40) in Soil

Our Reference		176661-6	176661-7	176661-8	176661-9	176661-10
Your Reference	UNITS	BH6	BH6	BH9	BH11	BH12
Depth		0.0-0.2	3.0-3.45	0.0-0.2	0.0-0.2	0.0-0.2
Date Sampled		25/09/2017	25/09/2017	26/09/2017	26/09/2017	26/09/2017
Type of sample		Soil	Soil	Soil	Soil	Soil
Date extracted	-	29/09/2017	29/09/2017	29/09/2017	29/09/2017	29/09/2017
Date analysed	-	30/09/2017	30/09/2017	30/09/2017	30/09/2017	30/09/2017
TRH C ₁₀ - C ₁₄	mg/kg	<50	<50	<50	<50	<50
TRH C ₁₅ - C ₂₈	mg/kg	<100	<100	<100	<100	<100
TRH C ₂₉ - C ₃₆	mg/kg	<100	<100	<100	<100	<100
TRH >C ₁₀ -C ₁₆	mg/kg	<50	<50	<50	<50	<50
TRH >C ₁₀ - C ₁₆ less Naphthalene (F2)	mg/kg	<50	<50	<50	<50	<50
TRH >C ₁₆ -C ₃₄	mg/kg	<100	<100	<100	<100	<100
TRH >C ₃₄ -C ₄₀	mg/kg	<100	<100	<100	<100	<100
Total +ve TRH (>C10-C40)	mg/kg	<50	<50	<50	<50	<50
Surrogate o-Terphenyl	%	82	76	80	84	83

svTRH (C10-C40) in Soil

Our Reference		176661-11	176661-12	176661-13	176661-14	176661-15
Your Reference	UNITS	BH13	BH16	BH18	BH18	BH19
Depth		0.5-0.95	0.0-0.2	0.0-0.2	1.5-1.95	0.0-0.2
Date Sampled		26/09/2017	26/09/2017	26/09/2017	26/09/2017	26/09/2017
Type of sample		Soil	Soil	Soil	Soil	Soil
Date extracted	-	29/09/2017	29/09/2017	29/09/2017	29/09/2017	29/09/2017
Date analysed	-	30/09/2017	30/09/2017	30/09/2017	30/09/2017	30/09/2017
TRH C ₁₀ - C ₁₄	mg/kg	<50	<50	<50	<50	<50
TRH C ₁₅ - C ₂₈	mg/kg	<100	<100	<100	<100	<100
TRH C ₂₉ - C ₃₆	mg/kg	<100	<100	<100	<100	<100
TRH >C ₁₀ -C ₁₆	mg/kg	<50	<50	<50	<50	<50
TRH >C ₁₀ - C ₁₆ less Naphthalene (F2)	mg/kg	<50	<50	<50	<50	<50
TRH >C ₁₆ -C ₃₄	mg/kg	<100	<100	<100	<100	<100
TRH >C ₃₄ -C ₄₀	mg/kg	<100	<100	<100	<100	<100
Total +ve TRH (>C10-C40)	mg/kg	<50	<50	<50	<50	<50
Surrogate o-Terphenyl	%	79	85	85	79	85

PAHs in Soil						
Our Reference		176661-1	176661-2	176661-3	176661-4	176661-5
Your Reference	UNITS	BH1	BH1	BH2	BH2	BH3
Depth		0.0-0.2	2.0-5.0	0.0-0.2	0.5-0.95	0.0-0.2
Date Sampled		25/09/2017	25/09/2017	25/09/2017	25/09/2017	25/09/2017
Type of sample		Soil	Soil	Soil	Soil	Soil
Date extracted	-	27/09/2017	27/09/2017	27/09/2017	27/09/2017	27/09/2017
Date analysed	-	29/09/2017	29/09/2017	29/09/2017	29/09/2017	29/09/2017
Naphthalene	mg/kg	<0.1	<0.1	<0.1	<0.1	<0.1
Acenaphthylene	mg/kg	<0.1	<0.1	<0.1	<0.1	<0.1
Acenaphthene	mg/kg	<0.1	<0.1	<0.1	<0.1	<0.1
Fluorene	mg/kg	<0.1	<0.1	<0.1	<0.1	<0.1
Phenanthrene	mg/kg	<0.1	<0.1	<0.1	<0.1	<0.1
Anthracene	mg/kg	<0.1	<0.1	<0.1	<0.1	<0.1
Fluoranthene	mg/kg	0.1	<0.1	<0.1	0.3	<0.1
Pyrene	mg/kg	0.1	<0.1	0.1	0.3	<0.1
Benzo(a)anthracene	mg/kg	<0.1	<0.1	<0.1	0.2	<0.1
Chrysene	mg/kg	<0.1	<0.1	<0.1	0.2	<0.1
Benzo(b,j+k)fluoranthene	mg/kg	<0.2	<0.2	<0.2	0.3	<0.2
Benzo(a)pyrene	mg/kg	0.06	<0.05	<0.05	0.1	<0.05
Indeno(1,2,3-c,d)pyrene	mg/kg	<0.1	<0.1	<0.1	<0.1	<0.1
Dibenzo(a,h)anthracene	mg/kg	<0.1	<0.1	<0.1	<0.1	<0.1
Benzo(g,h,i)perylene	mg/kg	<0.1	<0.1	<0.1	0.1	<0.1
Benzo(a)pyrene TEQ calc (zero)	mg/kg	<0.5	<0.5	<0.5	<0.5	<0.5
Benzo(a)pyrene TEQ calc(half)	mg/kg	<0.5	<0.5	<0.5	<0.5	<0.5
Benzo(a)pyrene TEQ calc(PQL)	mg/kg	<0.5	<0.5	<0.5	<0.5	<0.5
Total +ve PAH's	mg/kg	0.3	<0.05	0.1	1.4	<0.05
Surrogate <i>p</i> -Terphenyl-d14	%	106	99	98	102	98

PAHs in Soil						
Our Reference		176661-6	176661-7	176661-8	176661-9	176661-10
Your Reference	UNITS	BH6	BH6	BH9	BH11	BH12
Depth		0.0-0.2	3.0-3.45	0.0-0.2	0.0-0.2	0.0-0.2
Date Sampled		25/09/2017	25/09/2017	26/09/2017	26/09/2017	26/09/2017
Type of sample		Soil	Soil	Soil	Soil	Soil
Date extracted	-	27/09/2017	27/09/2017	27/09/2017	27/09/2017	27/09/2017
Date analysed	-	29/09/2017	29/09/2017	29/09/2017	29/09/2017	29/09/2017
Naphthalene	mg/kg	<0.1	<0.1	<0.1	<0.1	<0.1
Acenaphthylene	mg/kg	<0.1	<0.1	<0.1	<0.1	<0.1
Acenaphthene	mg/kg	<0.1	<0.1	<0.1	<0.1	<0.1
Fluorene	mg/kg	<0.1	<0.1	<0.1	<0.1	<0.1
Phenanthrene	mg/kg	<0.1	<0.1	<0.1	<0.1	<0.1
Anthracene	mg/kg	<0.1	<0.1	<0.1	<0.1	<0.1
Fluoranthene	mg/kg	<0.1	<0.1	<0.1	0.1	<0.1
Pyrene	mg/kg	<0.1	<0.1	0.1	0.1	<0.1
Benzo(a)anthracene	mg/kg	<0.1	<0.1	<0.1	<0.1	<0.1
Chrysene	mg/kg	<0.1	<0.1	<0.1	<0.1	<0.1
Benzo(b,j+k)fluoranthene	mg/kg	<0.2	<0.2	<0.2	<0.2	<0.2
Benzo(a)pyrene	mg/kg	<0.05	<0.05	<0.05	0.06	<0.05
Indeno(1,2,3-c,d)pyrene	mg/kg	<0.1	<0.1	<0.1	<0.1	<0.1
Dibenzo(a,h)anthracene	mg/kg	<0.1	<0.1	<0.1	<0.1	<0.1
Benzo(g,h,i)perylene	mg/kg	<0.1	<0.1	<0.1	0.1	<0.1
Benzo(a)pyrene TEQ calc (zero)	mg/kg	<0.5	<0.5	<0.5	<0.5	<0.5
Benzo(a)pyrene TEQ calc(half)	mg/kg	<0.5	<0.5	<0.5	<0.5	<0.5
Benzo(a)pyrene TEQ calc(PQL)	mg/kg	<0.5	<0.5	<0.5	<0.5	<0.5
Total +ve PAH's	mg/kg	<0.05	<0.05	0.1	0.4	<0.05
Surrogate p-Terphenyl-d14	%	101	105	101	103	101

PAHs in Soil						
Our Reference		176661-11	176661-12	176661-13	176661-14	176661-15
Your Reference	UNITS	BH13	BH16	BH18	BH18	BH19
Depth		0.5-0.95	0.0-0.2	0.0-0.2	1.5-1.95	0.0-0.2
Date Sampled		26/09/2017	26/09/2017	26/09/2017	26/09/2017	26/09/2017
Type of sample		Soil	Soil	Soil	Soil	Soil
Date extracted	-	27/09/2017	27/09/2017	27/09/2017	27/09/2017	27/09/2017
Date analysed	-	29/09/2017	29/09/2017	29/09/2017	29/09/2017	29/09/2017
Naphthalene	mg/kg	<0.1	<0.1	<0.1	<0.1	<0.1
Acenaphthylene	mg/kg	<0.1	<0.1	<0.1	<0.1	<0.1
Acenaphthene	mg/kg	<0.1	<0.1	<0.1	<0.1	<0.1
Fluorene	mg/kg	<0.1	<0.1	<0.1	<0.1	<0.1
Phenanthrene	mg/kg	<0.1	<0.1	<0.1	<0.1	<0.1
Anthracene	mg/kg	<0.1	<0.1	<0.1	<0.1	<0.1
Fluoranthene	mg/kg	<0.1	<0.1	<0.1	<0.1	<0.1
Pyrene	mg/kg	<0.1	<0.1	<0.1	<0.1	<0.1
Benzo(a)anthracene	mg/kg	<0.1	<0.1	<0.1	<0.1	<0.1
Chrysene	mg/kg	<0.1	<0.1	<0.1	<0.1	<0.1
Benzo(b,j+k)fluoranthene	mg/kg	<0.2	<0.2	<0.2	<0.2	<0.2
Benzo(a)pyrene	mg/kg	<0.05	<0.05	<0.05	<0.05	<0.05
Indeno(1,2,3-c,d)pyrene	mg/kg	<0.1	<0.1	<0.1	<0.1	<0.1
Dibenzo(a,h)anthracene	mg/kg	<0.1	<0.1	<0.1	<0.1	<0.1
Benzo(g,h,i)perylene	mg/kg	<0.1	<0.1	<0.1	<0.1	<0.1
Benzo(a)pyrene TEQ calc (zero)	mg/kg	<0.5	<0.5	<0.5	<0.5	<0.5
Benzo(a)pyrene TEQ calc(half)	mg/kg	<0.5	<0.5	<0.5	<0.5	<0.5
Benzo(a)pyrene TEQ calc(PQL)	mg/kg	<0.5	<0.5	<0.5	<0.5	<0.5
Total +ve PAH's	mg/kg	<0.05	<0.05	<0.05	<0.05	<0.05
Surrogate p-Terphenyl-d14	%	97	107	103	105	105

Organochlorine Pesticides in soil						
Our Reference		176661-1	176661-6	176661-8	176661-9	176661-13
Your Reference	UNITS	BH1	BH6	BH9	BH11	BH18
Depth		0.0-0.2	0.0-0.2	0.0-0.2	0.0-0.2	0.0-0.2
Date Sampled		25/09/2017	25/09/2017	26/09/2017	26/09/2017	26/09/2017
Type of sample		Soil	Soil	Soil	Soil	Soil
Date extracted	-	29/09/2017	29/09/2017	29/09/2017	29/09/2017	29/09/2017
Date analysed	-	29/09/2017	29/09/2017	29/09/2017	29/09/2017	29/09/2017
HCB	mg/kg	<0.1	<0.1	<0.1	<0.1	<0.1
alpha-BHC	mg/kg	<0.1	<0.1	<0.1	<0.1	<0.1
gamma-BHC	mg/kg	<0.1	<0.1	<0.1	<0.1	<0.1
beta-BHC	mg/kg	<0.1	<0.1	<0.1	<0.1	<0.1
Heptachlor	mg/kg	<0.1	<0.1	<0.1	<0.1	<0.1
delta-BHC	mg/kg	<0.1	<0.1	<0.1	<0.1	<0.1
Aldrin	mg/kg	<0.1	<0.1	<0.1	<0.1	<0.1
Heptachlor Epoxide	mg/kg	<0.1	<0.1	<0.1	<0.1	<0.1
gamma-Chlordane	mg/kg	<0.1	<0.1	<0.1	<0.1	<0.1
alpha-chlordane	mg/kg	<0.1	<0.1	<0.1	<0.1	<0.1
Endosulfan I	mg/kg	<0.1	<0.1	<0.1	<0.1	<0.1
pp-DDE	mg/kg	<0.1	<0.1	<0.1	<0.1	<0.1
Dieldrin	mg/kg	<0.1	<0.1	<0.1	<0.1	<0.1
Endrin	mg/kg	<0.1	<0.1	<0.1	<0.1	<0.1
pp-DDD	mg/kg	<0.1	<0.1	<0.1	<0.1	<0.1
Endosulfan II	mg/kg	<0.1	<0.1	<0.1	<0.1	<0.1
pp-DDT	mg/kg	<0.1	<0.1	<0.1	<0.1	<0.1
Endrin Aldehyde	mg/kg	<0.1	<0.1	<0.1	<0.1	<0.1
Endosulfan Sulphate	mg/kg	<0.1	<0.1	<0.1	<0.1	<0.1
Methoxychlor	mg/kg	<0.1	<0.1	<0.1	<0.1	<0.1
Total +ve DDT+DDD+DDE	mg/kg	<0.1	<0.1	<0.1	<0.1	<0.1
Surrogate TCMX	%	80	78	86	80	90

Organophosphorus Pesticides

Our Reference		176661-1	176661-6	176661-8	176661-9	176661-13
Your Reference	UNITS	BH1	BH6	BH9	BH11	BH18
Depth		0.0-0.2	0.0-0.2	0.0-0.2	0.0-0.2	0.0-0.2
Date Sampled		25/09/2017	25/09/2017	26/09/2017	26/09/2017	26/09/2017
Type of sample		Soil	Soil	Soil	Soil	Soil
Date extracted	-	29/09/2017	29/09/2017	29/09/2017	29/09/2017	29/09/2017
Date analysed	-	29/09/2017	29/09/2017	29/09/2017	29/09/2017	29/09/2017
Azinphos-methyl (Guthion)	mg/kg	<0.1	<0.1	<0.1	<0.1	<0.1
Bromophos-ethyl	mg/kg	<0.1	<0.1	<0.1	<0.1	<0.1
Chlorpyrifos	mg/kg	<0.1	<0.1	<0.1	<0.1	<0.1
Chlorpyrifos-methyl	mg/kg	<0.1	<0.1	<0.1	<0.1	<0.1
Diazinon	mg/kg	<0.1	<0.1	<0.1	<0.1	<0.1
Dichlorvos	mg/kg	<0.1	<0.1	<0.1	<0.1	<0.1
Dimethoate	mg/kg	<0.1	<0.1	<0.1	<0.1	<0.1
Ethion	mg/kg	<0.1	<0.1	<0.1	<0.1	<0.1
Fenitrothion	mg/kg	<0.1	<0.1	<0.1	<0.1	<0.1
Malathion	mg/kg	<0.1	<0.1	<0.1	<0.1	<0.1
Parathion	mg/kg	<0.1	<0.1	<0.1	<0.1	<0.1
Ronnel	mg/kg	<0.1	<0.1	<0.1	<0.1	<0.1
Surrogate TCMX	%	80	78	86	80	90

PCBs in Soil						
Our Reference		176661-1	176661-6	176661-8	176661-9	176661-13
Your Reference	UNITS	BH1	BH6	BH9	BH11	BH18
Depth		0.0-0.2	0.0-0.2	0.0-0.2	0.0-0.2	0.0-0.2
Date Sampled		25/09/2017	25/09/2017	26/09/2017	26/09/2017	26/09/2017
Type of sample		Soil	Soil	Soil	Soil	Soil
Date extracted	-	29/09/2017	29/09/2017	29/09/2017	29/09/2017	29/09/2017
Date analysed	-	29/09/2017	29/09/2017	29/09/2017	29/09/2017	29/09/2017
Aroclor 1016	mg/kg	<0.1	<0.1	<0.1	<0.1	<0.1
Aroclor 1221	mg/kg	<0.1	<0.1	<0.1	<0.1	<0.1
Aroclor 1232	mg/kg	<0.1	<0.1	<0.1	<0.1	<0.1
Aroclor 1242	mg/kg	<0.1	<0.1	<0.1	<0.1	<0.1
Aroclor 1248	mg/kg	<0.1	<0.1	<0.1	<0.1	<0.1
Aroclor 1254	mg/kg	<0.1	<0.1	<0.1	<0.1	<0.1
Aroclor 1260	mg/kg	<0.1	<0.1	<0.1	<0.1	<0.1
Total +ve PCBs (1016-1260)	mg/kg	<0.1	<0.1	<0.1	<0.1	<0.1
Surrogate TCLMX	%	80	78	86	80	90

Acid Extractable metals in soil

Our Reference		176661-1	176661-2	176661-3	176661-4	176661-5
Your Reference	UNITS	BH1	BH1	BH2	BH2	BH3
Depth		0.0-0.2	2.0-5.0	0.0-0.2	0.5-0.95	0.0-0.2
Date Sampled		25/09/2017	25/09/2017	25/09/2017	25/09/2017	25/09/2017
Type of sample		Soil	Soil	Soil	Soil	Soil
Date prepared	-	29/09/2017	29/09/2017	29/09/2017	29/09/2017	29/09/2017
Date analysed	-	03/10/2017	03/10/2017	03/10/2017	03/10/2017	03/10/2017
Arsenic	mg/kg	6	<4	5	5	<4
Cadmium	mg/kg	<0.4	<0.4	<0.4	<0.4	<0.4
Chromium	mg/kg	9	8	7	16	7
Copper	mg/kg	10	1	18	15	6
Lead	mg/kg	34	9	23	73	12
Mercury	mg/kg	<0.1	<0.1	<0.1	<0.1	<0.1
Nickel	mg/kg	3	2	2	2	2
Zinc	mg/kg	79	13	51	63	31

Acid Extractable metals in soil

Our Reference		176661-6	176661-7	176661-8	176661-9	176661-10
Your Reference	UNITS	BH6	BH6	BH9	BH11	BH12
Depth		0.0-0.2	3.0-3.45	0.0-0.2	0.0-0.2	0.0-0.2
Date Sampled		25/09/2017	25/09/2017	26/09/2017	26/09/2017	26/09/2017
Type of sample		Soil	Soil	Soil	Soil	Soil
Date prepared	-	29/09/2017	29/09/2017	29/09/2017	29/09/2017	29/09/2017
Date analysed	-	03/10/2017	03/10/2017	03/10/2017	03/10/2017	03/10/2017
Arsenic	mg/kg	<4	<4	8	<4	5
Cadmium	mg/kg	<0.4	<0.4	<0.4	<0.4	<0.4
Chromium	mg/kg	13	7	13	9	7
Copper	mg/kg	5	13	29	12	10
Lead	mg/kg	13	21	56	25	15
Mercury	mg/kg	<0.1	<0.1	<0.1	<0.1	<0.1
Nickel	mg/kg	1	2	4	7	2
Zinc	mg/kg	39	100	200	45	42

Acid Extractable metals in soil

Our Reference		176661-11	176661-12	176661-13	176661-14	176661-15
Your Reference	UNITS	BH13	BH16	BH18	BH18	BH19
Depth		0.5-0.95	0.0-0.2	0.0-0.2	1.5-1.95	0.0-0.2
Date Sampled		26/09/2017	26/09/2017	26/09/2017	26/09/2017	26/09/2017
Type of sample		Soil	Soil	Soil	Soil	Soil
Date prepared	-	29/09/2017	29/09/2017	29/09/2017	29/09/2017	29/09/2017
Date analysed	-	03/10/2017	03/10/2017	03/10/2017	03/10/2017	03/10/2017
Arsenic	mg/kg	<4	6	<4	<4	<4
Cadmium	mg/kg	<0.4	<0.4	<0.4	<0.4	<0.4
Chromium	mg/kg	16	12	6	19	7
Copper	mg/kg	2	31	13	3	10
Lead	mg/kg	9	36	13	8	18
Mercury	mg/kg	<0.1	<0.1	<0.1	<0.1	<0.1
Nickel	mg/kg	2	4	3	2	3
Zinc	mg/kg	21	160	48	220	49

Moisture						
Our Reference	UNITS	176661-1	176661-2	176661-3	176661-4	176661-5
Your Reference		BH1	BH1	BH2	BH2	BH3
Depth		0.0-0.2	2.0-5.0	0.0-0.2	0.5-0.95	0.0-0.2
Date Sampled		25/09/2017	25/09/2017	25/09/2017	25/09/2017	25/09/2017
Type of sample		Soil	Soil	Soil	Soil	Soil
Date prepared	-	29/09/2017	29/09/2017	29/09/2017	29/09/2017	29/09/2017
Date analysed	-	03/10/2017	03/10/2017	03/10/2017	03/10/2017	03/10/2017
Moisture	%	6.9	13	6.4	9.5	7.9

Moisture						
Our Reference	UNITS	176661-6	176661-7	176661-8	176661-9	176661-10
Your Reference		BH6	BH6	BH9	BH11	BH12
Depth		0.0-0.2	3.0-3.45	0.0-0.2	0.0-0.2	0.0-0.2
Date Sampled		25/09/2017	25/09/2017	26/09/2017	26/09/2017	26/09/2017
Type of sample		Soil	Soil	Soil	Soil	Soil
Date prepared	-	29/09/2017	29/09/2017	29/09/2017	29/09/2017	29/09/2017
Date analysed	-	03/10/2017	03/10/2017	03/10/2017	03/10/2017	03/10/2017
Moisture	%	6.1	15	9.6	4.1	6.7

Moisture						
Our Reference	UNITS	176661-11	176661-12	176661-13	176661-14	176661-15
Your Reference		BH13	BH16	BH18	BH18	BH19
Depth		0.5-0.95	0.0-0.2	0.0-0.2	1.5-1.95	0.0-0.2
Date Sampled		26/09/2017	26/09/2017	26/09/2017	26/09/2017	26/09/2017
Type of sample		Soil	Soil	Soil	Soil	Soil
Date prepared	-	29/09/2017	29/09/2017	29/09/2017	29/09/2017	29/09/2017
Date analysed	-	03/10/2017	03/10/2017	03/10/2017	03/10/2017	03/10/2017
Moisture	%	11	2.2	0.8	20	1.2

Asbestos ID - soils						
Our Reference	UNITS	176661-1	176661-3	176661-5	176661-6	176661-8
Your Reference		BH1	BH2	BH3	BH6	BH9
Depth		0.0-0.2	0.0-0.2	0.0-0.2	0.0-0.2	0.0-0.2
Date Sampled		25/09/2017	25/09/2017	25/09/2017	25/09/2017	26/09/2017
Type of sample		Soil	Soil	Soil	Soil	Soil
Date analysed	-	6/10/2017	6/10/2017	6/10/2017	6/10/2017	6/10/2017
Sample mass tested	g	Approx. 15g	Approx. 15g	Approx. 25g	Approx. 25g	Approx. 50g
Sample Description	-	Brown coarse-grained soil & rocks	Brown coarse-grained soil & rocks	Brown coarse-grained soil & rocks	Brown coarse-grained soil & rocks	Brown coarse-grained soil & rocks
Asbestos ID in soil	-	No asbestos detected at reporting limit of 0.1g/kg Organic fibre detected	No asbestos detected at reporting limit of 0.1g/kg Organic fibre detected	No asbestos detected at reporting limit of 0.1g/kg Organic fibre detected	No asbestos detected at reporting limit of 0.1g/kg Organic fibre detected	No asbestos detected at reporting limit of 0.1g/kg Organic fibre detected
Trace Analysis	-	No asbestos detected	No asbestos detected	No asbestos detected	No asbestos detected	No asbestos detected

Asbestos ID - soils						
Our Reference	UNITS	176661-9	176661-10	176661-11	176661-13	176661-15
Your Reference		BH11	BH12	BH13	BH18	BH19
Depth		0.0-0.2	0.0-0.2	0.5-0.95	0.0-0.2	0.0-0.2
Date Sampled		26/09/2017	26/09/2017	26/09/2017	26/09/2017	26/09/2017
Type of sample		Soil	Soil	Soil	Soil	Soil
Date analysed	-	6/10/2017	6/10/2017	6/10/2017	6/10/2017	6/10/2017
Sample mass tested	g	Approx. 25g	Approx. 15g	Approx. 15g	Approx. 40g	Approx. 25g
Sample Description	-	Brown sandy soil	Brown sandy soil	Brown coarse-grained soil & rocks	Brown sandy soil	Brown coarse-grained soil & rocks
Asbestos ID in soil	-	No asbestos detected at reporting limit of 0.1g/kg Organic fibre detected	No asbestos detected at reporting limit of 0.1g/kg Organic fibre detected	No asbestos detected at reporting limit of 0.1g/kg Organic fibre detected	No asbestos detected at reporting limit of 0.1g/kg Organic fibre detected	No asbestos detected at reporting limit of 0.1g/kg Organic fibre detected
Trace Analysis	-	No asbestos detected	No asbestos detected	No asbestos detected	No asbestos detected	No asbestos detected

Method ID	Methodology Summary
ASB-001	Asbestos ID - Qualitative identification of asbestos in bulk samples using Polarised Light Microscopy and Dispersion Staining Techniques including Synthetic Mineral Fibre and Organic Fibre as per Australian Standard 4964-2004.
Inorg-008	Moisture content determined by heating at 105+/-5 °C for a minimum of 12 hours.
Metals-020	Determination of various metals by ICP-AES.
Metals-021	Determination of Mercury by Cold Vapour AAS.
Org-003	Soil samples are extracted with Dichloromethane/Acetone and waters with Dichloromethane and analysed by GC-FID. F2 = (>C10-C16)-Naphthalene as per NEPM B1 Guideline on Investigation Levels for Soil and Groundwater (HSLs Tables 1A (3, 4)). Note Naphthalene is determined from the VOC analysis.
Org-003	Soil samples are extracted with Dichloromethane/Acetone and waters with Dichloromethane and analysed by GC-FID. F2 = (>C10-C16)-Naphthalene as per NEPM B1 Guideline on Investigation Levels for Soil and Groundwater (HSLs Tables 1A (3, 4)). Note Naphthalene is determined from the VOC analysis. Note, the Total +ve TRH PQL is reflective of the lowest individual PQL and is therefore "Total +ve TRH" is simply a sum of the positive individual TRH fractions (>C10-C40).
Org-005	Soil samples are extracted with dichloromethane/acetone and waters with dichloromethane and analysed by GC with dual ECD's.
Org-005	Soil samples are extracted with dichloromethane/acetone and waters with dichloromethane and analysed by GC with dual ECD's. Note, the Total +ve reported DDD+DDE+DDT PQL is reflective of the lowest individual PQL and is therefore simply a sum of the positive individually report DDD+DDE+DDT.
Org-006	Soil samples are extracted with dichloromethane/acetone and waters with dichloromethane and analysed by GC-ECD.
Org-006	Soil samples are extracted with dichloromethane/acetone and waters with dichloromethane and analysed by GC-ECD. Note, the Total +ve PCBs PQL is reflective of the lowest individual PQL and is therefore "Total +ve PCBs" is simply a sum of the positive individual PCBs.
Org-008	Soil samples are extracted with dichloromethane/acetone and waters with dichloromethane and analysed by GC with dual ECD's.

Method ID	Methodology Summary
Org-012	<p>Soil samples are extracted with Dichloromethane/Acetone and waters with Dichloromethane and analysed by GC-MS. Benzo(a)pyrene TEQ as per NEPM B1 Guideline on Investigation Levels for Soil and Groundwater - 2013.</p> <p>For soil results:-</p> <ol style="list-style-type: none"> 1. 'EQ PQL' values are assuming all contributing PAHs reported as <PQL are actually at the PQL. This is the most conservative approach and can give false positive TEQs given that PAHs that contribute to the TEQ calculation may not be present. 2. 'EQ zero' values are assuming all contributing PAHs reported as <PQL are zero. This is the least conservative approach and is more susceptible to false negative TEQs when PAHs that contribute to the TEQ calculation are present but below PQL. 3. 'EQ half PQL' values are assuming all contributing PAHs reported as <PQL are half the stipulated PQL. Hence a mid-point between the most and least conservative approaches above. <p>Note, the Total +ve PAHs PQL is reflective of the lowest individual PQL and is therefore "Total +ve PAHs" is simply a sum of the positive individual PAHs.</p>
Org-014	Soil samples are extracted with methanol and spiked into water prior to analysing by purge and trap GC-MS.
Org-016	Soil samples are extracted with methanol and spiked into water prior to analysing by purge and trap GC-MS. Water samples are analysed directly by purge and trap GC-MS. F1 = (C6-C10)-BTX as per NEPM B1 Guideline on Investigation Levels for Soil and Groundwater.
Org-016	<p>Soil samples are extracted with methanol and spiked into water prior to analysing by purge and trap GC-MS. Water samples are analysed directly by purge and trap GC-MS. F1 = (C6-C10)-BTX as per NEPM B1 Guideline on Investigation Levels for Soil and Groundwater.</p> <p>Note, the Total +ve Xylene PQL is reflective of the lowest individual PQL and is therefore "Total +ve Xylenes" is simply a sum of the positive individual Xylenes.</p>

QUALITY CONTROL: vTRH(C6-C10)/BTEXN in Soil						Duplicate			Spike Recovery %	
Test Description	Units	PQL	Method	Blank	#	Base	Dup.	RPD	LCS-1	176661-6
Date extracted	-			29/09/2017	1	29/09/2017	29/09/2017		29/09/2017	29/09/2017
Date analysed	-			03/10/2017	1	03/10/2017	03/10/2017		03/10/2017	03/10/2017
TRH C ₆ - C ₉	mg/kg	25	Org-016	<25	1	<25	<25	0	115	90
TRH C ₆ - C ₁₀	mg/kg	25	Org-016	<25	1	<25	<25	0	115	90
Benzene	mg/kg	0.2	Org-016	<0.2	1	<0.2	<0.2	0	97	84
Toluene	mg/kg	0.5	Org-016	<0.5	1	<0.5	<0.5	0	107	90
Ethylbenzene	mg/kg	1	Org-016	<1	1	<1	<1	0	123	93
m+p-xylene	mg/kg	2	Org-016	<2	1	<2	<2	0	123	92
o-Xylene	mg/kg	1	Org-016	<1	1	<1	<1	0	121	94
naphthalene	mg/kg	1	Org-014	<1	1	<1	<1	0	[NT]	[NT]
Surrogate aaa-Trifluorotoluene	%		Org-016	124	1	129	125	3	129	99

QUALITY CONTROL: vTRH(C6-C10)/BTEXN in Soil						Duplicate		Spike Recovery %		
Test Description	Units	PQL	Method	Blank	#	Base	Dup.	RPD	[NT]	[NT]
Date extracted	-			[NT]	13	29/09/2017	29/09/2017		[NT]	[NT]
Date analysed	-			[NT]	13	03/10/2017	03/10/2017		[NT]	[NT]
TRH C ₆ - C ₉	mg/kg	25	Org-016	[NT]	13	<25	<25	0	[NT]	[NT]
TRH C ₆ - C ₁₀	mg/kg	25	Org-016	[NT]	13	<25	<25	0	[NT]	[NT]
Benzene	mg/kg	0.2	Org-016	[NT]	13	<0.2	<0.2	0	[NT]	[NT]
Toluene	mg/kg	0.5	Org-016	[NT]	13	<0.5	<0.5	0	[NT]	[NT]
Ethylbenzene	mg/kg	1	Org-016	[NT]	13	<1	<1	0	[NT]	[NT]
m+p-xylene	mg/kg	2	Org-016	[NT]	13	<2	<2	0	[NT]	[NT]
o-Xylene	mg/kg	1	Org-016	[NT]	13	<1	<1	0	[NT]	[NT]
naphthalene	mg/kg	1	Org-014	[NT]	13	<1	<1	0	[NT]	[NT]
Surrogate aaa-Trifluorotoluene	%		Org-016	[NT]	13	105	128	20	[NT]	[NT]

QUALITY CONTROL: svTRH (C10-C40) in Soil					Duplicate			Spike Recovery %		
Test Description	Units	PQL	Method	Blank	#	Base	Dup.	RPD	LCS-1	176661-6
Date extracted	-			29/09/2017	1	29/09/2017	29/09/2017		29/09/2017	29/09/2017
Date analysed	-			29/09/2017	1	29/09/2017	29/09/2017		29/09/2017	30/09/2017
TRH C ₁₀ - C ₁₄	mg/kg	50	Org-003	<50	1	<50	<50	0	111	112
TRH C ₁₅ - C ₂₈	mg/kg	100	Org-003	<100	1	<100	<100	0	109	112
TRH C ₂₉ - C ₃₆	mg/kg	100	Org-003	<100	1	<100	<100	0	106	82
TRH >C ₁₀ -C ₁₆	mg/kg	50	Org-003	<50	1	<50	<50	0	111	112
TRH >C ₁₆ -C ₃₄	mg/kg	100	Org-003	<100	1	<100	<100	0	109	112
TRH >C ₃₄ -C ₄₀	mg/kg	100	Org-003	<100	1	<100	<100	0	106	82
Surrogate o-Terphenyl	%		Org-003	83	1	82	83	1	95	82

QUALITY CONTROL: svTRH (C10-C40) in Soil					Duplicate			Spike Recovery %		
Test Description	Units	PQL	Method	Blank	#	Base	Dup.	RPD	[NT]	[NT]
Date extracted	-			[NT]	13	29/09/2017	29/09/2017		[NT]	[NT]
Date analysed	-			[NT]	13	30/09/2017	30/09/2017		[NT]	[NT]
TRH C ₁₀ - C ₁₄	mg/kg	50	Org-003	[NT]	13	<50	<50	0	[NT]	[NT]
TRH C ₁₅ - C ₂₈	mg/kg	100	Org-003	[NT]	13	<100	<100	0	[NT]	[NT]
TRH C ₂₉ - C ₃₆	mg/kg	100	Org-003	[NT]	13	<100	<100	0	[NT]	[NT]
TRH >C ₁₀ -C ₁₆	mg/kg	50	Org-003	[NT]	13	<50	<50	0	[NT]	[NT]
TRH >C ₁₆ -C ₃₄	mg/kg	100	Org-003	[NT]	13	<100	<100	0	[NT]	[NT]
TRH >C ₃₄ -C ₄₀	mg/kg	100	Org-003	[NT]	13	<100	<100	0	[NT]	[NT]
Surrogate o-Terphenyl	%		Org-003	[NT]	13	85	83	2	[NT]	[NT]

QUALITY CONTROL: PAHs in Soil					Duplicate			Spike Recovery %		
Test Description	Units	PQL	Method	Blank	#	Base	Dup.	RPD	LCS-1	176661-6
Date extracted	-			27/09/2017	1	27/09/2017	27/09/2017		27/09/2017	27/09/2017
Date analysed	-			29/09/2017	1	29/09/2017	29/09/2017		29/09/2017	29/09/2017
Naphthalene	mg/kg	0.1	Org-012	<0.1	1	<0.1	<0.1	0	89	92
Acenaphthylene	mg/kg	0.1	Org-012	<0.1	1	<0.1	<0.1	0	[NT]	[NT]
Acenaphthene	mg/kg	0.1	Org-012	<0.1	1	<0.1	<0.1	0	[NT]	[NT]
Fluorene	mg/kg	0.1	Org-012	<0.1	1	<0.1	<0.1	0	97	96
Phenanthrene	mg/kg	0.1	Org-012	<0.1	1	<0.1	<0.1	0	101	101
Anthracene	mg/kg	0.1	Org-012	<0.1	1	<0.1	<0.1	0	[NT]	[NT]
Fluoranthene	mg/kg	0.1	Org-012	<0.1	1	0.1	<0.1	0	96	97
Pyrene	mg/kg	0.1	Org-012	<0.1	1	0.1	<0.1	0	93	93
Benzo(a)anthracene	mg/kg	0.1	Org-012	<0.1	1	<0.1	<0.1	0	[NT]	[NT]
Chrysene	mg/kg	0.1	Org-012	<0.1	1	<0.1	<0.1	0	93	91
Benzo(b,j,k)fluoranthene	mg/kg	0.2	Org-012	<0.2	1	<0.2	<0.2	0	[NT]	[NT]
Benzo(a)pyrene	mg/kg	0.05	Org-012	<0.05	1	0.06	<0.05	18	[NT]	[NT]
Indeno(1,2,3-c,d)pyrene	mg/kg	0.1	Org-012	<0.1	1	<0.1	<0.1	0	[NT]	[NT]
Dibenzo(a,h)anthracene	mg/kg	0.1	Org-012	<0.1	1	<0.1	<0.1	0	[NT]	[NT]
Benzo(g,h,i)perylene	mg/kg	0.1	Org-012	<0.1	1	<0.1	<0.1	0	[NT]	[NT]
Surrogate p-Terphenyl-d14	%		Org-012	108	1	106	103	3	112	111

QUALITY CONTROL: PAHs in Soil					Duplicate			Spike Recovery %		
Test Description	Units	PQL	Method	Blank	#	Base	Dup.	RPD	[NT]	[NT]
Date extracted	-			[NT]	13	27/09/2017	27/09/2017		[NT]	[NT]
Date analysed	-			[NT]	13	29/09/2017	29/09/2017		[NT]	[NT]
Naphthalene	mg/kg	0.1	Org-012	[NT]	13	<0.1	<0.1	0	[NT]	[NT]
Acenaphthylene	mg/kg	0.1	Org-012	[NT]	13	<0.1	<0.1	0	[NT]	[NT]
Acenaphthene	mg/kg	0.1	Org-012	[NT]	13	<0.1	<0.1	0	[NT]	[NT]
Fluorene	mg/kg	0.1	Org-012	[NT]	13	<0.1	<0.1	0	[NT]	[NT]
Phenanthrene	mg/kg	0.1	Org-012	[NT]	13	<0.1	<0.1	0	[NT]	[NT]
Anthracene	mg/kg	0.1	Org-012	[NT]	13	<0.1	<0.1	0	[NT]	[NT]
Fluoranthene	mg/kg	0.1	Org-012	[NT]	13	<0.1	<0.1	0	[NT]	[NT]
Pyrene	mg/kg	0.1	Org-012	[NT]	13	<0.1	<0.1	0	[NT]	[NT]
Benzo(a)anthracene	mg/kg	0.1	Org-012	[NT]	13	<0.1	<0.1	0	[NT]	[NT]
Chrysene	mg/kg	0.1	Org-012	[NT]	13	<0.1	<0.1	0	[NT]	[NT]
Benzo(b,j,k)fluoranthene	mg/kg	0.2	Org-012	[NT]	13	<0.2	<0.2	0	[NT]	[NT]
Benzo(a)pyrene	mg/kg	0.05	Org-012	[NT]	13	<0.05	<0.05	0	[NT]	[NT]
Indeno(1,2,3-c,d)pyrene	mg/kg	0.1	Org-012	[NT]	13	<0.1	<0.1	0	[NT]	[NT]
Dibenzo(a,h)anthracene	mg/kg	0.1	Org-012	[NT]	13	<0.1	<0.1	0	[NT]	[NT]
Benzo(g,h,i)perylene	mg/kg	0.1	Org-012	[NT]	13	<0.1	<0.1	0	[NT]	[NT]
Surrogate p-Terphenyl-d14	%		Org-012	[NT]	13	103	102	1	[NT]	[NT]

QUALITY CONTROL: Organochlorine Pesticides in soil					Duplicate			Spike Recovery %		
Test Description	Units	PQL	Method	Blank	#	Base	Dup.	RPD	LCS-1	176661-6
Date extracted	-			29/09/2017	1	29/09/2017	29/09/2017		29/09/2017	29/09/2017
Date analysed	-			29/09/2017	1	29/09/2017	29/09/2017		29/09/2017	29/09/2017
HCB	mg/kg	0.1	Org-005	<0.1	1	<0.1	<0.1	0	[NT]	[NT]
alpha-BHC	mg/kg	0.1	Org-005	<0.1	1	<0.1	<0.1	0	89	95
gamma-BHC	mg/kg	0.1	Org-005	<0.1	1	<0.1	<0.1	0	[NT]	[NT]
beta-BHC	mg/kg	0.1	Org-005	<0.1	1	<0.1	<0.1	0	89	94
Heptachlor	mg/kg	0.1	Org-005	<0.1	1	<0.1	<0.1	0	87	91
delta-BHC	mg/kg	0.1	Org-005	<0.1	1	<0.1	<0.1	0	[NT]	[NT]
Aldrin	mg/kg	0.1	Org-005	<0.1	1	<0.1	<0.1	0	83	87
Heptachlor Epoxide	mg/kg	0.1	Org-005	<0.1	1	<0.1	<0.1	0	84	88
gamma-Chlordane	mg/kg	0.1	Org-005	<0.1	1	<0.1	<0.1	0	[NT]	[NT]
alpha-chlordane	mg/kg	0.1	Org-005	<0.1	1	<0.1	<0.1	0	[NT]	[NT]
Endosulfan I	mg/kg	0.1	Org-005	<0.1	1	<0.1	<0.1	0	[NT]	[NT]
pp-DDE	mg/kg	0.1	Org-005	<0.1	1	<0.1	<0.1	0	89	93
Dieldrin	mg/kg	0.1	Org-005	<0.1	1	<0.1	<0.1	0	96	101
Endrin	mg/kg	0.1	Org-005	<0.1	1	<0.1	<0.1	0	81	85
pp-DDD	mg/kg	0.1	Org-005	<0.1	1	<0.1	<0.1	0	86	90
Endosulfan II	mg/kg	0.1	Org-005	<0.1	1	<0.1	<0.1	0	[NT]	[NT]
pp-DDT	mg/kg	0.1	Org-005	<0.1	1	<0.1	<0.1	0	[NT]	[NT]
Endrin Aldehyde	mg/kg	0.1	Org-005	<0.1	1	<0.1	<0.1	0	[NT]	[NT]
Endosulfan Sulphate	mg/kg	0.1	Org-005	<0.1	1	<0.1	<0.1	0	89	92
Methoxychlor	mg/kg	0.1	Org-005	<0.1	1	<0.1	<0.1	0	[NT]	[NT]
Surrogate TCMX	%		Org-005	78	1	80	78	3	73	78

QUALITY CONTROL: Organophosphorus Pesticides					Duplicate			Spike Recovery %		
Test Description	Units	PQL	Method	Blank	#	Base	Dup.	RPD	LCS-1	176661-6
Date extracted	-			29/09/2017	1	29/09/2017	29/09/2017		29/09/2017	29/09/2017
Date analysed	-			29/09/2017	1	29/09/2017	29/09/2017		29/09/2017	29/09/2017
Azinphos-methyl (Guthion)	mg/kg	0.1	Org-008	<0.1	1	<0.1	<0.1	0	[NT]	[NT]
Bromophos-ethyl	mg/kg	0.1	Org-008	<0.1	1	<0.1	<0.1	0	[NT]	[NT]
Chlorpyrifos	mg/kg	0.1	Org-008	<0.1	1	<0.1	<0.1	0	83	88
Chlorpyrifos-methyl	mg/kg	0.1	Org-008	<0.1	1	<0.1	<0.1	0	[NT]	[NT]
Diazinon	mg/kg	0.1	Org-008	<0.1	1	<0.1	<0.1	0	[NT]	[NT]
Dichlorvos	mg/kg	0.1	Org-008	<0.1	1	<0.1	<0.1	0	84	89
Dimethoate	mg/kg	0.1	Org-008	<0.1	1	<0.1	<0.1	0	[NT]	[NT]
Ethion	mg/kg	0.1	Org-008	<0.1	1	<0.1	<0.1	0	82	88
Fenitrothion	mg/kg	0.1	Org-008	<0.1	1	<0.1	<0.1	0	95	93
Malathion	mg/kg	0.1	Org-008	<0.1	1	<0.1	<0.1	0	105	99
Parathion	mg/kg	0.1	Org-008	<0.1	1	<0.1	<0.1	0	94	96
Ronnel	mg/kg	0.1	Org-008	<0.1	1	<0.1	<0.1	0	93	99
Surrogate TCMX	%		Org-008	78	1	80	78	3	82	86

Client Reference: E30807KM, Oxford Falls

QUALITY CONTROL: PCBs in Soil					Duplicate			Spike Recovery %		
Test Description	Units	PQL	Method	Blank	#	Base	Dup.	RPD	LCS-1	176661-6
Date extracted	-			29/09/2017	1	29/09/2017	29/09/2017		29/09/2017	29/09/2017
Date analysed	-			29/09/2017	1	29/09/2017	29/09/2017		29/09/2017	29/09/2017
Aroclor 1016	mg/kg	0.1	Org-006	<0.1	1	<0.1	<0.1	0	[NT]	[NT]
Aroclor 1221	mg/kg	0.1	Org-006	<0.1	1	<0.1	<0.1	0	[NT]	[NT]
Aroclor 1232	mg/kg	0.1	Org-006	<0.1	1	<0.1	<0.1	0	[NT]	[NT]
Aroclor 1242	mg/kg	0.1	Org-006	<0.1	1	<0.1	<0.1	0	[NT]	[NT]
Aroclor 1248	mg/kg	0.1	Org-006	<0.1	1	<0.1	<0.1	0	[NT]	[NT]
Aroclor 1254	mg/kg	0.1	Org-006	<0.1	1	<0.1	<0.1	0	100	104
Aroclor 1260	mg/kg	0.1	Org-006	<0.1	1	<0.1	<0.1	0	[NT]	[NT]
Surrogate TCLMX	%		Org-006	78	1	80	78	3	82	86

Client Reference: E30807KM, Oxford Falls

QUALITY CONTROL: Acid Extractable metals in soil						Duplicate		Spike Recovery %		
Test Description	Units	PQL	Method	Blank	#	Base	Dup.	RPD	LCS-1	176661-6
Date prepared	-			29/09/2017	1	29/09/2017	29/09/2017		29/09/2017	29/09/2017
Date analysed	-			03/10/2017	1	03/10/2017	03/10/2017		03/10/2017	03/10/2017
Arsenic	mg/kg	4	Metals-020	<4	1	6	6	0	114	100
Cadmium	mg/kg	0.4	Metals-020	<0.4	1	<0.4	<0.4	0	104	100
Chromium	mg/kg	1	Metals-020	<1	1	9	8	12	111	98
Copper	mg/kg	1	Metals-020	<1	1	10	9	11	104	98
Lead	mg/kg	1	Metals-020	<1	1	34	31	9	105	96
Mercury	mg/kg	0.1	Metals-021	<0.1	1	<0.1	<0.1	0	95	98
Nickel	mg/kg	1	Metals-020	<1	1	3	3	0	107	100
Zinc	mg/kg	1	Metals-020	<1	1	79	66	18	124	87

QUALITY CONTROL: Acid Extractable metals in soil						Duplicate		Spike Recovery %		
Test Description	Units	PQL	Method	Blank	#	Base	Dup.	RPD	[NT]	[NT]
Date prepared	-			[NT]	13	29/09/2017	29/09/2017		[NT]	[NT]
Date analysed	-			[NT]	13	03/10/2017	03/10/2017		[NT]	[NT]
Arsenic	mg/kg	4	Metals-020	[NT]	13	<4	<4	0	[NT]	[NT]
Cadmium	mg/kg	0.4	Metals-020	[NT]	13	<0.4	<0.4	0	[NT]	[NT]
Chromium	mg/kg	1	Metals-020	[NT]	13	6	9	40	[NT]	[NT]
Copper	mg/kg	1	Metals-020	[NT]	13	13	12	8	[NT]	[NT]
Lead	mg/kg	1	Metals-020	[NT]	13	13	13	0	[NT]	[NT]
Mercury	mg/kg	0.1	Metals-021	[NT]	13	<0.1	<0.1	0	[NT]	[NT]
Nickel	mg/kg	1	Metals-020	[NT]	13	3	3	0	[NT]	[NT]
Zinc	mg/kg	1	Metals-020	[NT]	13	48	47	2	[NT]	[NT]

Result Definitions

NT	Not tested
NA	Test not required
INS	Insufficient sample for this test
PQL	Practical Quantitation Limit
<	Less than
>	Greater than
RPD	Relative Percent Difference
LCS	Laboratory Control Sample
NS	Not specified
NEPM	National Environmental Protection Measure
NR	Not Reported

Quality Control Definitions

Blank	This is the component of the analytical signal which is not derived from the sample but from reagents, glassware etc, can be determined by processing solvents and reagents in exactly the same manner as for samples.
Duplicate	This is the complete duplicate analysis of a sample from the process batch. If possible, the sample selected should be one where the analyte concentration is easily measurable.
Matrix Spike	A portion of the sample is spiked with a known concentration of target analyte. The purpose of the matrix spike is to monitor the performance of the analytical method used and to determine whether matrix interferences exist.
LCS (Laboratory Control Sample)	This comprises either a standard reference material or a control matrix (such as a blank sand or water) fortified with analytes representative of the analyte class. It is simply a check sample.
Surrogate Spike	Surrogates are known additions to each sample, blank, matrix spike and LCS in a batch, of compounds which are similar to the analyte of interest, however are not expected to be found in real samples.
Australian Drinking Water Guidelines recommend that Thermotolerant Coliform, Faecal Enterococci, & E.Coli levels are less than 1cfu/100mL. The recommended maximums are taken from "Australian Drinking Water Guidelines", published by NHMRC & ARMC 2011.	

Laboratory Acceptance Criteria

Duplicate sample and matrix spike recoveries may not be reported on smaller jobs, however, were analysed at a frequency to meet or exceed NEPM requirements. All samples are tested in batches of 20. The duplicate sample RPD and matrix spike recoveries for the batch were within the laboratory acceptance criteria.

Filters, swabs, wipes, tubes and badges will not have duplicate data as the whole sample is generally extracted during sample extraction.

Spikes for Physical and Aggregate Tests are not applicable.

For VOCs in water samples, three vials are required for duplicate or spike analysis.

Duplicates: <5xPQL - any RPD is acceptable; >5xPQL - 0-50% RPD is acceptable.

Matrix Spikes, LCS and Surrogate recoveries: Generally 70-130% for inorganics/metals; 60-140% for organics (+/-50% surrogates) and 10-140% for labile SVOCs (including labile surrogates), ultra trace organics and speciated phenols is acceptable.

In circumstances where no duplicate and/or sample spike has been reported at 1 in 10 and/or 1 in 20 samples respectively, the sample volume submitted was insufficient in order to satisfy laboratory QA/QC protocols.

When samples are received where certain analytes are outside of recommended technical holding times (THTs), the analysis has proceeded. Where analytes are on the verge of breaching THTs, every effort will be made to analyse within the THT or as soon as practicable.

Where sampling dates are not provided, Envirolab are not in a position to comment on the validity of the analysis where recommended technical holding times may have been breached.

Measurement Uncertainty estimates are available for most tests upon request.

Appendix E: Soil Suitability Analysis Report and Recommendations



Soil Chemistry Profile

Mehlich 3 - Multi-nutrient Extractant

Sample Drop Off: 16 Chilvers Road
Thornleigh NSW 2120
Mailing Address: PO Box 357
Pennant Hills NSW 1715

Tel: 1300 30 40 80
Fax: 1300 64 46 89
Em: info@sesl.com.au
Web: www.sesl.com.au

Batch N°: 45188 Sample N°: 1 Date Received: 3/10/17 Report Status: ☐ Draft ☒ Final

Client Name: **Environmental Investigation Services** Project Name: **Soil assessment for School Oval**
Client Contact: **Rob Muller**
Client Job N°:
Client Order N°:
Address: **PO Box 976**
NORTH RYDE BC NSW 1670
SES� Quote N°: **Q7388**
Sample Name: **BH1 0.0-0.2**
Description: **Soil**
Test Type: **FSC, OM_WB, BSP**

RECOMMENDATIONS

Sample 'BH1 0.0-0.2' was tested to determine its use in a school oval. The soil is slightly acidic in CaCl₂ with desirably low salinity, sodium and chloride levels. The cation exchange is close to being balanced. The eCEC is low indicating poor nutrient retention. Nitrate, potassium and sulphate need boosting. Organic matter = 6.2% (very high). The soil is a light sandy clay loam with a weak crumb structure and rapid permeability. The soil once compacted through pedestrian traffic especially during wet periods will start to waterlog and turf growth will fail. We suggest capping the soil with an imported media is used as passive amenity turf. However if this soil is to be used as a sportsfield further management is required.

Amendment Strategy

We recommend adding 30g/m² of urea to boost nitrogen.

Add sulphate of potash at 40g/m².


To help withstand compaction for passive amenity turf cap existing ameliorated soil with 100mm of an imported 80/20 media.

Alternatively use the soil from Sample 3 to cap this soil.

SOIL SAMPLE DEPTH (mm): ☒ 100 ☐ 150 ☐ 200

FERTILITY RATING: ☐ Low ☒ Moderate ☐ High




pH and ELECTRICAL CONDUCTIVITY

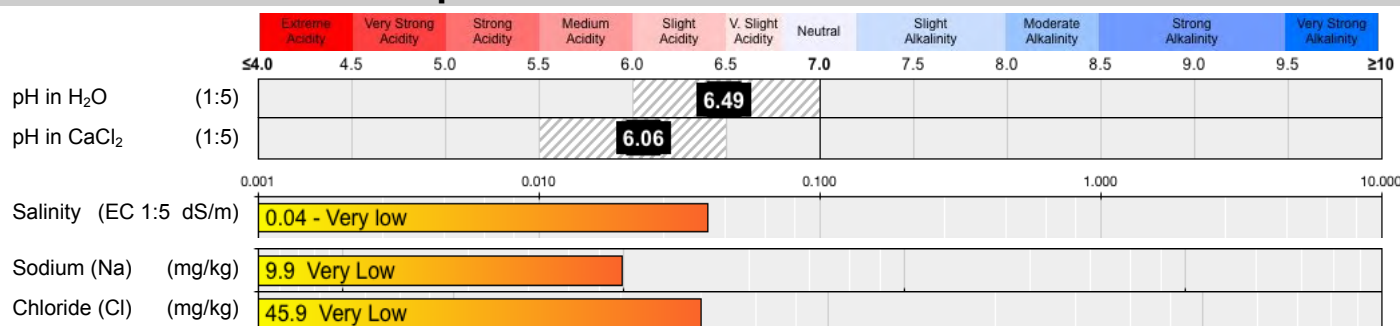

CATION BALANCE

EXCHANGEABLE CATION PERCENTAGE

Note: Hydrogen only determined when pH in CaCl₂ ≤ 5.5
Al only determined if pH in CaCl₂ is ≤ 5.2

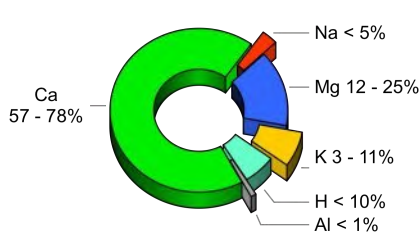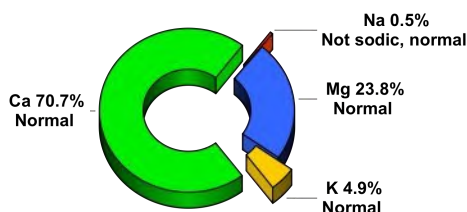

ACTUAL

IDEAL

EFFECTIVE CATION EXCHANGE CAPACITY (eCEC)



CATION RATIOS

Ratio	Result	Target Range
-------	--------	--------------

Ca:Mg	3	4.1 - 6.0
-------	---	-----------

Comment: Calcium low

Mg:K	4.9	2.6 - 5.0
------	-----	-----------

Comment: Balanced

K/(Ca+Mg)	0.05	< 0.07
-----------	------	--------

Comment: Acceptable

K:Na	10.5	N/A
------	------	-----

Sodium Absorption Ratio: D.N.T.

EXCHANGEABLE CATIONS cmol(+)/kg

Na:	K:	Ca:	Mg:	H:	Al:
0.04	0.42	6.08	2.05		

SOLUBLE CATIONS cmol(+)/kg

Na:	K:	Ca:	Mg:
-----	----	-----	-----



A member of the Australasian Soil and Plant Analysis Council
† This laboratory has been awarded a Certificate of Proficiency for specific soil and plant tissue analyses by the Australasian Soil and Plant Analysis Council (ASPAC). Tests for which proficiency has been demonstrated are highlighted in this report.

Disclaimer: Tests are performed under a quality system complying with ISO 9001: 2008. Results are based on the analysis of the sample taken or received by SESL. Due to the variability of sampling procedures, environmental conditions and managerial factors, SESL does not accept any liability for a lack of performance based on its interpretation and recommendations. This document must not be reproduced except in full.



Soil Chemistry Profile

Mehlich 3 - Multi-nutrient Extractant

Sample Drop Off: 16 Chilvers Road
Thornleigh NSW 2120

Mailing Address: PO Box 357
Pennant Hills NSW 1715

Tel: 1300 30 40 80
Fax: 1300 64 46 89
Em: info@sesl.com.au
Web: www.sesl.com.au

Batch N°: 45188

Sample N°: 1

Date Received: 3/10/17

Report Status: ☐ Draft ☒ Final

PLANT AVAILABLE NUTRIENTS

Major Nutrients	Result (mg/kg)	Very Low	Low	Marginal	Adequate	High	Result (g/sqm)	Desirable (g/sqm)	Adjustment (g/sqm)
Nitrate-N (NO ₃)	7						0.9	4	3.1
Phosphate-P (PO ₄)	101						13.4	8.4	Drawdown
Potassium (K) †	165						21.9	29.3	7.4
Sulphate-S (SO ₄)	3.5						0.5	9	8.5
Calcium (Ca) †	1220						162.3	208.3	46
Magnesium (Mg) †	249						33.1	21.7	Drawdown
Iron (Fe)	475						63.2	73.4	10.2
Manganese (Mn) †	11						1.5	5.9	4.4
Zinc (Zn) †	29						3.9	0.7	Drawdown
Copper (Cu)	3.5						0.5	0.8	0.3
Boron (B) †	<0.1						0	0.4	0.4

Explanation of graph ranges:

Very Low

Growth is likely to be severely depressed and deficiency symptoms present. Large applications for soil building purposes are usually recommended. Potential response to nutrient addition is >90%.

Low

Potential "hidden hunger" or sub-clinical deficiency. Potential response to nutrient addition is 60 to 90%.

Marginal

Supply of this nutrient is barely adequate for the plant, and build-up is still recommended. Potential response to nutrient addition is 30 to 60%.

Adequate

Supply of this nutrient is adequate for the plant, and only maintenance application rates are recommended. Potential response to nutrient addition is 5 to 30%.

High


The level is excessive and may be detrimental to plant growth (i.e. phytotoxic) and may contribute to pollution of ground and surface waters. Drawdown is recommended. Potential response to nutrient addition is <2%.

NOTES: Adjustment recommendation calculates the elemental application to shift the soil test level to within the Adequate band, which maximises growth/yield, and economic efficiency, and minimises impact on the environment.

Drawdown: The objective nutrient management is to utilise residual soil nutrients. There is no agronomic reason to apply fertiliser when soil test levels exceed Adequate.

* g/sqm measurements are based on soil bulk density of 1.33 tonne/m³ and selected soil depth.

Phosphorus Saturation Index

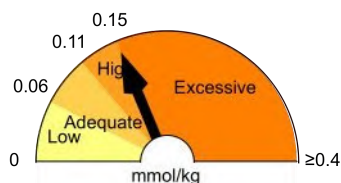

Excessive. Exceeds environmental threshold. Implement improved P management to reduce potential for nonpoint P pollution.

Exchangeable Acidity

Adams-Evans Buffer pH (BpH): -
Sum of Base Cations (meq/100g⁻¹): **8.6**
Eff. Cation Exch. Capacity (eCEC): **8.6**
Base Saturation (%): **100**
Exchangeable Acidity (meq/100g⁻¹): -
Exchangeable Acidity (%): -

Lime Application Rate

– to achieve pH 6.0 (g/sqm): **0**
– to neutralise Al (g/sqm): -

Gypsum Application Rate

– to achieve 67.5% exch. Ca (g/sqm): **0**
The CGAR is corrected for a soil depth of 100mm and any Lime addition to achieve pH 6.0.

Physical Description

Texture: **Light Sandy Clay Loam**
Colour: -
Estimated clay content: **25%**
Size: **Fine (1 - 10mm)**
Gravel content: **Gravelly**
Aggregate strength: **Pedal - Weak**
Structural unit: **Crumb**
Potential infiltration rate: **Rapid**
Permeability (mm/hr): **>120**
Calculated EC_{SE} (dS/m): **0.4**

– Non-saline. Salinity effects on plants are mostly negligible.

Organic Carbon (OC%)[†]: **2.8 – Very high**

Organic Matter (OM%): **6.2**

Additional comments:

Consultant: Chantal Milner

Authorised Signatory: Simon Leake

Date Report Generated 16/10/2017

METHOD REFERENCES:

pH (1:5 H₂O) - Rayment & Higginson (1992) 4A1.
pH (1:5 CaCl₂) - Rayment & Higginson (1992) 4B1.
EC (1:5) - Rayment & Higginson (1992) 3A1.
Chloride - Rayment & Higginson (1992) 5A2.
Nitrate - Rayment & Higginson (1992) 7B1.
Aluminium - SESL in-house.
PO₄, K, SO₄, Ca, Mg, Na, Fe, Mn, Zn, Cu, B - Mehlich 3 (1984).
Buffer pH and Hydrogen - Adams-Evans (1972).
Texture/Structure/Colour - PM0003 (Texture - Northcote (1992), Structure - Murphy (1991), Colour - Munsell (2000))



A member of the Australasian Soil and Plant Analysis Council
† This laboratory has been awarded a Certificate of Proficiency for specific soil and plant tissue analyses by the Australasian Soil and Plant Analysis Council (ASPAC). Tests for which proficiency has been demonstrated are highlighted in this report.

Disclaimer: Tests are performed under a quality system complying with ISO 9001: 2008. Results are based on the analysis of the sample taken or received by SESL. Due to the variability of sampling procedures, environmental conditions and managerial factors, SESL does not accept any liability for a lack of performance based on its interpretation and recommendations. This document must not be reproduced except in full.



Soil Chemistry Profile

Mehlich 3 - Multi-nutrient Extractant

Sample Drop Off: 16 Chilvers Road
Thornleigh NSW 2120
Mailing Address: PO Box 357
Pennant Hills NSW 1715

Tel: 1300 30 40 80
Fax: 1300 64 46 89
Em: info@sesl.com.au
Web: www.sesl.com.au

Batch N°: 45188

Sample N°: 2

Date Received: 3/10/17

Report Status: ☐ Draft ☒ Final

Client Name: **Environmental Investigation Services** Project Name: **Soil assessment for School Oval**
Client Contact: **Rob Muller**
Client Job N°:
Client Order N°:
Address: **PO Box 976**
NORTH RYDE BC NSW 1670
SES� Quote N°: **Q7388**
Sample Name: **BH4 0.5-0.95**
Description: **Soil**
Test Type: **FSC, OM_WB, BSP**

RECOMMENDATIONS


Sample 'BH4 0.5-0.95' was tested to determine its use in a school oval. The soil is slightly acidic in CaCl₂ with desirably low salinity, sodium and chloride levels. The cation exchange is calcic. The eCEC is low indicating poor nutrient retention. All nutrients need boosting aside from phosphorus. Organic matter = 1.1% (very low). The soil is a sandy clay loam with a moderate crumb structure and moderate permeability. The soil once compacted through pedestrian traffic especially during wet periods will start to waterlog and turf growth will fail. We suggest capping the soil with an imported media is used as passive amenity turf. However if this soil is to be used as a sportsfield further management is required.

Amendment Strategy

We recommend adding a multipurpose NPK+TE fertiliser that has low P.
To help withstand compaction for passive amenity turf cap existing ameliorated soil with 100mm of an imported 80/20 media.
Alternatively use the soil from Sample 3 to cap this soil.

SOIL SAMPLE DEPTH (mm): ☒ 100 ☐ 150 ☐ 200FERTILITY RATING: ☐ Low ☒ Moderate ☐ High




pH and ELECTRICAL CONDUCTIVITY

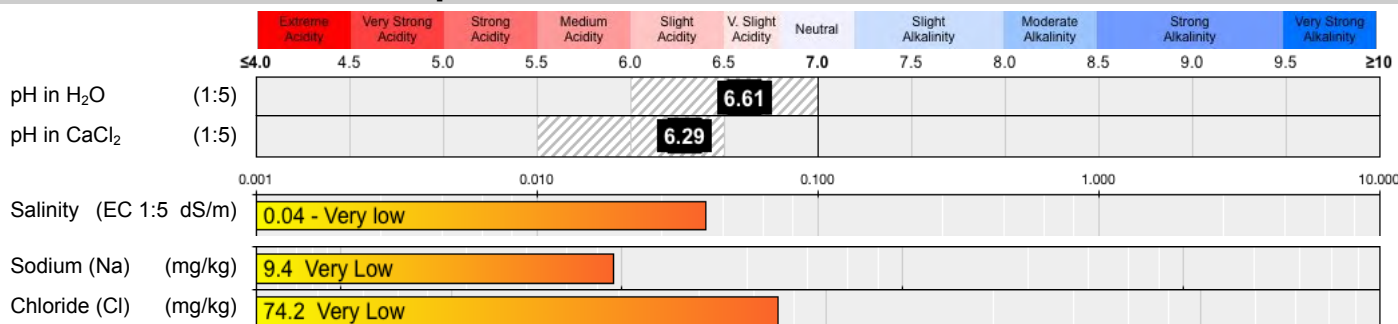

CATION BALANCE

EXCHANGEABLE CATION PERCENTAGE

Note: Hydrogen only determined when pH in CaCl₂ ≤ 5.5
Al only determined if pH in CaCl₂ is ≤ 5.2

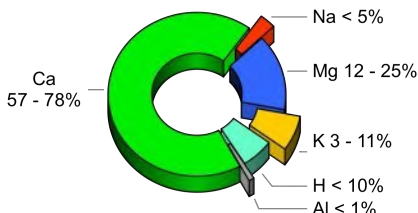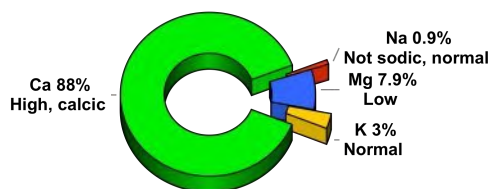

CATION RATIOS

Ratio	Result	Target Range
Ca:Mg	11.3	4.1 – 6.0
Comment:	Potential magnesium	
Mg:K	2.6	2.6 – 5.0
Comment:	Balanced	
K/(Ca+Mg)	0.03	< 0.07
Comment:	Acceptable	
K:Na	3.5	N/A
Sodium Absorption Ratio:	D.N.T.	

EFFECTIVE CATION EXCHANGE CAPACITY (eCEC)



EXCHANGEABLE CATIONS cmol(+)/kg

Na:	K:	Ca:	Mg:	H:	Al:
0.04	0.14	4.05	0.36		

SOLUBLE CATIONS cmol(+)/kg

Na:	K:	Ca:	Mg:
-----	----	-----	-----



A member of the Australasian Soil and Plant Analysis Council
† This laboratory has been awarded a Certificate of Proficiency for specific soil and plant tissue analyses by the Australasian Soil and Plant Analysis Council (ASPAC). Tests for which proficiency has been demonstrated are highlighted in this report.

Disclaimer: Tests are performed under a quality system complying with ISO 9001: 2008. Results are based on the analysis of the sample taken or received by SESL. Due to the variability of sampling procedures, environmental conditions and managerial factors, SESL does not accept any liability for a lack of performance based on its interpretation and recommendations. This document must not be reproduced except in full.



Soil Chemistry Profile

Mehlich 3 - Multi-nutrient Extractant

Sample Drop Off: 16 Chilvers Road
Thornleigh NSW 2120

Mailing Address: PO Box 357
Pennant Hills NSW 1715

Tel: 1300 30 40 80
Fax: 1300 64 46 89

Em: info@sesl.com.au
Web: www.sesl.com.au

Batch N°: 45188

Sample N°: 2

Date Received: 3/10/17

Report Status: ☐ Draft ☒ Final

PLANT AVAILABLE NUTRIENTS

Major Nutrients	Result (mg/kg)	Very Low	Low	Marginal	Adequate	High	Result (g/sqm)	Desirable (g/sqm)	Adjustment (g/sqm)
Nitrate-N (NO ₃)	1.7						0.2	4	3.8
Phosphate-P (PO ₄)	109						14.5	8.4	Drawdown
Potassium (K) †	55						7.3	23.7	16.4
Sulphate-S (SO ₄)	20						2.7	9	6.3
Calcium (Ca) †	811						107.9	168.5	60.6
Magnesium (Mg) †	44						5.9	17.8	11.9
Iron (Fe)	223						29.7	73.4	43.7
Manganese (Mn) †	3.1						0.4	5.9	5.5
Zinc (Zn) †	32						4.3	0.7	Drawdown
Copper (Cu)	1.6						0.2	0.8	0.6
Boron (B) †	<0.1						0	0.4	0.4

Explanation of graph ranges:

Very Low

Growth is likely to be severely depressed and deficiency symptoms present. Large applications for soil building purposes are usually recommended. Potential response to nutrient addition is >90%.

Low

Potential "hidden hunger" or sub-clinical deficiency. Potential response to nutrient addition is 60 to 90%.

Marginal

Supply of this nutrient is barely adequate for the plant, and build-up is still recommended. Potential response to nutrient addition is 30 to 60%.

Adequate

Supply of this nutrient is adequate for the plant, and only maintenance application rates are recommended. Potential response to nutrient addition is 5 to 30%.

High


The level is excessive and may be detrimental to plant growth (i.e. phytotoxic) and may contribute to pollution of ground and surface waters. Drawdown is recommended. Potential response to nutrient addition is <2%.

NOTES: Adjustment recommendation calculates the elemental application to shift the soil test level to within the Adequate band, which maximises growth/yield, and economic efficiency, and minimises impact on the environment.

Drawdown: The objective nutrient management is to utilise residual soil nutrients. There is no agronomic reason to apply fertiliser when soil test levels exceed Adequate.

* g/sqm measurements are based on soil bulk density of 1.33 tonne/m³ and selected soil depth.

Phosphorus Saturation Index

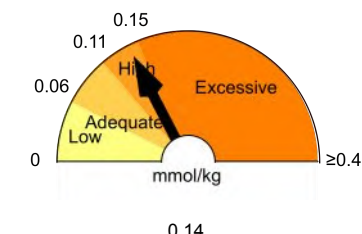

High. Soil P will not limit plant growth. No P recommended this season.

Exchangeable Acidity

Adams-Evans Buffer pH (BpH): -

Sum of Base Cations (meq/100g⁻¹): **4.6**

Eff. Cation Exch. Capacity (eCEC): **4.6**

Base Saturation (%): **100**

Exchangeable Acidity (meq/100g⁻¹): -

Exchangeable Acidity (%): -

Lime Application Rate

– to achieve pH 6.0 (g/sqm): **0**

– to neutralise Al (g/sqm): -

Gypsum Application Rate

– to achieve 67.5% exch. Ca (g/sqm): **0**

The CGAR is corrected for a soil depth of 100mm and any Lime addition to achieve pH 6.0.

Physical Description

Texture: **Sandy Clay Loam**

Colour: -

Estimated clay content: **20 - 30%**

Size: **Fine (1 - 10mm)**

Gravel content: **Gravelly**

Aggregate strength: **Pedal - Moderate**

Structural unit: **Crumb**

Potential infiltration rate: **Moderate**

Permeability (mm/hr): **20 - 60**

Calculated EC_{SE} (dS/m): **0.4**

– Non-saline. Salinity effects on plants are mostly negligible.

Organic Carbon (OC%)[†]: **0.5 – Very low**

Organic Matter (OM%): **1.1**

Additional comments:

Consultant: Chantal Milner

Authorised Signatory: Simon Leake

Date Report Generated 16/10/2017

METHOD REFERENCES:

pH (1:5 H₂O) - Rayment & Higginson (1992) 4A1.
pH (1:5 CaCl₂) - Rayment & Higginson (1992) 4B1.
EC (1:5) - Rayment & Higginson (1992) 3A1.
Chloride - Rayment & Higginson (1992) 5A2.
Nitrate - Rayment & Higginson (1992) 7B1.
Aluminium - SESL in-house.
PO₄, K, SO₄, Ca, Mg, Na, Fe, Mn, Zn, Cu, B - Mehlich 3 (1984).
Buffer pH and Hydrogen - Adams-Evans (1972).
Texture/Structure/Colour - PM0003 (Texture - Northcote (1992), Structure - Murphy (1991), Colour - Munsell (2000))



A member of the Australasian Soil and Plant Analysis Council
† This laboratory has been awarded a Certificate of Proficiency for specific soil and plant tissue analyses by the Australasian Soil and Plant Analysis Council (ASPAC). Tests for which proficiency has been demonstrated are highlighted in this report.

Disclaimer: Tests are performed under a quality system complying with ISO 9001: 2008. Results are based on the analysis of the sample taken or received by SESL. Due to the variability of sampling procedures, environmental conditions and managerial factors, SESL does not accept any liability for a lack of performance based on its interpretation and recommendations. This document must not be reproduced except in full.



Soil Chemistry Profile

Mehlich 3 - Multi-nutrient Extractant

Sample Drop Off: 16 Chilvers Road
Thornleigh NSW 2120
Mailing Address: PO Box 357
Pennant Hills NSW 1715

Tel: 1300 30 40 80
Fax: 1300 64 46 89
Em: info@sesl.com.au
Web: www.sesl.com.au

Batch N°: 45188

Sample N°: 3

Date Received: 3/10/17

Report Status: ☐ Draft ☒ Final

Client Name: **Environmental Investigation Services** Project Name: **Soil assessment for School Oval**
Client Contact: **Rob Muller**
Client Job N°:
Client Order N°:
Address: **PO Box 976**
NORTH RYDE BC NSW 1670
SES� Quote N°: **Q7388**
Sample Name: **BH7 0.0-0.2**
Description: **Soil**
Test Type: **FSC, OM_WB, BSP**

RECOMMENDATIONS


Sample 'BH7 0.0-0.2' was tested to determine its use in a school oval. The soil is strongly acidic in CaCl₂ with desirably low salinity, sodium and chloride levels. The cation exchange is highly acidic. The eCEC is low indicating poor nutrient retention. All nutrients need boosting aside from phosphorus. Organic matter = 3.1% (moderate). The soil is a sandy loam with a weak crumb structure and rapid permeability. This soil is the best choice out of the 3 samples for use in a school oval. This soil could be used as the capping layer for the other 2 soils.

Amendment Strategy

We recommend adding a multipurpose NPK+TE fertiliser that has low P.
A small amount of lime at just 50g/m² will reduce the exchangeable acidity.

SOIL SAMPLE DEPTH (mm): ☒ 100 ☐ 150 ☐ 200FERTILITY RATING: ☐ Low ☒ Moderate ☐ High




pH and ELECTRICAL CONDUCTIVITY

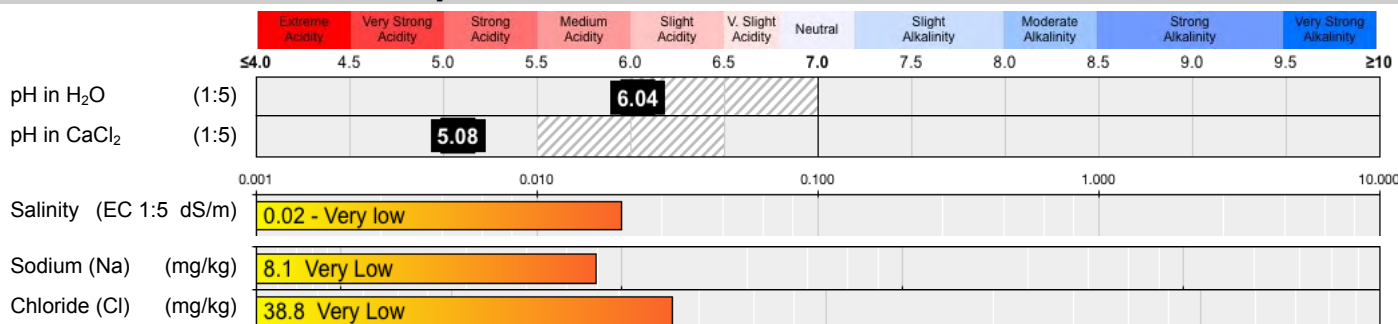

CATION BALANCE

EXCHANGEABLE CATION PERCENTAGE


Note: Hydrogen only determined when pH in CaCl₂ ≤ 5.5
Al only determined if pH in CaCl₂ is ≤ 5.2

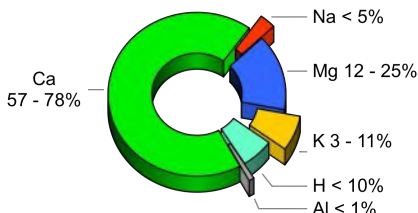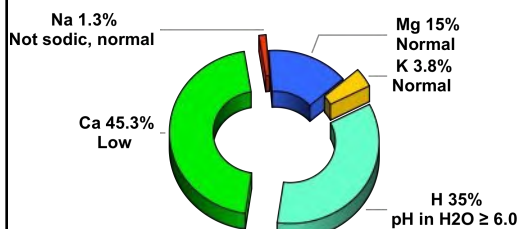

ACTUAL

IDEAL

EFFECTIVE CATION EXCHANGE CAPACITY (eCEC)



CATION RATIOS

Ratio	Result	Target Range
Ca:Mg	3	4.1 – 6.0
Comment: Calcium low		
Mg:K	4	2.6 – 5.0
Comment: Balanced		
K/(Ca+Mg)	0.06	< 0.07
Comment: Acceptable		
K:Na	3	N/A
Sodium Absorption Ratio: D.N.T.		

EXCHANGEABLE CATIONS cmol(+)/kg

Na:	K:	Ca:	Mg:	H:	Al:
0.04	0.12	1.45	0.48	1.12	0.00

SOLUBLE CATIONS cmol(+)/kg

Na:	K:	Ca:	Mg:
-----	----	-----	-----



A member of the Australasian Soil and Plant Analysis Council
† This laboratory has been awarded a Certificate of Proficiency for specific soil and plant tissue analyses by the Australasian Soil and Plant Analysis Council (ASPAC). Tests for which proficiency has been demonstrated are highlighted in this report.

Disclaimer: Tests are performed under a quality system complying with ISO 9001: 2008. Results are based on the analysis of the sample taken or received by SESL. Due to the variability of sampling procedures, environmental conditions and managerial factors, SESL does not accept any liability for a lack of performance based on its interpretation and recommendations. This document must not be reproduced except in full.



Soil Chemistry Profile

Mehlich 3 - Multi-nutrient Extractant

Sample Drop Off: 16 Chilvers Road
Thornleigh NSW 2120

Mailing Address: PO Box 357
Pennant Hills NSW 1715

Tel: 1300 30 40 80
Fax: 1300 64 46 89

Em: info@sesl.com.au
Web: www.sesl.com.au

Batch N°: 45188

Sample N°: 3

Date Received: 3/10/17

Report Status: ☐ Draft ☒ Final

PLANT AVAILABLE NUTRIENTS

Major Nutrients	Result (mg/kg)	Very Low	Low	Marginal	Adequate	High	Result (g/sqm)	Desirable (g/sqm)	Adjustment (g/sqm)
Nitrate-N (NO ₃)	2.2						0.3	4	3.7
Phosphate-P (PO ₄)	121						16.1	8.4	Drawdown
Potassium (K) †	47.5						6.3	23.7	17.4
Sulphate-S (SO ₄)	<3.20						0.4	9	8.6
Calcium (Ca) †	291						38.7	168.5	129.8
Magnesium (Mg) †	58						7.7	17.8	10.1
Iron (Fe)	173						23	73.4	50.4
Manganese (Mn) †	3.5						0.5	5.9	5.4
Zinc (Zn) †	5.7						0.8	0.7	Drawdown
Copper (Cu)	<0.64						0.1	0.8	0.7
Boron (B) †	<0.1						0	0.4	0.4

Explanation of graph ranges:

Very Low

Growth is likely to be severely depressed and deficiency symptoms present. Large applications for soil building purposes are usually recommended. Potential response to nutrient addition is >90%.

Low

Potential "hidden hunger" or sub-clinical deficiency. Potential response to nutrient addition is 60 to 90%.

Marginal

Supply of this nutrient is barely adequate for the plant, and build-up is still recommended. Potential response to nutrient addition is 30 to 60%.

Adequate

Supply of this nutrient is adequate for the plant, and only maintenance application rates are recommended. Potential response to nutrient addition is 5 to 30%.

High


The level is excessive and may be detrimental to plant growth (i.e. phytotoxic) and may contribute to pollution of ground and surface waters. Drawdown is recommended. Potential response to nutrient addition is <2%.

NOTES: Adjustment recommendation calculates the elemental application to shift the soil test level to within the Adequate band, which maximises growth/yield, and economic efficiency, and minimises impact on the environment.

Drawdown: The objective nutrient management is to utilise residual soil nutrients. There is no agronomic reason to apply fertiliser when soil test levels exceed Adequate.

* g/sqm measurements are based on soil bulk density of 1.33 tonne/m³ and selected soil depth.

Phosphorus Saturation Index

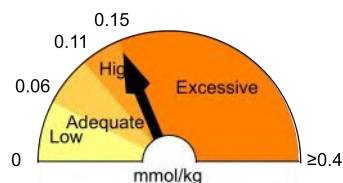

Excessive. Exceeds environmental threshold. Implement improved P management to reduce potential for nonpoint P pollution.

Exchangeable Acidity

Adams-Evans Buffer pH (BpH): **7.8**
Sum of Base Cations (meq/100g⁻¹): **2.1**
Eff. Cation Exch. Capacity (eCEC): **3.2**
Base Saturation (%): **65.63**
Exchangeable Acidity (meq/100g⁻¹): -
Exchangeable Acidity (%): -

Lime Application Rate

– to achieve pH 6.0 (g/sqm): **0**
– to neutralise Al (g/sqm): **0**

Gypsum Application Rate

– to achieve 67.5% exch. Ca (g/sqm): **81**
The CGAR is corrected for a soil depth of 100mm and any Lime addition to achieve pH 6.0.

Physical Description

Texture: **Sandy Loam**
Colour: **-**
Estimated clay content: **10 - 20%**
Size: **Fine (1 - 10mm)**
Gravel content: **Not gravelly**
Aggregate strength: **Pedal - Weak**
Structural unit: **Crumb**
Potential infiltration rate: **Rapid**
Permeability (mm/hr): **>120**
Calculated EC_{SE} (dS/m): **0.3**

– Non-saline. Salinity effects on plants are mostly negligible.

Organic Carbon (OC%)[†]: **1.4 – Moderate**

Organic Matter (OM%): **3.1**

Additional comments:

Consultant: Chantal Milner

Authorised Signatory: Simon Leake

Date Report Generated 16/10/2017

METHOD REFERENCES:

pH (1:5 H₂O) - Rayment & Higginson (1992) 4A1.
pH (1:5 CaCl₂) - Rayment & Higginson (1992) 4B1.
EC (1:5) - Rayment & Higginson (1992) 3A1.
Chloride - Rayment & Higginson (1992) 5A2.
Nitrate - Rayment & Higginson (1992) 7B1.
Aluminium - SESL in-house.
PO₄, K, SO₄, Ca, Mg, Na, Fe, Mn, Zn, Cu, B - Mehlich 3 (1984).
Buffer pH and Hydrogen - Adams-Evans (1972).
Texture/Structure/Colour - PM0003 (Texture - Northcote (1992), Structure - Murphy (1991), Colour - Munsell (2000))



A member of the Australasian Soil and Plant Analysis Council
† This laboratory has been awarded a Certificate of Proficiency for specific soil and plant tissue analyses by the Australasian Soil and Plant Analysis Council (ASPAC). Tests for which proficiency has been demonstrated are highlighted in this report.

Disclaimer: Tests are performed under a quality system complying with ISO 9001: 2008. Results are based on the analysis of the sample taken or received by SESL. Due to the variability of sampling procedures, environmental conditions and managerial factors, SESL does not accept any liability for a lack of performance based on its interpretation and recommendations. This document must not be reproduced except in full.

Appendix F: UCL Calculations

	A	B	C	D	E	F	G	H	I	J	K	L
1	UCL Statistics for Uncensored Full Data Sets											
2												
3	User Selected Options											
4	Date/Time of Computation			23/10/2017 8:02:50 AM								
5	From File			WorkSheet.xls								
6	Full Precision			OFF								
7	Confidence Coefficient			95%								
8	Number of Bootstrap Operations			2000								
9												
10												
11	Arsenic											
12												
13	General Statistics											
14	Total Number of Observations				14		Number of Distinct Observations				4	
15							Number of Missing Observations				0	
16	Minimum				4		Mean				4.786	
17	Maximum				8		Median				4	
18	SD				1.188		Std. Error of Mean				0.318	
19	Coefficient of Variation				0.248		Skewness				1.762	
20												
21	Normal GOF Test											
22	Shapiro Wilk Test Statistic				0.719		Shapiro Wilk GOF Test					
23	5% Shapiro Wilk Critical Value				0.874		Data Not Normal at 5% Significance Level					
24	Lilliefors Test Statistic				0.317		Lilliefors GOF Test					
25	5% Lilliefors Critical Value				0.237		Data Not Normal at 5% Significance Level					
26	Data Not Normal at 5% Significance Level											
27												
28	Assuming Normal Distribution											
29	95% Normal UCL					95% UCLs (Adjusted for Skewness)						
30	95% Student's-t UCL				5.348		95% Adjusted-CLT UCL (Chen-1995)				5.468	
31							95% Modified-t UCL (Johnson-1978)				5.373	
32												
33	Gamma GOF Test											
34	A-D Test Statistic				1.559		Anderson-Darling Gamma GOF Test					
35	5% A-D Critical Value				0.734		Data Not Gamma Distributed at 5% Significance Level					
36	K-S Test Statistic				0.336		Kolmogrov-Smirnoff Gamma GOF Test					
37	5% K-S Critical Value				0.228		Data Not Gamma Distributed at 5% Significance Level					
38	Data Not Gamma Distributed at 5% Significance Level											
39												
40	Gamma Statistics											
41	k hat (MLE)				20.92		k star (bias corrected MLE)				16.49	
42	Theta hat (MLE)				0.229		Theta star (bias corrected MLE)				0.29	
43	nu hat (MLE)				585.8		nu star (bias corrected)				461.6	
44	MLE Mean (bias corrected)				4.786		MLE Sd (bias corrected)				1.179	
45							Approximate Chi Square Value (0.05)				412.8	
46	Adjusted Level of Significance				0.0312		Adjusted Chi Square Value				406.6	
47												
48	Assuming Gamma Distribution											
49	95% Approximate Gamma UCL (use when n>=50))				5.352		95% Adjusted Gamma UCL (use when n<50)				5.432	
50												
51	Lognormal GOF Test											
52	Shapiro Wilk Test Statistic				0.75		Shapiro Wilk Lognormal GOF Test					
53	5% Shapiro Wilk Critical Value				0.874		Data Not Lognormal at 5% Significance Level					
54	Lilliefors Test Statistic				0.333		Lilliefors Lognormal GOF Test					
55	5% Lilliefors Critical Value				0.237		Data Not Lognormal at 5% Significance Level					
56	Data Not Lognormal at 5% Significance Level											
57												

	A	B	C	D	E	F	G	H	I	J	K	L
58	Lognormal Statistics											
59	Minimum of Logged Data					1.386	Mean of logged Data					1.542
60	Maximum of Logged Data					2.079	SD of logged Data					0.219
61												
62	Assuming Lognormal Distribution											
63	95% H-UCL					5.347	90% Chebyshev (MVUE) UCL					5.618
64	95% Chebyshev (MVUE) UCL					6	97.5% Chebyshev (MVUE) UCL					6.529
65	99% Chebyshev (MVUE) UCL					7.569						
66												
67	Nonparametric Distribution Free UCL Statistics											
68	Data do not follow a Discernible Distribution (0.05)											
69												
70	Nonparametric Distribution Free UCLs											
71	95% CLT UCL					5.308	95% Jackknife UCL					5.348
72	95% Standard Bootstrap UCL					N/A	95% Bootstrap-t UCL					N/A
73	95% Hall's Bootstrap UCL					N/A	95% Percentile Bootstrap UCL					N/A
74	95% BCA Bootstrap UCL					N/A						
75	90% Chebyshev(Mean, Sd) UCL					5.738	95% Chebyshev(Mean, Sd) UCL					6.17
76	97.5% Chebyshev(Mean, Sd) UCL					6.769	99% Chebyshev(Mean, Sd) UCL					7.946
77												
78	Suggested UCL to Use											
79	95% Student's-t UCL					5.348	or 95% Modified-t UCL					5.373
80												
81	Note: Suggestions regarding the selection of a 95% UCL are provided to help the user to select the most appropriate 95% UCL.											
82	These recommendations are based upon the results of the simulation studies summarized in Singh, Singh, and Iaci (2002)											
83	and Singh and Singh (2003). However, simulations results will not cover all Real World data sets.											
84	For additional insight the user may want to consult a statistician.											
85												

	A	B	C	D	E	F	G	H	I	J	K	L
1	UCL Statistics for Uncensored Full Data Sets											
2												
3	User Selected Options											
4	Date/Time of Computation			23/10/2017 8:04:19 AM								
5	From File			WorkSheet.xls								
6	Full Precision			OFF								
7	Confidence Coefficient			95%								
8	Number of Bootstrap Operations			2000								
9												
10												
11	Chromium											
12												
13	General Statistics											
14	Total Number of Observations				14		Number of Distinct Observations				7	
15							Number of Missing Observations				0	
16	Minimum				6		Mean				10.57	
17	Maximum				19		Median				9	
18	SD				4.237		Std. Error of Mean				1.133	
19	Coefficient of Variation				0.401		Skewness				0.73	
20												
21	Normal GOF Test											
22	Shapiro Wilk Test Statistic				0.866		Shapiro Wilk GOF Test					
23	5% Shapiro Wilk Critical Value				0.874		Data Not Normal at 5% Significance Level					
24	Lilliefors Test Statistic				0.229		Lilliefors GOF Test					
25	5% Lilliefors Critical Value				0.237		Data appear Normal at 5% Significance Level					
26	Data appear Approximate Normal at 5% Significance Level											
27												
28	Assuming Normal Distribution											
29	95% Normal UCL						95% UCLs (Adjusted for Skewness)					
30	95% Student's-t UCL				12.58		95% Adjusted-CLT UCL (Chen-1995)				12.67	
31							95% Modified-t UCL (Johnson-1978)				12.61	
32												
33	Gamma GOF Test											
34	A-D Test Statistic				0.796		Anderson-Darling Gamma GOF Test					
35	5% A-D Critical Value				0.736		Data Not Gamma Distributed at 5% Significance Level					
36	K-S Test Statistic				0.246		Kolmogrov-Smirnoff Gamma GOF Test					
37	5% K-S Critical Value				0.229		Data Not Gamma Distributed at 5% Significance Level					
38	Data Not Gamma Distributed at 5% Significance Level											
39												
40	Gamma Statistics											
41	k hat (MLE)				7.205		k star (bias corrected MLE)				5.709	
42	Theta hat (MLE)				1.467		Theta star (bias corrected MLE)				1.852	
43	nu hat (MLE)				201.7		nu star (bias corrected)				159.8	
44	MLE Mean (bias corrected)				10.57		MLE Sd (bias corrected)				4.425	
45							Approximate Chi Square Value (0.05)				131.6	
46	Adjusted Level of Significance				0.0312		Adjusted Chi Square Value				128.2	
47												
48	Assuming Gamma Distribution											
49	95% Approximate Gamma UCL (use when n>=50))				12.84		95% Adjusted Gamma UCL (use when n<50)				13.18	
50												
51	Lognormal GOF Test											
52	Shapiro Wilk Test Statistic				0.885		Shapiro Wilk Lognormal GOF Test					
53	5% Shapiro Wilk Critical Value				0.874		Data appear Lognormal at 5% Significance Level					
54	Lilliefors Test Statistic				0.24		Lilliefors Lognormal GOF Test					
55	5% Lilliefors Critical Value				0.237		Data Not Lognormal at 5% Significance Level					
56	Data appear Approximate Lognormal at 5% Significance Level											
57												

	A	B	C	D	E	F	G	H	I	J	K	L
58	Lognormal Statistics											
59	Minimum of Logged Data					1.792	Mean of logged Data					2.287
60	Maximum of Logged Data					2.944	SD of logged Data					0.386
61												
62	Assuming Lognormal Distribution											
63	95% H-UCL					13.1	90% Chebyshev (MVUE) UCL					13.88
64	95% Chebyshev (MVUE) UCL					15.38	97.5% Chebyshev (MVUE) UCL					17.47
65	99% Chebyshev (MVUE) UCL					21.58						
66												
67	Nonparametric Distribution Free UCL Statistics											
68	Data appear to follow a Discernible Distribution at 5% Significance Level											
69												
70	Nonparametric Distribution Free UCLs											
71	95% CLT UCL					12.43	95% Jackknife UCL					12.58
72	95% Standard Bootstrap UCL					12.36	95% Bootstrap-t UCL					12.88
73	95% Hall's Bootstrap UCL					12.47	95% Percentile Bootstrap UCL					12.29
74	95% BCA Bootstrap UCL					12.71						
75	90% Chebyshev(Mean, Sd) UCL					13.97	95% Chebyshev(Mean, Sd) UCL					15.51
76	97.5% Chebyshev(Mean, Sd) UCL					17.64	99% Chebyshev(Mean, Sd) UCL					21.84
77												
78	Suggested UCL to Use											
79	95% Student's-t UCL					12.58						
80												
81	Note: Suggestions regarding the selection of a 95% UCL are provided to help the user to select the most appropriate 95% UCL.											
82	These recommendations are based upon the results of the simulation studies summarized in Singh, Singh, and Iaci (2002)											
83	and Singh and Singh (2003). However, simulations results will not cover all Real World data sets.											
84	For additional insight the user may want to consult a statistician.											
85												

	A	B	C	D	E	F	G	H	I	J	K	L
1	UCL Statistics for Uncensored Full Data Sets											
2												
3	User Selected Options											
4	Date/Time of Computation			23/10/2017 8:05:36 AM								
5	From File			WorkSheet.xls								
6	Full Precision			OFF								
7	Confidence Coefficient			95%								
8	Number of Bootstrap Operations			2000								
9												
10												
11	Lead											
12												
13	General Statistics											
14	Total Number of Observations				14		Number of Distinct Observations				13	
15							Number of Missing Observations				0	
16	Minimum				8		Mean				25.43	
17	Maximum				73		Median				19.5	
18	SD				18.88		Std. Error of Mean				5.047	
19	Coefficient of Variation				0.743		Skewness				1.605	
20												
21	Normal GOF Test											
22	Shapiro Wilk Test Statistic				0.817		Shapiro Wilk GOF Test					
23	5% Shapiro Wilk Critical Value				0.874		Data Not Normal at 5% Significance Level					
24	Lilliefors Test Statistic				0.223		Lilliefors GOF Test					
25	5% Lilliefors Critical Value				0.237		Data appear Normal at 5% Significance Level					
26	Data appear Approximate Normal at 5% Significance Level											
27												
28	Assuming Normal Distribution											
29	95% Normal UCL					95% UCLs (Adjusted for Skewness)						
30	95% Student's-t UCL				34.37		95% Adjusted-CLT UCL (Chen-1995)				36.04	
31							95% Modified-t UCL (Johnson-1978)				34.73	
32												
33	Gamma GOF Test											
34	A-D Test Statistic				0.41		Anderson-Darling Gamma GOF Test					
35	5% A-D Critical Value				0.744		Detected data appear Gamma Distributed at 5% Significance Level					
36	K-S Test Statistic				0.14		Kolmogrov-Smirnoff Gamma GOF Test					
37	5% K-S Critical Value				0.231		Detected data appear Gamma Distributed at 5% Significance Level					
38	Detected data appear Gamma Distributed at 5% Significance Level											
39												
40	Gamma Statistics											
41	k hat (MLE)				2.497		k star (bias corrected MLE)				2.01	
42	Theta hat (MLE)				10.18		Theta star (bias corrected MLE)				12.65	
43	nu hat (MLE)				69.91		nu star (bias corrected)				56.27	
44	MLE Mean (bias corrected)				25.43		MLE Sd (bias corrected)				17.94	
45							Approximate Chi Square Value (0.05)				40.03	
46	Adjusted Level of Significance				0.0312		Adjusted Chi Square Value				38.21	
47												
48	Assuming Gamma Distribution											
49	95% Approximate Gamma UCL (use when n>=50))				35.75		95% Adjusted Gamma UCL (use when n<50)				37.44	
50												
51	Lognormal GOF Test											
52	Shapiro Wilk Test Statistic				0.962		Shapiro Wilk Lognormal GOF Test					
53	5% Shapiro Wilk Critical Value				0.874		Data appear Lognormal at 5% Significance Level					
54	Lilliefors Test Statistic				0.114		Lilliefors Lognormal GOF Test					
55	5% Lilliefors Critical Value				0.237		Data appear Lognormal at 5% Significance Level					
56	Data appear Lognormal at 5% Significance Level											
57												

	A	B	C	D	E	F	G	H	I	J	K	L
58	Lognormal Statistics											
59	Minimum of Logged Data				2.079		Mean of logged Data				3.022	
60	Maximum of Logged Data				4.29		SD of logged Data				0.658	
61												
62	Assuming Lognormal Distribution											
63	95% H-UCL				38.74		90% Chebyshev (MVUE) UCL				38.87	
64	95% Chebyshev (MVUE) UCL				45.12		97.5% Chebyshev (MVUE) UCL				53.81	
65	99% Chebyshev (MVUE) UCL				70.87							
66												
67	Nonparametric Distribution Free UCL Statistics											
68	Data appear to follow a Discernible Distribution at 5% Significance Level											
69												
70	Nonparametric Distribution Free UCLs											
71	95% CLT UCL				33.73		95% Jackknife UCL				34.37	
72	95% Standard Bootstrap UCL				33.5		95% Bootstrap-t UCL				40.16	
73	95% Hall's Bootstrap UCL				66.06		95% Percentile Bootstrap UCL				34	
74	95% BCA Bootstrap UCL				36.14							
75	90% Chebyshev(Mean, Sd) UCL				40.57		95% Chebyshev(Mean, Sd) UCL				47.43	
76	97.5% Chebyshev(Mean, Sd) UCL				56.95		99% Chebyshev(Mean, Sd) UCL				75.64	
77												
78	Suggested UCL to Use											
79	95% Student's-t UCL				34.37							
80												
81	Note: Suggestions regarding the selection of a 95% UCL are provided to help the user to select the most appropriate 95% UCL.											
82	These recommendations are based upon the results of the simulation studies summarized in Singh, Singh, and Iaci (2002)											
83	and Singh and Singh (2003). However, simulations results will not cover all Real World data sets.											
84	For additional insight the user may want to consult a statistician.											
85												

	A	B	C	D	E	F	G	H	I	J	K	L
1	UCL Statistics for Uncensored Full Data Sets											
2												
3	User Selected Options											
4	Date/Time of Computation			23/10/2017 8:06:53 AM								
5	From File			WorkSheet.xls								
6	Full Precision			OFF								
7	Confidence Coefficient			95%								
8	Number of Bootstrap Operations			2000								
9												
10												
11	Nickel											
12												
13	General Statistics											
14	Total Number of Observations				14		Number of Distinct Observations				5	
15							Number of Missing Observations				0	
16	Minimum				1		Mean				2.786	
17	Maximum				7		Median				2	
18	SD				1.477		Std. Error of Mean				0.395	
19	Coefficient of Variation				0.53		Skewness				1.932	
20												
21	Normal GOF Test											
22	Shapiro Wilk Test Statistic				0.773		Shapiro Wilk GOF Test					
23	5% Shapiro Wilk Critical Value				0.874		Data Not Normal at 5% Significance Level					
24	Lilliefors Test Statistic				0.274		Lilliefors GOF Test					
25	5% Lilliefors Critical Value				0.237		Data Not Normal at 5% Significance Level					
26	Data Not Normal at 5% Significance Level											
27												
28	Assuming Normal Distribution											
29	95% Normal UCL					95% UCLs (Adjusted for Skewness)						
30	95% Student's-t UCL				3.485		95% Adjusted-CLT UCL (Chen-1995)				3.653	
31							95% Modified-t UCL (Johnson-1978)				3.519	
32												
33	Gamma GOF Test											
34	A-D Test Statistic				0.957		Anderson-Darling Gamma GOF Test					
35	5% A-D Critical Value				0.738		Data Not Gamma Distributed at 5% Significance Level					
36	K-S Test Statistic				0.277		Kolmogrov-Smirnoff Gamma GOF Test					
37	5% K-S Critical Value				0.229		Data Not Gamma Distributed at 5% Significance Level					
38	Data Not Gamma Distributed at 5% Significance Level											
39												
40	Gamma Statistics											
41	k hat (MLE)				4.901		k star (bias corrected MLE)				3.898	
42	Theta hat (MLE)				0.568		Theta star (bias corrected MLE)				0.715	
43	nu hat (MLE)				137.2		nu star (bias corrected)				109.2	
44	MLE Mean (bias corrected)				2.786		MLE Sd (bias corrected)				1.411	
45						Approximate Chi Square Value (0.05)				86.04		
46	Adjusted Level of Significance				0.0312		Adjusted Chi Square Value				83.32	
47												
48	Assuming Gamma Distribution											
49	95% Approximate Gamma UCL (use when n>=50))				3.534		95% Adjusted Gamma UCL (use when n<50)				3.649	
50												
51	Lognormal GOF Test											
52	Shapiro Wilk Test Statistic				0.889		Shapiro Wilk Lognormal GOF Test					
53	5% Shapiro Wilk Critical Value				0.874		Data appear Lognormal at 5% Significance Level					
54	Lilliefors Test Statistic				0.259		Lilliefors Lognormal GOF Test					
55	5% Lilliefors Critical Value				0.237		Data Not Lognormal at 5% Significance Level					
56	Data appear Approximate Lognormal at 5% Significance Level											
57												

	A	B	C	D	E	F	G	H	I	J	K	L
58	Lognormal Statistics											
59	Minimum of Logged Data				0		Mean of logged Data				0.919	
60	Maximum of Logged Data				1.946		SD of logged Data				0.463	
61												
62	Assuming Lognormal Distribution											
63	95% H-UCL				3.612		90% Chebyshev (MVUE) UCL				3.821	
64	95% Chebyshev (MVUE) UCL				4.298		97.5% Chebyshev (MVUE) UCL				4.96	
65	99% Chebyshev (MVUE) UCL				6.26							
66												
67	Nonparametric Distribution Free UCL Statistics											
68	Data appear to follow a Discernible Distribution at 5% Significance Level											
69												
70	Nonparametric Distribution Free UCLs											
71	95% CLT UCL				3.435		95% Jackknife UCL				3.485	
72	95% Standard Bootstrap UCL				3.42		95% Bootstrap-t UCL				3.993	
73	95% Hall's Bootstrap UCL				6.427		95% Percentile Bootstrap UCL				3.429	
74	95% BCA Bootstrap UCL				3.571							
75	90% Chebyshev(Mean, Sd) UCL				3.97		95% Chebyshev(Mean, Sd) UCL				4.506	
76	97.5% Chebyshev(Mean, Sd) UCL				5.251		99% Chebyshev(Mean, Sd) UCL				6.713	
77												
78	Suggested UCL to Use											
79	95% Student's-t UCL				3.485		or 95% Modified-t UCL				3.519	
80												
81	Note: Suggestions regarding the selection of a 95% UCL are provided to help the user to select the most appropriate 95% UCL.											
82	These recommendations are based upon the results of the simulation studies summarized in Singh, Singh, and Iaci (2002)											
83	and Singh and Singh (2003). However, simulations results will not cover all Real World data sets.											
84	For additional insight the user may want to consult a statistician.											
85												

	A	B	C	D	E	F	G	H	I	J	K	L
1	UCL Statistics for Uncensored Full Data Sets											
2												
3	User Selected Options											
4	Date/Time of Computation			23/10/2017 8:00:26 AM								
5	From File			WorkSheet.xls								
6	Full Precision			OFF								
7	Confidence Coefficient			95%								
8	Number of Bootstrap Operations			2000								
9												
10												
11	Zinc											
12												
13	General Statistics											
14	Total Number of Observations				14		Number of Distinct Observations				14	
15							Number of Missing Observations				0	
16	Minimum				21		Mean				82	
17	Maximum				220		Median				50	
18	SD				64.51		Std. Error of Mean				17.24	
19	Coefficient of Variation				0.787		Skewness				1.366	
20												
21	Normal GOF Test											
22	Shapiro Wilk Test Statistic				0.786		Shapiro Wilk GOF Test					
23	5% Shapiro Wilk Critical Value				0.874		Data Not Normal at 5% Significance Level					
24	Lilliefors Test Statistic				0.259		Lilliefors GOF Test					
25	5% Lilliefors Critical Value				0.237		Data Not Normal at 5% Significance Level					
26	Data Not Normal at 5% Significance Level											
27												
28	Assuming Normal Distribution											
29	95% Normal UCL					95% UCLs (Adjusted for Skewness)						
30	95% Student's-t UCL				112.5		95% Adjusted-CLT UCL (Chen-1995)				117.1	
31							95% Modified-t UCL (Johnson-1978)				113.6	
32												
33	Gamma GOF Test											
34	A-D Test Statistic				0.751		Anderson-Darling Gamma GOF Test					
35	5% A-D Critical Value				0.745		Data Not Gamma Distributed at 5% Significance Level					
36	K-S Test Statistic				0.233		Kolmogrov-Smirnoff Gamma GOF Test					
37	5% K-S Critical Value				0.231		Data Not Gamma Distributed at 5% Significance Level					
38	Data Not Gamma Distributed at 5% Significance Level											
39												
40	Gamma Statistics											
41	k hat (MLE)				2.194		k star (bias corrected MLE)				1.772	
42	Theta hat (MLE)				37.37		Theta star (bias corrected MLE)				46.29	
43	nu hat (MLE)				61.44		nu star (bias corrected)				49.61	
44	MLE Mean (bias corrected)				82		MLE Sd (bias corrected)				61.61	
45							Approximate Chi Square Value (0.05)				34.44	
46	Adjusted Level of Significance				0.0312		Adjusted Chi Square Value				32.76	
47												
48	Assuming Gamma Distribution											
49	95% Approximate Gamma UCL (use when n>=50))				118.1		95% Adjusted Gamma UCL (use when n<50)				124.2	
50												
51	Lognormal GOF Test											
52	Shapiro Wilk Test Statistic				0.931		Shapiro Wilk Lognormal GOF Test					
53	5% Shapiro Wilk Critical Value				0.874		Data appear Lognormal at 5% Significance Level					
54	Lilliefors Test Statistic				0.2		Lilliefors Lognormal GOF Test					
55	5% Lilliefors Critical Value				0.237		Data appear Lognormal at 5% Significance Level					
56	Data appear Lognormal at 5% Significance Level											
57												

	A	B	C	D	E	F	G	H	I	J	K	L
58	Lognormal Statistics											
59	Minimum of Logged Data				3.045		Mean of logged Data				4.162	
60	Maximum of Logged Data				5.394		SD of logged Data				0.703	
61												
62	Assuming Lognormal Distribution											
63	95% H-UCL				129.7		90% Chebyshev (MVUE) UCL				128.1	
64	95% Chebyshev (MVUE) UCL				149.7		97.5% Chebyshev (MVUE) UCL				179.7	
65	99% Chebyshev (MVUE) UCL				238.6							
66												
67	Nonparametric Distribution Free UCL Statistics											
68	Data appear to follow a Discernible Distribution at 5% Significance Level											
69												
70	Nonparametric Distribution Free UCLs											
71	95% CLT UCL				110.4		95% Jackknife UCL				112.5	
72	95% Standard Bootstrap UCL				109.1		95% Bootstrap-t UCL				131.8	
73	95% Hall's Bootstrap UCL				113.5		95% Percentile Bootstrap UCL				110.2	
74	95% BCA Bootstrap UCL				115.8							
75	90% Chebyshev(Mean, Sd) UCL				133.7		95% Chebyshev(Mean, Sd) UCL				157.1	
76	97.5% Chebyshev(Mean, Sd) UCL				189.7		99% Chebyshev(Mean, Sd) UCL				253.5	
77												
78	Suggested UCL to Use											
79	95% H-UCL				129.7							
80												
81	Note: Suggestions regarding the selection of a 95% UCL are provided to help the user to select the most appropriate 95% UCL.											
82	These recommendations are based upon the results of the simulation studies summarized in Singh, Singh, and Iaci (2002)											
83	and Singh and Singh (2003). However, simulations results will not cover all Real World data sets.											
84	For additional insight the user may want to consult a statistician.											
85												
86	ProUCL computes and outputs H-statistic based UCLs for historical reasons only.											
87	H-statistic often results in unstable (both high and low) values of UCL95 as shown in examples in the Technical Guide.											
88	It is therefore recommended to avoid the use of H-statistic based 95% UCLs.											
89	Use of nonparametric methods are preferred to compute UCL95 for skewed data sets which do not follow a gamma distribution.											
90												

	A	B	C	D	E	F	G	H	I	J	K	L
1	UCL Statistics for Data Sets with Non-Detects											
2												
3	User Selected Options											
4	Date/Time of Computation			23/10/2017 8:09:03 AM								
5	From File			WorkSheet.xls								
6	Full Precision			OFF								
7	Confidence Coefficient			95%								
8	Number of Bootstrap Operations			2000								
9												
10	Total PAHs											
11												
12	General Statistics											
13	Total Number of Observations				14		Number of Distinct Observations				5	
14	Number of Detects				5		Number of Non-Detects				9	
15	Number of Distinct Detects				4		Number of Distinct Non-Detects				1	
16	Minimum Detect				0.1		Minimum Non-Detect				0.05	
17	Maximum Detect				1.4		Maximum Non-Detect				0.05	
18	Variance Detects				0.293		Percent Non-Detects				64.29%	
19	Mean Detects				0.46		SD Detects				0.541	
20	Median Detects				0.3		CV Detects				1.177	
21	Skewness Detects				1.926		Kurtosis Detects				3.867	
22	Mean of Logged Detects				-1.278		SD of Logged Detects				1.1	
23												
24	Normal GOF Test on Detects Only											
25	Shapiro Wilk Test Statistic				0.748		Shapiro Wilk GOF Test					
26	5% Shapiro Wilk Critical Value				0.762		Detected Data Not Normal at 5% Significance Level					
27	Lilliefors Test Statistic				0.344		Lilliefors GOF Test					
28	5% Lilliefors Critical Value				0.396		Detected Data appear Normal at 5% Significance Level					
29	Detected Data appear Approximate Normal at 5% Significance Level											
30												
31	Kaplan-Meier (KM) Statistics using Normal Critical Values and other Nonparametric UCLs											
32	Mean			0.196		Standard Error of Mean				0.105		
33	SD			0.35		95% KM (BCA) UCL				N/A		
34	95% KM (t) UCL			0.381		95% KM (Percentile Bootstrap) UCL				N/A		
35	95% KM (z) UCL			0.368		95% KM Bootstrap t UCL				N/A		
36	90% KM Chebyshev UCL			0.51		95% KM Chebyshev UCL				0.652		
37	97.5% KM Chebyshev UCL			0.849		99% KM Chebyshev UCL				1.236		
38												
39	Gamma GOF Tests on Detected Observations Only											
40	A-D Test Statistic			0.416		Anderson-Darling GOF Test						
41	5% A-D Critical Value			0.69		Detected data appear Gamma Distributed at 5% Significance Level						
42	K-S Test Statistic			0.231		Kolmogrov-Smirnoff GOF						
43	5% K-S Critical Value			0.364		Detected data appear Gamma Distributed at 5% Significance Level						
44	Detected data appear Gamma Distributed at 5% Significance Level											
45												
46	Gamma Statistics on Detected Data Only											
47	k hat (MLE)			1.135		k star (bias corrected MLE)				0.587		
48	Theta hat (MLE)			0.405		Theta star (bias corrected MLE)				0.783		
49	nu hat (MLE)			11.35		nu star (bias corrected)				5.874		
50	MLE Mean (bias corrected)			0.46		MLE Sd (bias corrected)				0.6		
51												
52	Gamma Kaplan-Meier (KM) Statistics											
53	k hat (KM)			0.315		nu hat (KM)				8.833		
54	Approximate Chi Square Value (8.83, α)			3.226		Adjusted Chi Square Value (8.83, β)				2.793		
55	95% Gamma Approximate KM-UCL (use when n>=50)			0.538		95% Gamma Adjusted KM-UCL (use when n<50)				0.621		
56												
57	Gamma ROS Statistics using Imputed Non-Detects											

	A	B	C	D	E	F	G	H	I	J	K	L
58	GROS may not be used when data set has > 50% NDs with many tied observations at multiple DLs											
59	GROS may not be used when kstar of detected data is small such as < 0.1											
60	For such situations, GROS method tends to yield inflated values of UCLs and BTVs											
61	For gamma distributed detected data, BTVs and UCLs may be computed using gamma distribution on KM estimates											
62		Minimum	0.01							Mean	0.171	
63		Maximum	1.4							Median	0.01	
64		SD	0.374							CV	2.194	
65		k hat (MLE)	0.399							k star (bias corrected MLE)	0.361	
66		Theta hat (MLE)	0.428							Theta star (bias corrected MLE)	0.473	
67		nu hat (MLE)	11.18							nu star (bias corrected)	10.12	
68		MLE Mean (bias corrected)	0.171							MLE Sd (bias corrected)	0.284	
69										Adjusted Level of Significance (β)	0.0312	
70		Approximate Chi Square Value (10.12, α)	4.014							Adjusted Chi Square Value (10.12, β)	3.519	
71		95% Gamma Approximate UCL (use when $n \geq 50$)	0.43							95% Gamma Adjusted UCL (use when $n < 50$)	0.491	
72												
73	Lognormal GOF Test on Detected Observations Only											
74		Shapiro Wilk Test Statistic	0.901							Shapiro Wilk GOF Test		
75		5% Shapiro Wilk Critical Value	0.762							Detected Data appear Lognormal at 5% Significance Level		
76		Lilliefors Test Statistic	0.224							Lilliefors GOF Test		
77		5% Lilliefors Critical Value	0.396							Detected Data appear Lognormal at 5% Significance Level		
78	Detected Data appear Lognormal at 5% Significance Level											
79												
80	Lognormal ROS Statistics Using Imputed Non-Detects											
81		Mean in Original Scale	0.171							Mean in Log Scale	-3.876	
82		SD in Original Scale	0.374							SD in Log Scale	2.409	
83		95% t UCL (assumes normality of ROS data)	0.348							95% Percentile Bootstrap UCL	0.349	
84		95% BCA Bootstrap UCL	0.426							95% Bootstrap t UCL	0.762	
85		95% H-UCL (Log ROS)	14.97									
86												
87	UCLs using Lognormal Distribution and KM Estimates when Detected data are Lognormally Distributed											
88		KM Mean (logged)	-2.382							95% H-UCL (KM -Log)	0.339	
89		KM SD (logged)	1.012							95% Critical H Value (KM-Log)	2.811	
90		KM Standard Error of Mean (logged)	0.302									
91												
92	DL/2 Statistics											
93		DL/2 Normal								DL/2 Log-Transformed		
94		Mean in Original Scale	0.18							Mean in Log Scale	-2.828	
95		SD in Original Scale	0.37							SD in Log Scale	1.345	
96		95% t UCL (Assumes normality)	0.356							95% H-Stat UCL	0.52	
97	DL/2 is not a recommended method, provided for comparisons and historical reasons											
98												
99	Nonparametric Distribution Free UCL Statistics											
100	Detected Data appear Approximate Normal Distributed at 5% Significance Level											
101												
102	Suggested UCL to Use											
103		95% KM (t) UCL	0.381							95% KM (Percentile Bootstrap) UCL	N/A	
104	Warning: One or more Recommended UCL(s) not available!											
105												
106	Note: Suggestions regarding the selection of a 95% UCL are provided to help the user to select the most appropriate 95% UCL.											
107	Recommendations are based upon data size, data distribution, and skewness.											
108	These recommendations are based upon the results of the simulation studies summarized in Singh, Maichle, and Lee (2006).											
109	However, simulations results will not cover all Real World data sets; for additional insight the user may want to consult a statistician.											
110												

	A	B	C	D	E	F	G	H	I	J	K	L
1	UCL Statistics for Data Sets with Non-Detects											
2												
3	User Selected Options											
4	Date/Time of Computation			23/10/2017 8:11:06 AM								
5	From File			WorkSheet.xls								
6	Full Precision			OFF								
7	Confidence Coefficient			95%								
8	Number of Bootstrap Operations			2000								
9												
10	BaP											
11												
12	General Statistics											
13	Total Number of Observations				14		Number of Distinct Observations				3	
14	Number of Detects				3		Number of Non-Detects				11	
15	Number of Distinct Detects				2		Number of Distinct Non-Detects				1	
16	Minimum Detect				0.06		Minimum Non-Detect				0.05	
17	Maximum Detect				0.1		Maximum Non-Detect				0.05	
18	Variance Detects				5.3333E-4		Percent Non-Detects				78.57%	
19	Mean Detects				0.0733		SD Detects				0.0231	
20	Median Detects				0.06		CV Detects				0.315	
21	Skewness Detects				1.732		Kurtosis Detects				N/A	
22	Mean of Logged Detects				-2.643		SD of Logged Detects				0.295	
23												
24	Warning: Data set has only 3 Detected Values.											
25	This is not enough to compute meaningful or reliable statistics and estimates.											
26												
27												
28	Normal GOF Test on Detects Only											
29	Shapiro Wilk Test Statistic				0.75		Shapiro Wilk GOF Test					
30	5% Shapiro Wilk Critical Value				0.767		Detected Data Not Normal at 5% Significance Level					
31	Lilliefors Test Statistic				0.385		Lilliefors GOF Test					
32	5% Lilliefors Critical Value				0.512		Detected Data appear Normal at 5% Significance Level					
33	Detected Data appear Approximate Normal at 5% Significance Level											
34												
35	Kaplan-Meier (KM) Statistics using Normal Critical Values and other Nonparametric UCLs											
36	Mean			0.055		Standard Error of Mean				0.00424		
37	SD			0.013		95% KM (BCA) UCL				N/A		
38	95% KM (t) UCL			0.0625		95% KM (Percentile Bootstrap) UCL				N/A		
39	95% KM (z) UCL			0.062		95% KM Bootstrap t UCL				N/A		
40	90% KM Chebyshev UCL			0.0677		95% KM Chebyshev UCL				0.0735		
41	97.5% KM Chebyshev UCL			0.0815		99% KM Chebyshev UCL				0.0972		
42												
43	Gamma GOF Tests on Detected Observations Only											
44	Not Enough Data to Perform GOF Test											
45												
46	Gamma Statistics on Detected Data Only											
47	k hat (MLE)			16.61		k star (bias corrected MLE)				N/A		
48	Theta hat (MLE)			0.00441		Theta star (bias corrected MLE)				N/A		
49	nu hat (MLE)			99.69		nu star (bias corrected)				N/A		
50	MLE Mean (bias corrected)			N/A		MLE Sd (bias corrected)				N/A		
51												
52	Gamma Kaplan-Meier (KM) Statistics											
53	k hat (KM)			18.02		nu hat (KM)				504.6		
54						Adjusted Level of Significance (β)				0.0312		
55	Approximate Chi Square Value (504.60, α)			453.5		Adjusted Chi Square Value (504.60, β)				447.1		
56	95% Gamma Approximate KM-UCL (use when n>=50)			0.0612		95% Gamma Adjusted KM-UCL (use when n<50)				0.0621		
57												

	A	B	C	D	E	F	G	H	I	J	K	L
58	Lognormal GOF Test on Detected Observations Only											
59	Shapiro Wilk Test Statistic					0.75	Shapiro Wilk GOF Test					
60	5% Shapiro Wilk Critical Value					0.767	Detected Data Not Lognormal at 5% Significance Level					
61	Lilliefors Test Statistic					0.385	Lilliefors GOF Test					
62	5% Lilliefors Critical Value					0.512	Detected Data appear Lognormal at 5% Significance Level					
63	Detected Data appear Approximate Lognormal at 5% Significance Level											
64												
65	Lognormal ROS Statistics Using Imputed Non-Detects											
66	Mean in Original Scale					0.0315	Mean in Log Scale					-3.743
67	SD in Original Scale					0.0261	SD in Log Scale					0.785
68	95% t UCL (assumes normality of ROS data)					0.0438	95% Percentile Bootstrap UCL					0.0433
69	95% BCA Bootstrap UCL					0.0468	95% Bootstrap t UCL					0.0499
70	95% H-UCL (Log ROS)					0.055						
71												
72	UCLs using Lognormal Distribution and KM Estimates when Detected data are Lognormally Distributed											
73	KM Mean (logged)					-2.92	95% H-UCL (KM -Log)					0.0601
74	KM SD (logged)					0.183	95% Critical H Value (KM-Log)					1.806
75	KM Standard Error of Mean (logged)					0.0598						
76												
77	DL/2 Statistics											
78	DL/2 Normal					DL/2 Log-Transformed						
79	Mean in Original Scale					0.0354	Mean in Log Scale					-3.465
80	SD in Original Scale					0.0225	SD in Log Scale					0.46
81	95% t UCL (Assumes normality)					0.046	95% H-Stat UCL					0.0449
82	DL/2 is not a recommended method, provided for comparisons and historical reasons											
83												
84	Nonparametric Distribution Free UCL Statistics											
85	Detected Data appear Approximate Normal Distributed at 5% Significance Level											
86												
87	Suggested UCL to Use											
88	95% KM (t) UCL					0.0625	95% KM (Percentile Bootstrap) UCL					N/A
89	Warning: One or more Recommended UCL(s) not available!											
90												
91	Note: Suggestions regarding the selection of a 95% UCL are provided to help the user to select the most appropriate 95% UCL.											
92	Recommendations are based upon data size, data distribution, and skewness.											
93	These recommendations are based upon the results of the simulation studies summarized in Singh, Maichle, and Lee (2006).											
94	However, simulations results will not cover all Real World data sets; for additional insight the user may want to consult a statistician.											
95												